



Entergy Services, LLC  
639 Loyola Avenue  
P. O. Box 61000  
New Orleans, LA 70161-1000  
Tel 504 576 2984  
Fax 504 576 5579  
hbarton@entergy.com

Harry M. Barton  
Senior Counsel  
Legal Department -- Regulatory

January 10, 2020

**Via Hand Delivery**

Lora W. Johnson, CMC, LMMC  
Clerk of Council  
Room 1E09, City Hall  
1300 Perdido Street  
New Orleans, LA 70112


**Re: Rulemaking Proceeding to Establish Rules for Community Solar Projects  
CNO Docket No. UD-18-03**

Dear Ms. Johnson:

Enclosed for your further handling please find an original and three copies of Entergy New Orleans, LLC's ("ENO") Supplemental Implementation Plan, together with Exhibits thereto, in connection with the above-referenced matter. Please file an original and two copies into the record, and return a date-stamped copy to our courier.

Should you have any questions, please do not hesitate to contact me. Thanking you in advance for your usual courtesy and assistance with this matter.

Sincerely,

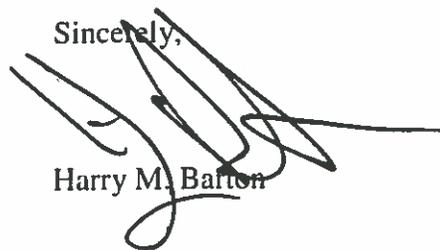

Harry M. Barton

HMB/bkd  
Enclosures  
cc: Official Service List

RECEIVED  
JAN 10 2020  
BY: NR

**BEFORE THE  
COUNCIL OF THE CITY OF NEW ORLEANS**

**IN RE: A RULEMAKING )  
PROCEEDING TO ESTABLISH )  
RULES FOR COMMUNITY SOLAR ) DOCKET NO. UD-18-03  
PROJECTS )**

**ENTERGY NEW ORLEANS, LLC'S SUPPLEMENTAL  
IMPLEMENTATION PLAN FOR THE  
COUNCIL OF THE CITY OF NEW ORLEANS' COMMUNITY SOLAR RULES**

Pursuant to Council Resolution No. R-19-111, Entergy New Orleans, LLC (“ENO” or the “Company”) hereby submits its Supplemental Implementation Plan (“Supplemental Plan”) for implementing the Council of the City of New Orleans’ (“Council”) Community Solar Rules. On August 29, 2019, the Company submitted its Community Solar Program (“CSP”) Implementation Plan (“Plan”) and supporting attachments as required by Council Resolution No. R-19-111 (the “Resolution”). The submission of the Plan followed a year-long rulemaking and resulted from ENO’s in-depth review of the Council’s Community Solar Rules (“Rules”) and evaluation of what ENO would need to do to comply with those Rules. The Plan was also informed by a technical conference between ENO, the Advisors, and all parties to this Docket. In all, the Plan contained some 139 pages of materials developed by ENO in order to comply with the Council’s Rules and begin implementation of the Council’s CSP.

On September 30, 2019, the Advisors submitted their Comments on ENO’s Plan and the attendant documents included with the Plan. The Advisors’ Comments suggest several material revisions to those documents. On October 15, 2019, ENO submitted Reply Comments to the Advisors’ Comments that discussed some of the issues raised in the Advisors’ Comments and committed to addressing all outstanding items with the filing of the Supplemental Plan. With this

Supplemental Plan, ENO submits documents that have been modified to reflect the Advisors' input and discusses cost recovery issues that will need to be resolved by the Council.

### **1. Revised Documents.**

With this Supplemental Plan, ENO is submitting revisions to several documents and forms that were submitted with the Plan in August 2019. The revisions to these documents reflect input from the Advisors' Comments. As ENO noted in its Reply Comments, some of the Advisors' suggestions for revising the Plan touched on issues that are within ENO's managerial discretion, pursuant to legal standards outline in ENO's Reply Comments. However, after review of the Advisors' Comments, ENO believes it has been able to accommodate most, if not all, of the Advisors' suggestions for revisions to the documents initially filed with the Plan. For these revised documents, ENO is submitting both a "redlined" and "clean" version of the documents for the parties' review and consideration. The revised documents submitted with this Supplemental Plan are as follows:

- **Exhibit A**: Revised Form CSG-1, Program Application for CSG Facilities. Exhibit A-1 is the "redlined" version; Exhibit A-2 is the "clean" version; all of ENO's revised document Exhibits follow this format;
- **Exhibit B**: Revised Form CSG-2, Interconnection Application for CSG Facilities;
- **Exhibit C**: Revised Form CSG-3, Interconnection and Operation Agreement for CSG Facilities;
- **Exhibit D**: Revised Form CSG-4, Standard Offer Power Purchase Agreement for CSG Facilities;
- **Exhibit E**: Revised Form CSG-5, Initial CSG Facility Subscription Report;
- **Exhibit F**: Revised Form CSG-8, Subscriber Agency Agreement; and
- **Exhibit G**: Revised Proposed Rate Schedule for Community Solar Generating Facilities ("Schedule CSGF").

ENO is also submitting, and attaching as **Exhibit H**, Distribution Standard No. DR07-01, Rev. 17, entitled, “Distributed Energy Resource Standards for Interconnection.” This updated Standard became effective December 15, 2019 and supersedes the prior Distribution Standards DR07-01 and DR07-02. The updated DR07-01 provides a single Distribution Standard applicable to all distributed energy resources (“DERs”) that will be interconnected to ENO’s distribution grid, as well as distribution grids operated by any other individual regulated utility operating companies that are subsidiaries of Entergy Corporation.

## **2. Staffing Needs.**

ENO’s Implementation Plan discussed the need to hire a full-time employee to serve as the Community Solar Program Manager (“CSPM”). The Advisors’ Comments expressed concern over whether ENO needed to hire a new employee to fill this role. In ENO’s Reply Comments, ENO laid out in detail the reasons that a new employee would be needed to perform the functions required under the Rules and to implement the CSP according to the Council’s directives and the suggestions from the Advisors’ Comments. ENO has continued to evaluate this issue and still believes it will be necessary to hire a full-time employee to serve as the CSPM, for the reasons stated in the initial Plan and in ENO’s Reply Comments. ENO anticipates that it will be able to hire the CSPM and begin accepting applications for the CSP within four months of receiving Council approval of the Supplemental Plan and associated documents and forms.

## **3. Cost Recovery Issues.**

ENO’s Reply Comments addressed several issues related to recovery of ENO’s costs in implementing the Council’s Rules and the CSP – such as correcting the misconception that ENO’s proposal to recover such costs through a Formula Rate Plan (“FRP”) filing would “guarantee dollar for dollar recovery” of the costs. Subsequent to the filing of ENO’s Reply Comments, the Council adopted Council Resolution No. R-19-457, which attempted to resolve all issues pending before

the Council related to ENO's 2018 Combined Rate Case. Resolution R-19-457 authorizes ENO to submit FRPs to the Council, beginning in 2020. This process would allow for ENO to, among other things, submit the costs incurred in implementing the CSP and otherwise complying with the Rules for the Council's review and approval in conjunction with that future FRP proceeding.

Several outstanding matters related to the 2018 Rate Case and Resolution No. R-19-457 may affect the implementation of Resolution R-19-457 and the filing of an FRP in 2020. On December 6, 2019, ENO filed an appeal and request for judicial review of Resolution No. R-19-457 with the Civil District Court for the Parish of Orleans, which appeal also requested a stay of, or injunctive relief from, Resolution No. R-19-457 during the pendency of ENO's appeal. On December 9, 2019, ENO also submitted a Compliance Filing Subject to Injunctive Relief and Pending Judicial Review of Resolution R-19-457. That filing seeks to, subject to a full reservation of ENO's right to seek judicial review of R-19-457, facilitate further consideration by the Council that may enable implementation of rates as contemplated by R-19-457. ENO seeks to continue working toward an amicable resolution to the issues raised in ENO's appeal and the Compliance Filing. ENO will continue to monitor these issues as related to cost recovery for expenses incurred in implementing the Council's Rules and the CSP.


The Advisors' Comments also requested that ENO provide specific accounts to which ENO's expenses would be coded when they are incurred. ENO does not yet possess this information because the internal project codes specific to the administration of the CSP have not yet been created. ENO will create a unique project code(s) that are to be used to track the costs associated with the CSP. Employees will charge the specific projects related to the respective scope of work. Employees will be educated on the types of activities that can be charged to the CSP projects and only those employees involved in the implementation and administration of the

CSP will be given the project codes. Depending upon the activities being performed, certain operating and maintenance accounts (non-fuel FERC Accounts ranging in 500 series and 900 series) will be derived. ENO will routinely review the transactions recorded on the CSP project codes to ensure completeness and accuracy of charges. The specific FERC accounts are not known at this time and will be based on activities performed related to managing and implementing the CSP. ENO can provide the specific project codes being used to track the program costs once they are created.

#### **4. Conclusion**

ENO requests that the Council approve the Supplemental Plan for Implementation of the Council's CSP and Rules, along with the documents attached hereto for use in implementing the Rules.

By: \_\_\_\_\_

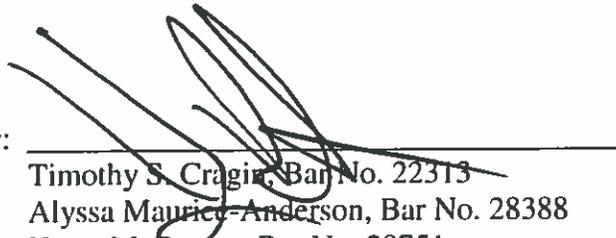

Timothy S. Cragin, Bar No. 22313  
Alyssa Maurice-Anderson, Bar No. 28388  
Harry M. Barton, Bar No. 29751  
639 Loyola Avenue, Mail Unit L-ENT-26E  
New Orleans, Louisiana 70113  
Telephone: (504) 576-2984  
Facsimile: (504) 576-5579

**ATTORNEYS FOR  
ENERGY NEW ORLEANS, LLC**

**CERTIFICATE OF SERVICE**  
**Docket No. UD-18-03**

I hereby certify that I have served the required number of copies of the foregoing report upon all other known parties of this proceeding, by the following: electronic mail, facsimile, overnight mail, hand delivery, and/or United States Postal Service, postage prepaid.

Lora W. Johnson, CMC, LMMC  
Clerk of Council  
Council of the City of New Orleans  
City Hall, Room 1E09  
1300 Perdido Street  
New Orleans, LA 70112

Erin Spears, Chief of Staff  
Bobbie Mason  
Christopher Roberts  
Council Utilities Regulatory Office  
City of New Orleans  
City Hall, Room 6E07  
1300 Perdido Street  
New Orleans, LA 70112

Andrew Tuzzolo  
CM Moreno Chief of Staff  
1300 Perdido Street, Room 2W40  
New Orleans, LA

David Gavlinski  
Council Chief of Staff  
New Orleans City Council  
City Hall, Room 1E06  
1300 Perdido Street  
New Orleans, LA 70112

Sunni LeBeouf  
City Attorney Office  
City Hall, Room 5th Floor  
1300 Perdido Street  
New Orleans, LA 70112

Norman White  
Department of Finance  
City Hall, Room 3E06  
1300 Perdido Street  
New Orleans, LA 70112

Jonathan M. Rhodes,  
Director of Utilities, Mayor's Office  
City Hall – Room 2E04  
1300 Perdido Street  
New Orleans, LA 70112

Hon. Jeffery S. Gulin  
3203 Bridle Ridge Lane  
Lutherville, MD 21093

Clinton A. Vince, Esq.  
Presley R. Reed, Jr., Esq.  
Emma F. Hand, Esq.  
Herminia Gomez  
Dentons US LLP  
1900 K Street NW  
Washington, DC 20006

Basile J. Uddo, Esq.  
J.A. "Jay" Beatmann, Jr.  
c/o Dentons US LLP  
The Poydras Center  
650 Poydras Street, Suite 2850  
New Orleans, LA 70130-6132

Joseph W. Rogers  
Victor M. Prep  
Byron S. Watson  
Legend Consulting Group  
6041 South Syracuse Way, Suite 105  
Greenwood Village, CO 80111

Errol Smith, CPA  
Bruno and Tervalon  
4298 Elysian Fields Avenue  
New Orleans, LA 70122

Brian L. Guillot  
VP, Regulatory Affairs  
Entergy New Orleans, LLC  
Mail Unit L-MAG-505B  
1600 Perdido Street  
New Orleans, LA 70112

Timothy S. Cragin  
Harry M. Barton  
Alyssa Maurice-Anderson  
Entergy Services, LLC  
Mail Unit L-ENT-26E  
639 Loyola Avenue  
New Orleans, LA 70113

Polly S. Rosemond  
Seth Cureington  
Derek Mills  
Keith Wood  
Kevin Boleware  
Entergy New Orleans, LLC  
Mail Unit L-MAG-505B  
1600 Perdido Street  
New Orleans, LA 70112

Joseph J. Romano, III  
Suzanne Fontan  
Therese Perrault  
Entergy Services, LLC  
Mail Unit L-ENT-4C  
639 Loyola Avenue  
New Orleans, LA 70113

Andy Kowalczyk  
350 New Orleans  
1115 Congress St.  
New Orleans, LA 70117

Benjamin Quimby  
1621 S. Rampart St.  
New Orleans, LA 70113

Renate Heurich  
350 Louisiana  
1407 Napoleon Avenue, Suite #C  
New Orleans, LA 70115

Katherine W. King  
Randy Young  
Kean Miller LLP  
400 Convention Street, Suite 700  
Post Office Box 3513  
Baton Rouge, LA 70821


Carrie Tournillon  
Kean Miller LLP  
900 Poydras Street, Suite 3600  
New Orleans, 70112

Maurice Brubaker  
Air Products and Chemicals, Inc.  
16690 Swingly Ridge Road, Suite 140  
Chesterfield, MO 63017

Logan Atkinson Burke  
Sophie Zaken  
Alliance for Affordable Energy  
4505 S. Claiborne Avenue  
New Orleans, La 70125

Jeffery D. Cantin  
Stephen Wright  
Gulf States Renewable Energy Industries  
Association  
400 Poydras Street, Suite 900  
New Orleans, LA 70130

New Orleans, Louisiana this 10<sup>th</sup> day of January, 2020.

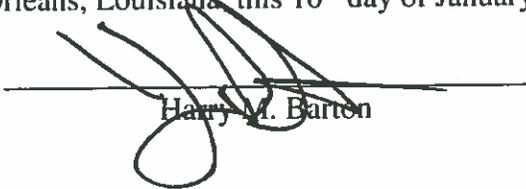  
Harry M. Barton

ENTERGY NEW ORLEANS, LLC  
PROGRAM APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
LOCATED IN ORLEANS PARISH  
FORM CSG-1

**Application Instructions**

All required information and supporting documentation must be submitted in order for this Application to be considered complete. Submit the completed Form CSG-1 and all supporting documentation to Entergy New Orleans via email: [NewOrleansCouncilCommunitySolar@Entergy.com](mailto:NewOrleansCouncilCommunitySolar@Entergy.com). Any questions related to this form should also be sent to [NewOrleansCouncilCommunitySolar@Entergy.com](mailto:NewOrleansCouncilCommunitySolar@Entergy.com).

The following documentation must be submitted with this Application:

- Proof of Subscriber Organization registration with New Orleans City Council via the Council's Utility Regulatory Office ("**CURO**");
- Proof of application for all applicable permits to construct and operate the CSG Facility; and
- Proof of Site Control (evidence of property ownership, **executed option to purchase lease**, or executed lease agreement)

**Subscriber Organization:**

Subscriber Organization Name: \_\_\_\_\_

Subscriber Organization Identification number (provided by Council **through CURO**): \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Contact Person: \_\_\_\_\_

Telephone Number: \_\_\_\_\_ Email: \_\_\_\_\_

Entergy Account Number **(may be assigned if account does not yet exist)**: \_\_\_\_\_

ENTERGY NEW ORLEANS, LLC  
PROGRAM APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
LOCATED IN ORLEANS PARISH  
FORM CSG-1

Proposed location of Community Solar Generating Facility

Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Proposed Generating capacity of Community Solar Generating Facility:

Kilowatts-DC: \_\_\_\_\_ Kilowatts-AC: \_\_\_\_\_

Expected Annual Energy Production of Community Solar Generating Facility:

MWh per year: \_\_\_\_\_

***Application must contain signature of Subscriber Organization representative to be processed. A Company representative will execute and date below once all required information has been submitted and the Application has been approved. That approval date shall represent the start of the time period contemplated under Section VII(D)(11-12) of the Council's Community Solar Rules.***

Subscriber Organization:

Company Name: \_\_\_\_\_

Signature: \_\_\_\_\_

Name: \_\_\_\_\_ Title: \_\_\_\_\_

Date: \_\_\_\_\_

Company:

Company Name: Entergy New Orleans, LLC

Signature: \_\_\_\_\_

Name: \_\_\_\_\_ Title: \_\_\_\_\_

Date: \_\_\_\_\_

ENTERGY NEW ORLEANS, LLC  
PROGRAM APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
LOCATED IN ORLEANS PARISH  
FORM CSG-1

**Application Instructions**

All required information and supporting documentation must be submitted in order for this Application to be considered complete. Submit the completed Form CSG-1 and all supporting documentation to Entergy New Orleans via email: [NewOrleansCouncilCommunitySolar@Entergy.com](mailto:NewOrleansCouncilCommunitySolar@Entergy.com). Any questions related to this form should also be sent to [NewOrleansCouncilCommunitySolar@Entergy.com](mailto:NewOrleansCouncilCommunitySolar@Entergy.com).

The following documentation must be submitted with this Application:

- Proof of Subscriber Organization registration with New Orleans City Council via the Council's Utility Regulatory Office ("CURO");
- Proof of application for all applicable permits to construct and operate the CSG Facility; and
- Proof of Site Control (evidence of property ownership, executed option to purchase lease, or executed lease agreement)

**Subscriber Organization:**

Subscriber Organization

Name: \_\_\_\_\_

Subscriber Organization Identification  
number (provided by Council through  
CURO): \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Contact Person: \_\_\_\_\_

Telephone Number: \_\_\_\_\_ Email: \_\_\_\_\_

Entergy Account Number  
(may be assigned if account  
does not yet exist): \_\_\_\_\_

ENTERGY NEW ORLEANS, LLC  
PROGRAM APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
LOCATED IN ORLEANS PARISH  
FORM CSG-1

**Proposed location of Community Solar Generating Facility**

Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Proposed Generating capacity of Community Solar Generating Facility:

Kilowatts-DC: \_\_\_\_\_ Kilowatts-AC: \_\_\_\_\_

Expected Annual Energy Production of Community Solar Generating Facility:

MWh per year: \_\_\_\_\_

***Application must contain signature of Subscriber Organization representative to be processed. A Company representative will execute and date below once all required information has been submitted and the Application has been approved. That approval date shall represent the start of the time period contemplated under Section VII(D)(11-12) of the Council's Community Solar Rules.***

**Subscriber Organization:**

Company Name: \_\_\_\_\_

Signature: \_\_\_\_\_

Name: \_\_\_\_\_ Title: \_\_\_\_\_

Date: \_\_\_\_\_

**Company:**

Company Name: Entergy New Orleans, LLC \_\_\_\_\_

Signature: \_\_\_\_\_

Name: \_\_\_\_\_ Title: \_\_\_\_\_

Date: \_\_\_\_\_

ENTERGY NEW ORLEANS, LLC  
INTERCONNECTION APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
LOCATED IN ORLEANS PARISH  
FORM CSG-2

**Application Instructions**

All required information and supporting documentation must be submitted by Subscriber Organization for Application to be considered complete. Submit this completed Form CSG-2 and all supporting documentation to Entergy New Orleans, LLC ("ENO" or "the Company") via email: [NewOrleansCouncilCommunitySolar@Entergy.com](mailto:NewOrleansCouncilCommunitySolar@Entergy.com). Any questions related to this form should also be sent to [NewOrleansCouncilCommunitySolar@Entergy.com](mailto:NewOrleansCouncilCommunitySolar@Entergy.com).

The following documentation must be submitted with this Application:

- One-line Diagram with location of accessible disconnect clearly shown; and
- Manufacturer literature describing the specific system to be installed

**Section 1. Subscriber Organization Information**

Subscriber Organization

Name: \_\_\_\_\_

Subscriber Organization Identification

number (provided by Council through the Council's Utility Regulatory Office): \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Contact Person: \_\_\_\_\_

Telephone Number: \_\_\_\_\_ Email: \_\_\_\_\_

Entergy Account

Number (may be assigned if account does not yet exist): \_\_\_\_\_

ENTERGY NEW ORLEANS, LLC  
 INTERCONNECTION APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
 LOCATED IN ORLEANS PARISH  
 FORM CSG-2

**Community Solar Generating Facility:**

Facility Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Contact Person: \_\_\_\_\_

Telephone Number: \_\_\_\_\_ Email: \_\_\_\_\_

**Section 2. Generator/Facility Information**

Provide the following	Solar Generator	Inverter
Manufacturer:		
Model Number:		
Number of Units:		
Kilowatt Rating(s) (95° at location)		
Ampere Rating:	N/A	
Short Circuit Current:	N/A	
Tilt Angle (°):		N/A
Azimuth Angle (°):		N/A
Number of phases at Interconnection point:		N/A
Voltage at Interconnection point:		N/A
Proposed output at this site (kW-AC):		N/A

**Does the unit:**

- Disconnect intertie within 10 cycles of a service interruption or fault?  
 Yes \_\_\_\_\_ No \_\_\_\_\_
- Block Generator from energizing dead circuits for five minutes after most recent fault?  
 Yes \_\_\_\_\_ No \_\_\_\_\_

ENTERGY NEW ORLEANS, LLC  
INTERCONNECTION APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
LOCATED IN ORLEANS PARISH  
FORM CSG-2

Codes, Standards, and Rules

The system shall be installed in compliance with the Building/Electrical Code of the City of New Orleans, Orleans Parish and Form CSG-3, Interconnection and Parallel Operation of Community Solar Generating Facility Agreement ("Interconnection Agreement"), executed by and between Subscriber Organization and ENO. This system meets the most current version of the applicable Entergy Standard, Entergy Standard DR07-01 "Distributed Energy Resource Standards for Interconnection. either the Entergy Standard DR07-02, "Connecting Small Electric Generators to the Entergy Distribution System (less than 300kVA)," or Entergy Standard DR07-01, "Connecting Large Electric Generators to the Entergy Distribution System (300kVA to 20MVA)." The interconnection protection system is tested and listed for compliance with the latest published edition of Underwriters Laboratories (UL) 1741 including the anti-islanding test. The system will be installed in compliance with IEEE 929 and/or IEEE 1547 as applicable, all manufacturer specifications, the National Electric Code, and all local codes. No protection settings affecting anti-islanding have been or will be adjusted or modified. The system shall be installed in accordance with the attached one-line diagram.

The Community Solar Generating ("CSG") Facility shall meet the requirements of the New Orleans Community Solar Rules ("Rules") promulgated by the Council in Resolution No. R-19-111, in Docket No. UD-18-03.

The parties shall be subject to the provisions of the Rules, the terms and conditions set forth in this Application, the Company's applicable rate tariff schedules, and the executed Interconnection Agreement.

Permits and Authorizations

The Subscriber Organization shall obtain and maintain any governmental authorizations and permits required for the construction and operation of the Facility and interconnection facilities before the facility is interconnected. The Subscriber Organization shall maintain the Facility and interconnection facilities in a safe and reliable manner and in conformance with all applicable laws and regulations.

Interconnection Agreement

Interconnection of the CSG Facility shall be subject to the terms and conditions of the Interconnection Agreement, executed by and between Subscriber Organization and ENO. The CSG Facility shall not commence commercial operation until it has been inspected and approved by the Company and the Form CSG-3 Interconnection Agreement has been executed between the parties.

ENTERGY NEW ORLEANS, LLC  
INTERCONNECTION APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
LOCATED IN ORLEANS PARISH  
FORM CSG-2

I hereby certify that the information provided on this Interconnection Application is true and correct and that the CSG Facility will comply with the conditions stated above.

Signature of Subscriber Organization: \_\_\_\_\_

Printed Name: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Telephone: \_\_\_\_\_ Projected Installation Date: \_\_\_\_\_

ENTERGY NEW ORLEANS, LLC  
INTERCONNECTION APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
LOCATED IN ORLEANS PARISH  
FORM CSG-2

**Application Instructions**

All required information and supporting documentation must be submitted by Subscriber Organization for Application to be considered complete. Submit this completed Form CSG-2 and all supporting documentation to Entergy New Orleans, LLC ("ENO" or "the Company") via email: [NewOrleansCouncilCommunitySolar@Entergy.com](mailto:NewOrleansCouncilCommunitySolar@Entergy.com). Any questions related to this form should also be sent to [NewOrleansCouncilCommunitySolar@Entergy.com](mailto:NewOrleansCouncilCommunitySolar@Entergy.com).

The following documentation must be submitted with this Application:

- One-line Diagram with location of accessible disconnect clearly shown; and
- Manufacturer literature describing the specific system to be installed

**Section 1. Subscriber Organization Information**

Subscriber Organization  
Name: \_\_\_\_\_

Subscriber Organization Identification  
number (provided by Council through the  
Council's Utility Regulatory Office): \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Contact Person: \_\_\_\_\_

Telephone Number: \_\_\_\_\_ Email: \_\_\_\_\_

Entergy Account  
Number(may be assigned if  
account does not yet exist): \_\_\_\_\_

ENTERGY NEW ORLEANS, LLC  
 INTERCONNECTION APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
 LOCATED IN ORLEANS PARISH  
 FORM CSG-2

**Community Solar Generating Facility:**

Facility Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Contact Person: \_\_\_\_\_

Telephone Number: \_\_\_\_\_ Email: \_\_\_\_\_

**Section 2. Generator/Facility Information**

Provide the following	Solar Generator	Inverter
Manufacturer:		
Model Number:		
Number of Units:		
Kilowatt Rating(s) (95° at location)		
Ampere Rating:	N/A	
Short Circuit Current:	N/A	
Tilt Angle (°):		N/A
Azimuth Angle (°):		N/A
Number of phases at Interconnection point:		N/A
Voltage at Interconnection point:		N/A
Proposed output at this site (kW-AC):		N/A

**Does the unit:**

- Disconnect intertie within 10 cycles of a service interruption or fault?  
 Yes \_\_\_\_\_ No \_\_\_\_\_
- Block Generator from energizing dead circuits for five minutes after most recent fault?  
 Yes \_\_\_\_\_ No \_\_\_\_\_

ENTERGY NEW ORLEANS, LLC  
INTERCONNECTION APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
LOCATED IN ORLEANS PARISH  
FORM CSG-2

Codes, Standards, and Rules

The system shall be installed in compliance with the Building/Electrical Code of the City of New Orleans, Orleans Parish and Form CSG-3, Interconnection and Parallel Operation of Community Solar Generating Facility Agreement ("Interconnection Agreement"), executed by and between Subscriber Organization and ENO. This system meets the most current version of the applicable Entergy Standard, Entergy Standard DR07-01 "Distributed Energy Resource Standards for Interconnection. The interconnection protection system is tested and listed for compliance with the latest published edition of Underwriters Laboratories (UL) 1741 including the anti-islanding test. The system will be installed in compliance with IEEE 929 and/or IEEE 1547 as applicable, all manufacturer specifications, the National Electric Code, and all local codes. No protection settings affecting anti-islanding have been or will be adjusted or modified. The system shall be installed in accordance with the attached one-line diagram.

The Community Solar Generating ("CSG") Facility shall meet the requirements of the New Orleans Community Solar Rules ("Rules") promulgated by the Council in Resolution No. R-19-111, in Docket No. UD-18-03.

The parties shall be subject to the provisions of the Rules, the terms and conditions set forth in this Application, the Company's applicable rate tariff schedules, and the executed Interconnection Agreement.

Permits and Authorizations

The Subscriber Organization shall obtain and maintain any governmental authorizations and permits required for the construction and operation of the Facility and interconnection facilities before the facility is interconnected. The Subscriber Organization shall maintain the Facility and interconnection facilities in a safe and reliable manner and in conformance with all applicable laws and regulations.

Interconnection Agreement

Interconnection of the CSG Facility shall be subject to the terms and conditions of the Interconnection Agreement, executed by and between Subscriber Organization and ENO. The CSG Facility shall not commence commercial operation until it has been inspected and approved by the Company and the Form CSG-3 Interconnection Agreement has been executed between the parties.

ENTERGY NEW ORLEANS, LLC  
INTERCONNECTION APPLICATION FOR COMMUNITY SOLAR GENERATING FACILITIES  
LOCATED IN ORLEANS PARISH  
FORM CSG-2

I hereby certify that the information provided on this Interconnection Application is true and correct and that the CSG Facility will comply with the conditions stated above.

Signature of Subscriber Organization: \_\_\_\_\_

Printed Name: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_

Telephone: \_\_\_\_\_ Projected Installation Date: \_\_\_\_\_

**INTERCONNECTION AND PARALLEL OPERATION OF  
COMMUNITY SOLAR GENERATING FACILITY AGREEMENT**

**BY AND BETWEEN**

\_\_\_\_\_

**and**

**ENTERGY NEW ORLEANS, LLC**

**Form CSG-3**

**TABLE OF CONTENTS**

Article I - Definitions..... 4

Article II –Term of Agreement..... 6

Article III – Interconnection Specifications..... 7

    A. Description

    B. Operations Date

Article IV - General Terms and Conditions ..... 7

    A. Electric Services Supplied by the Company..... 7

    B. Construction..... 8

    C. Operation..... 11

    D. Continuity of Service..... 15

    E. Force Majeure..... 16

    F. Indemnity..... 17

    G. Waiver..... 19

    H. Assignment..... 19

    I. Governmental Jurisdiction and Authorization..... 19

    J. Headings Not To Affect Meaning..... 20

    K. Amendments..... 20

    L. Notice..... 20

    M. Breach, Cure, and Default..... 21

    N. Termination of Interconnection Service..... 23

Article V - Insurance..... 24

Article VI - General Provisions..... 25

Appendix A - Interconnection Facilities

Appendix B - Schedule of Rates

Appendix C - Special Facilities

Appendix D - Additional Insured Endorsement

Appendix E – Company’s Notice Of Satisfaction

Appendix F – Customer’s Notice Of Satisfaction

**Appendix G – Third-Party Facility Owner’s Consent**

INTERCONNECTION AND PARALLEL OPERATION OF  
COMMUNITY SOLAR GENERATING FACILITY AGREEMENT

BY AND BETWEEN

\_\_\_\_\_

and

ENERGY NEW ORLEANS, LLC

THIS AGREEMENT is made this \_\_\_\_ day of \_\_\_\_\_, \_\_\_\_ between \_\_\_\_\_, hereinafter called the "Subscriber Organization" or "SO," and Entergy New Orleans, LLC, a ~~\_\_\_\_\_~~ limited liability company organized under the laws of the State of Texas, hereinafter called the "Company." The SO and the Company each may be referred to herein as a "Party," or collectively as "Parties." This Agreement is made subject to the current Entergy Standard DR07-01, Distributed Energy Resource Standards for Interconnection ("Standard"). In the event of a conflict between the terms of this Agreement and the current Standard, the terms of the Standard shall apply.

WITNESSETH:

WHEREAS, The SO requires an interconnection to operate in parallel with the Company's electric distribution system.

NOW, THEREFORE, and in consideration of and subject to the mutual covenants contained herein, it is agreed:

## ARTICLE I - DEFINITIONS

Whenever used in this Agreement, Appendices, and attachments hereto, the following terms shall have the following meanings:

Agreement - This Interconnection and Operating Agreement by and between \_\_\_\_\_ and Entergy \_\_\_\_\_, Inc. New Orleans, LLC, also referred to as "the Contract".

ANSI - American National Standards Institute

Company's System - All the facilities owned or controlled by the Company on the Company's side of the Point of Common Coupling related to the provision of electric service, including, but not limited to, the Company's distribution, transmission and interconnection facilities.

~~SO's Facility - All the physical assets on the SO's side of the interconnection point Point of Common Coupling that relate in any way to the SO generation source. The SO's Facility may sometimes be referred to herein as "Facility."~~

Emergency - Any abnormal condition on the Company's System that requires automatic or immediate manual action to prevent or limit loss of distribution facilities or generation supply which loss could adversely affect the reliability of the Company's System or the systems to which the Company's System is directly or indirectly connected.

Good Utility Practice - Any of the practices, methods and acts engaged in or approved by a significant proportion of the electric utility industry during the relevant time period, or

any of the practices, methods and acts which, in the exercise of reasonable judgment in light of the facts known at the time the decision was made, could have been expected to accomplish the desired result at the lowest reasonable cost consistent with reliability, safety and expedition. Good Utility Practice is not intended to be limited to the optimum practice, method or act to the exclusion of all others, but rather to be a spectrum of acceptable practices, methods or acts.

Interconnection Facilities - All facilities presently in place or presently proposed to be installed, as delineated in Appendix A and Appendix B, or required to be installed in the future in order to interconnect the SO's Facility to the Company's System including, but not limited to, connection, transmission, distribution, engineering, administrative, transformation, switching, metering, protective and safety equipment. Interconnection Facilities shall include any additions and/or reinforcements to the Company's System, that the Company, in a reasonable exercise of its judgment, deems to be necessary.

IEEE - Institute of Electrical and Electronics Engineers.

Interconnection Service - The services provided by the Company to interconnect the SO's Facility with the Company's System pursuant to the terms of this Agreement.

Metering Point - The point, shown in Appendix B, where the Metering Facilities of the Company measure the electric energy delivered either to the Company by the SO or to the SO by the Company.

NEC - National Electric Code

NEMA - National Electric Manufacturer's Association

Operation Date - The day commencing at 00:01 hours, following the day during which Interconnection Facilities and equipment of the SO's Facility have been completed to the Company's and the SO's mutual satisfaction and energized in parallel operation of the Company's and the SO's systems as confirmed in writing or electronically in the form included as Appendixes E and F, respectively, hereto.

Point of Common Coupling - The point, shown in Appendix A, where the conductors of the Company connect to the conductors of the SO.

SO's Facility – All the physical assets on the SO's side of the Point of Common Coupling that relate in any way to the SO generation source. The SO's Facility may sometimes be referred to herein as "Facility."

Special Facilities - Those certain Interconnection Facilities presently in place, presently proposed to be installed or required to be installed in the future, which Facilities were installed or will be installed and will be maintained by the Company, but at the SO's expense, and which Facilities are subject to the provisions of Appendix C of this Agreement.

System Protection Facilities - The equipment required to protect (1) the Company's System and its other customers from faults occurring at the SO's Facility or system, and (2) the SO's Facility from faults occurring on the Company's System or on the system of others to which the Company's System is directly or indirectly connected.

## ARTICLE II - TERM OF AGREEMENT

This Agreement shall be binding upon execution and shall remain in effect for a term of \_\_\_\_\_ years from the Operation Date; provided, that the SO may terminate this Agreement by giving written notice thereof to the Company, not less than 90 days prior to the effective date of such termination. Following conclusion of the primary term, this Agreement shall remain in effect on a year-to-year basis, provided, that either the SO or the Company may terminate this Agreement, for good cause shown, by giving written notice thereof to the other party not less than ninety (90) days prior to the effective date of such termination. The Company may suspend receipt of deliveries, purchases and payment therefor if the SO's failure to comply with this Agreement affects the Company's operation. If, for any reason, delivery and/or payment therefor are suspended, delivery and payment shall promptly resume upon correction or elimination of the condition that gave rise to the suspension.

## ARTICLE III – INTERCONNECTION SPECIFICATIONS

### A. DESCRIPTION

The SO's \_\_\_\_\_ KW Facility located at \_\_\_\_\_, \_\_\_\_\_ shall be the location of the "Point of Common Coupling". Details of this "Point of Common Coupling" and the "SOs Facility" shall be detailed in Appendix A and Appendix B.

### B. OPERATIONS DATE

The scheduled Operation Date of the SO's Facility is \_\_\_\_\_, \_\_\_\_\_.

ARTICLE IV - GENERAL TERMS AND CONDITIONS

A. ELECTRIC SERVICES SUPPLIED BY THE COMPANY

This Agreement does not provide for any electric service by the Company to the SO. If the SO requires electric service from the Company, the SO shall enter into separate contract arrangements with the Company in accordance with the Company's applicable electric tariffs on file with and authorized by the appropriate regulatory authority.

B. CONSTRUCTION

1. Land Rights

The SO agrees to furnish at no cost to the Company all necessary rights of way upon, over, under, and across lands owned or controlled by the SO and/or its affiliated interests for the construction and operation of necessary lines, substations, and other equipment to accomplish interconnection under this Agreement and shall, at all reasonable times, give the Company, or its agents, free access to such lines, substations, and equipment. An accessible, protected and satisfactory site selected upon mutual agreement by the Parties and located on the SO's premises shall be provided by and at the SO's expense for installation of metering devices, unless the Company elects to install meters on poles or other locations controlled by it. The SO grants to the Company at all reasonable times the right of free ingress and egress to the SO's premises for the purpose of installing, testing, reading, inspecting, repairing, operating, altering or removing any of the Company's property located on the SO's premises or for

other purposes necessary to enable the Company to receive or to deliver electric energy or determine the SO's compliance with this Agreement. If any part of the Company's facilities are to be installed on property owned by other than the SO, the SO shall, if the Company is unable to do so without cost to the Company, procure from the owners thereof all necessary permanent rights of way and easements, in a form satisfactory to the Company, for the construction, operation, maintenance and replacement of the Company facilities upon such property. In the event the SO is unable to secure them (a) by condemnation proceedings or (b) by other means, the SO shall reimburse the Company for all costs incurred by the Company in securing such rights.

2. Facility and Equipment Design and Construction

a. The SO shall be obligated to design, construct, install, own, operate and maintain the SO's Facility and all equipment needed to generate power, except for any Special Facilities constructed, installed and maintained by the Company pursuant to Appendix C (Special Facilities), which is attached hereto. The SO's Facility and equipment shall meet all requirements of applicable codes, including, without limitation, those of IEEE, NEMA, ANSI, and NEC, and further, shall meet all requirements of any duly constituted regulatory authority having jurisdiction. The SO shall submit all specifications for the SO's Facility and equipment, including System Protection Facilities, as defined in Article I and more fully described in Article IV, Paragraph C(1) of this Agreement, to the Company for review prior to connecting the said SO's Facility and equipment to

the Company's System. The Company's review of the SO's specifications shall be construed neither as confirming nor as endorsing the design, nor as any warranty as to fitness, safety, durability or reliability of the SO's Facility or any of the equipment. The Company shall not, by reasons of such review or failure to review, be responsible for strength, details of design, adequacy or capacity of the SO's Facility or equipment, nor shall the Company's acceptance be deemed to be an endorsement of any Facility or equipment. The SO agrees to make changes to its Interconnection Facilities as may be reasonably required to meet changing requirements of the Company's System. It is agreed that such necessary changes will be made by each Party to its facilities on its respective side of the Point of Common Coupling, at its own expense. The Company agrees to give the SO advance written notice of the time such changes are to be completed, and a reasonable opportunity for the SO to accomplish these changes. Contemporaneous with such notice, the Company shall supply complete engineering information and specifications for the SO to use in determining what changes will be necessary on the SO's side of the Point of Common Coupling.

b. The SO shall be obligated to construct, install, own and maintain any facilities on the SO's side of the Point of Common Coupling, which may be required to operate in parallel with the Company. The Company's Interconnection Facilities shall be of a size to accommodate the delivery of the kW amount referred to in Article III (A) of this Agreement. In the event it is

necessary for the Company to install any Special Facilities that are essential to accomplish the purposes of this Agreement, the Company may, at its option, require a contribution, facilities charge, or other compensation to make such facilities available to the SO.

3. Metering

The Company shall provide, install, own and maintain metering. All costs associated with metering the energy supplied to the Company by the SO or any subsequent changes requested by the SO to metering shall be borne by the SO.

C. OPERATION

1. Protection and System Quality

a. It shall be the SO's obligation, at its expense, to install or have installed and keep operative System Protective Facilities, including such protective and regulating devices as are identified by order, rule or regulation of any duly constituted regulatory authority having jurisdiction, or as are otherwise necessary to protect personnel and equipment and to minimize deleterious effects to the Company's electric service operation. Any such protective or regulating devices that may be required on the Company's facilities shall be installed by the Company at the SO's expense.

b. Requirements for Protection – The SO shall provide, install, own, and maintain relays, circuit breakers, and all other devices necessary to promptly remove any fault contribution of the SO's generating equipment to any short circuit occurring on the Company's System not otherwise isolated by the

Company's equipment. Such protective equipment shall include, without limitation, a disconnecting device or switch with load interrupting capability to be located between the SO's Facility and the Company's System at an accessible, protected, and satisfactory site selected upon mutual agreement of the Parties. The SO shall be responsible for protection of its Facilities and equipment from such conditions as single-phasing of distribution system, negative sequence currents, over- or under-frequency, sudden load rejection, over- or under-voltage, phase angle jump, and generator loss-of-field. The SO shall be solely responsible for provisions to disconnect its generation when a disturbance on the Company's System results in the SO's Facility becoming isolated from the Company's System.

c. System Quality -

i. The SO's Facility and equipment shall not cause excessive voltage excursions or cause the voltage to drop below or rise above the extents of the range maintained by the Company without the SO's generation. The SO's Facility and equipment shall not cause excessive voltage flicker or introduce excessive distortion to the sinusoidal voltage or current waves.

ii. Excessive voltage excursions, excessive voltage flicker, and excessive distortion to the sinusoidal voltage or current waves shall be determined in accordance with the applicable sections of the Company's most current Energy Standard DR07-01, Distributed Energy Resource Standards for Interconnection. ~~Standard & Engineering Services Guideline, Electric Standard~~

~~No. DR07-01, including Sections 3.1.9.8-9, 11-12~~, which Standard shall be provided to the SO by the Company at the SO's request. Failure by the SO to operate the Facility within the limits set forth in this Agreement and the referenced Standard shall result in immediate disconnection by the Company of the SO's Facility from the Company's System.

iii. The operating frequency of the SO's generating equipment shall not deviate more than +0.5 Hertz ("Hz") or -0.7 Hz from a 60 Hz base. The SO shall automatically disconnect the Facility from the Company's System within 15 cycles if this frequency tolerance cannot be maintained. The SO may reconnect when the Company's System voltage and frequency return to normal range and the system is stabilized.

iv. In accordance with IEEE 519 the total harmonic distortion ("THD") voltage shall not exceed 5.0% of the fundamental 60 Hz frequency or 3.0% of the fundamental frequency for any individual harmonic when measured at the Point of Common Coupling with the Company's System.

d. Inspection – The Company shall have the right, but shall have no obligation or responsibility, to: i) observe the SO's tests and/or inspection of any of the SO's protective equipment; ii) review the settings of the SO's protective equipment; and iii) review the SO's maintenance records relative to the SO's Facility and/or protective equipment. The foregoing rights may be exercised by the Company from time to time as deemed necessary by the Company upon reasonable notice to the SO. However, the exercise or non-exercise by the

Company of any of the foregoing rights of observation, review or inspection shall be construed neither as an endorsement nor confirmation of any aspect, feature, element, or condition of the SO's Facility or protective equipment or the operation thereof, and shall not constitute a warranty as to fitness, safety, desirability, or reliability of same.

2. Meters

- a. The Company shall inspect and test all the Company-owned meters upon their installation and at regular intervals thereafter. If requested to do so by the SO, the Company shall inspect or test a meter more frequently than required by standard utility practice or any applicable regulations, at the expense of the SO. The Company shall give reasonable notice of the time when any inspection or test shall take place, and the SO may have representatives present at the test or inspection.

3. Communications

- a. At the Company's discretion and upon reasonable notice to the SO, a Remote Terminal Unit ("RTU") shall be installed by the SO, or by the Company at the SO's expense, to gather accumulated and instantaneous data to be telemetered to a location designated by the Company. The SO shall put forth best reasonable efforts to install or facilitate installation of such equipment as soon as practicable, provided that installation shall be accomplished within a time period of no more than one hundred and eighty (180) days

following said notice by the Company. The communication protocol for this link will be specified by the Company. Instantaneous analog watt and VAR flow information must be telemetered directly to such location.

4. Disconnection

a. Disconnection in Event of Emergency – The Company and the SO shall have the right to disconnect without notice the Interconnection Facilities if, in the Company's or the SO's sole opinion, an Emergency exists and immediate disconnection is necessary to protect persons, the Company's System or facilities, the SO's facilities, or the facilities of the Company's other customers from damages or interference caused by the SO's interconnection and/or generating equipment, or lack of proper or properly operating protective devices. For purposes of this Article IV, Paragraph C(4), protective devices may be deemed by the Company not to be properly operating if the Company's review under Article IV, Paragraph C(1)(d) ("Inspection") discloses irregular or otherwise insufficient maintenance on such devices or that maintenance records do not exist or are otherwise insufficient to demonstrate that adequate maintenance has been and is being performed.

b. Disconnection after Agreement Terminates - Upon termination of this Agreement by its terms, the Company may disconnect the Facility from the Company's System in accordance with a plan for disconnection upon which the Company and the SO agree.

D. CONTINUITY OF SERVICE

Except in case of Emergency, in order not to interfere unreasonably with the other Party's operations, the curtailing, interrupting or reducing Party shall give the other Party reasonable prior notice of any curtailment, interruption or reduction, the reason for its occurrence and its probable duration. The SO always shall notify the Company promptly of any complete or partial outage of the SO's Facility.

E. FORCE MAJEURE

1. The term "Force Majeure" as used herein shall mean an event, occurrence, or circumstance beyond the reasonable control of, and without the fault or negligence of, the Party claiming Force Majeure, including, but not limited to, acts of God, acts of war or the public enemy, flood, earthquakes, storms, fire, lightning, epidemics, riots, civil disturbances, sabotage, explosion, curtailments, orders, regulations or restrictions imposed by governmental or military, or lawfully established civilian authorities, labor dispute (including strikes by employees of one of the Parties hereto) or any other event or cause which is beyond the claiming Party's reasonable control, and which wholly or in part prevents the claiming party from performing its obligations under this Agreement. Mere economic hardship of a Party shall not constitute "Force Majeure." The Party unable to carry out an obligation, imposed on it by this Agreement, due to "Force Majeure," shall notify the other Party in writing or

electronically or by telephone within a reasonable time after the occurrence of the cause relied on.

2. The Company shall not be responsible for any non-performance under the Agreement or failure to purchase electric energy under the Agreement due to "Force Majeure" whether occurring on the Company's electric system or any connecting electric system affecting the Company's operations. The Company shall be excused from whatever performance is affected only while a "Force Majeure" situation exists and the Company attempts in good faith to alleviate such situation.
3. If the SO, because of "Force Majeure," is rendered wholly or partially unable to perform an obligation imposed on it by this Agreement, except for the obligation to make payments of money, the SO shall be excused from whatever performance is affected, but only while a "Force Majeure" situation exists and the SO attempts in good faith to alleviate such situation.

F. INDEMNITY

1. The SO agrees to fully defend indemnify and hold the Company, its shareholders, directors, officers, agents, representatives, employees, servants, its affiliated and associated companies, their respective shareholders and/or its assigns ("SO Indemnified Parties"), harmless from and against any and all claims, demands, liability, losses, damage, costs or expenses including attorney's fees and other costs of defense (collectively "Claims") arising out of any injury, bodily or otherwise, to or death of persons, or for damage to, or destruction of property

belonging to SO, Company or others (including the SO's Facility and the Company's system) arising out of or otherwise resulting from the use, ownership, maintenance, or operation of the SO's Facility, resulting from the fault, negligence or willful misconduct of Customer in connection with SO's obligations under this Agreement; provided, however, that the provisions of this Paragraph shall not apply if such Claims are held to have been caused by the sole negligence and/or the willful misconduct of SO's Indemnified Parties.

2. The Company agrees to fully defend indemnify and hold the SO, its shareholders, directors, officers, agents, representatives, employees, servants, its affiliated and associated companies, their respective shareholders and/or its assigns ("Company's Indemnified Parties"), harmless from and against any and all claims, demands, liability, losses, damage, costs or expenses including attorney's fees and other costs of defense (collectively "Claims") arising out of any injury, bodily or otherwise, to or death of persons, or for damage to, or destruction of property belonging to Company, SO or others (including the SO's Facility and the Company's system) arising out of or otherwise resulting from the use, ownership, maintenance, or operation of the Company's system, resulting from the fault, negligence or willful misconduct of Company in connection with Company's obligations under this Agreement; provided, however, that the provisions of this Paragraph shall not apply if such Claims ~~and~~ are held to have

been caused by the sole negligence and/or the willful misconduct of Company's Indemnified Parties.

2. Neither Party shall be liable in contract, in tort (including negligence), or otherwise to the other Party for any incidental or consequential loss or damage whatsoever, including, but not limited to, loss of profits or revenue on work not performed, for loss of use of or under-utilization of the other Party's facilities, or loss of use of revenues or loss of anticipated profits, resulting from either Party's performance or non-performance of an obligation imposed on it by this Agreement.

G. WAIVER

Any waiver at any time by either Party of its rights with respect to a default under this Agreement, or with respect to any other matters arising in connection with this Agreement, shall not be deemed a waiver with respect to any subsequent default or other matter.

H. ASSIGNMENT

Neither Party shall voluntarily assign its rights nor delegate its duties under this Agreement, or any part of such rights or duties, without the written consent of the other Party, except in connection with the sale, merger or transfer of a substantial portion of its properties (or in the case of the Company, its distribution facilities) including Interconnection Facilities which it owns provided that the assignee in such a sale, merger or transfer assumes directly all rights,

duties and obligations arising under this Agreement, and such assignor shall be, without further action, released from its obligations hereunder. Any such assignment or delegation made without such written consent shall be null and void. The Company shall be entitled to assign the Agreement to any wholly-owned direct or indirect subsidiary of Entergy Corporation.

I. GOVERNMENTAL JURISDICTION AND AUTHORIZATION

1. This Agreement shall not become effective until all required governmental authorizations and permits are first obtained and copies thereof are submitted to the Company; provided that this Agreement shall not become effective unless it, and all provisions thereof, is authorized and permitted by such governmental agencies without change or condition.
2. This Agreement is subject to present and future valid laws and valid orders, rules and regulations of duly constituted regulatory authorities having jurisdiction. This Agreement shall not become effective until approved by the Council for the City of New Orleans ("Council"), to the extent such approval is required, and/or accepted by any other regulatory bodies having jurisdiction in the premises, if any. Each party expressly reserves, however, the right to appeal and otherwise contest any change ordered by a governmental agency or court having jurisdiction in the rights, terms or conditions specified in this Agreement.

J. HEADINGS NOT TO AFFECT MEANING

The descriptive headings of the various Sections and Articles of this Interconnection Agreement have been inserted for convenience of reference

only and shall in no way modify or restrict any of the terms and provisions hereof.

K. AMENDMENTS

This Agreement may be amended by and only by a written instrument duly executed by each of the parties hereto.

L. NOTICES

Any notice, demand or request required or permitted to be given by either Party to the other and any instrument required or permitted to be tendered or delivered by either Party to the other may be so given, tendered or delivered, as the case may be, by depositing the same in any United States Post Office with postage prepaid, for transmission by certified or registered mail, addressed to the Party, or personally delivered to the Party, at the address set out below:

To the Company:                      Entergy New Orleans, LLC

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

To the SO:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

M. BREACH, CURE AND DEFAULT

1. General. A breach of this Agreement ("Breach") shall occur upon the failure by a Party to perform or observe any material term or condition of

this Agreement. A default of this Agreement ("Default") shall occur upon the failure of a Party in Breach of this Agreement to cure such Breach in accordance with the provisions of Article IV(M)(4) of this Agreement.

2. Events of Breach - A Breach of this Agreement shall include:

- (a) The failure to pay any amount when due;
- (b) The failure to comply with any material term or condition of this Agreement, including but not limited to any material Breach of a representation, warranty or covenant made in this Agreement;
- (c) If a Party: (1) becomes insolvent; (2) files a voluntary petition in bankruptcy under any provision of any federal or state bankruptcy law or shall consent to the filing of any bankruptcy or reorganization petition against it under any similar law; (3) makes a general assignment for the benefit of its creditors; or (4) consents to the appointment of a receiver, trustee or liquidator;
- (d) Assignment of this Agreement in a manner inconsistent with the terms of this Agreement;
- (e) Failure of either Party to provide such access rights, or a Party's attempt to revoke or terminate such access rights, as provided under this Agreement; or
- (f) Failure of either Party to provide information or data to the other Party as required under this Agreement, provided the Party

entitled to the information or data under this Agreement requires such information or data to satisfy its obligations under this Agreement.

- 3 Continued Operation. In the event of a Breach or Default by either Party, the Parties shall continue to operate and maintain, as applicable, such DC power systems, protection and Metering Equipment, telemetering equipment, SCADA equipment, transformers, secondary systems, communications equipment, building facilities, software, documentation, structural components, and other facilities and appurtenances that are reasonably necessary for the Company to operate and maintain the Company's System, or for the SO to operate and maintain the Facility, in a safe and reliable manner.
4. Cure and Default. Upon the occurrence of an event of Breach, the Party not in Breach (hereinafter the "Non-Breaching Party"), when it becomes aware of the Breach, shall give written notice of the Breach to the Breaching Party (the "Breaching Party") and to any other person a Party to this Agreement identifies in writing to the other Party in advance. Such notice shall set forth, in reasonable detail, the nature of the Breach, and where known and applicable, the steps necessary to cure such Breach. Upon receiving written notice of the Breach hereunder, the Breaching Party shall have thirty (30) days to cure such Breach. If the Breach is such that it cannot be cured within thirty (30) days, the

Breaching Party will commence in good faith all steps as are reasonable and appropriate to cure the Breach within such thirty (30) day time period and thereafter diligently pursue such action to completion. In the event the Breaching Party fails to cure the Breach, or to commence reasonable and appropriate steps to cure the Breach, within thirty (30) days of becoming aware of the Breach, the Breaching Party will be in Default of the Agreement.

5. Right to Compel Performance. Notwithstanding the foregoing, upon the occurrence of an event of Default, the non-Defaulting Party shall be entitled to: (1) commence an action to require the Defaulting Party to remedy such Default and specifically perform its duties and obligations hereunder in accordance with the terms and conditions hereof, and (2) exercise such other rights and remedies as it may have in equity or at law.

N. TERMINATION OF INTERCONNECTION SERVICE

1. Expiration of Term. Except as otherwise specified in this Article IV(N), Interconnection Service for the Facility terminates at the conclusion of the Term of this Agreement stated in Article II of this Agreement.
2. Termination. A Party may terminate this Agreement upon the Default of the other Party. Subject to the limitations set forth in Article IV(N)(3 ) below, in the event of a Default, a non-Defaulting Party may terminate

this Agreement only upon its giving of written notice of termination to the other Party.

3. Survival of Rights. Termination of this Agreement shall not relieve either Party of any of its liabilities and obligations arising hereunder prior to the date termination becomes effective, and each Party may take whatever judicial or administrative actions as appear necessary or desirable to enforce its rights hereunder.

#### ARTICLE V - INSURANCE

Without limiting any obligations or liabilities under this Agreement, the SO shall, at its own expense, provide and maintain, in effect for the life of this Agreement, minimum insurance coverage as follows:

- A. Workers' Compensation Insurance in accordance with all applicable State, Federal, and Maritime laws, including Employer's Liability Insurance in the minimum amount of \$1,000,000. Policy shall be endorsed to include a Waiver of Subrogation in favor of the Company and its affiliated and associated companies.
- B. Comprehensive General Liability Insurance, including Contractual Liability Coverage for liabilities assumed under this Agreement and Personal Injury Coverage, with combined single limit of not less than \$5,000,000 each occurrence. The SO shall furnish to the Company an Additional Insured Endorsement with respect to such insurance in substantially the form shown in Appendix D.

The insurance carrier or carriers and form of policies shall be subject to review and approval by the Company, such approval shall not be unreasonably withheld. All of the SO's policies of insurance shall provide the Company with 30 days prior written notice of cancellation, expiration or material adverse change. Prior to the date the SO's facilities are first operated in parallel with the Company's electric system and annually thereafter during the term of this Agreement, the SO shall furnish Certificate of Insurance to the Company.

#### ARTICLE VI - GENERAL PROVISIONS

The Company shall not be liable for any costs or damages due to the inability of the SO or its designated representatives to obtain any licenses or permits required by any authority having jurisdiction over such matters.

This Agreement constitutes the entire agreement between the Parties hereto with reference to the subject matter hereof and no change or modification as to any of the provisions hereof shall be binding on either Party unless reduced to writing and approved by the authorized officer or agent of the SO and the President or a Vice President of the Company. The terms and conditions of this Agreement and every Appendix referred to herein shall be amended, as agreed to by the Parties, to comply with changes or alterations made necessary by a valid applicable order of any governmental regulatory authority, or any court, having jurisdiction hereof.

This Agreement includes the following checked appendices which are attached and incorporated herein:

\_\_\_\_\_ Appendix A - Interconnection Facilities (One Line)

\_\_\_\_\_ Appendix B - Interconnection Application

\_\_\_\_\_ Appendix C - Special Facilities

\_\_\_\_\_ Appendix D - Additional Insured Endorsement

\_\_\_\_\_ Appendix E – Company’s Notice Of Satisfaction

\_\_\_\_\_ Appendix F – SO’s Notice Of Satisfaction

Appendix G – Third-Party Facility Owner’s Consent

(Signature Page to Follow)

IN WITNESS WHEREOF, the Parties hereto have caused this Agreement to be duly executed by their duly authorized officers on the day and year first above written.

WITNESSES:

\_\_\_\_\_

**(Subscriber Organization)**

\_\_\_\_\_

By \_\_\_\_\_

\_\_\_\_\_

Title \_\_\_\_\_

**ENTERGY NEW ORLEANS, LLC**

\_\_\_\_\_

By \_\_\_\_\_

\_\_\_\_\_

Title \_\_\_\_\_

**APPENDIX A - INTERCONNECTION FACILITIES (ONE LINE)**

This Appendix A is a part of the INTERCONNECTION AND OPERATING AGREEMENT by and between the Subscriber Organization and the Company.

See Drawing No. \_\_\_\_\_ dated \_\_\_\_\_, \_\_\_\_\_, which drawing is attached hereto and made a part hereof.

APPENDIX B - INTERCONNECTION APPLICATION

This Appendix B is a part of the INTERCONNECTION AND OPERATING AGREEMENT, Form  
CSG-32, by and between the Subscriber Organization and the Company.

See Interconnection Application No. \_\_\_\_\_ dated \_\_\_\_\_, \_\_\_\_\_, which is attached  
hereto and made a part hereof.

## APPENDIX C - SPECIAL FACILITIES

This Appendix C is a part of the INTERCONNECTION AND OPERATING AGREEMENT, Form CSG-3, by and between the Subscriber Organization and the Company.

#### APPENDIX D - ADDITIONAL INSURED ENDORSEMENT

This Appendix D is a part of the INTERCONNECTION AND OPERATING AGREEMENT, [Form CSG-3](#), by and between the Subscriber Organization ("SO") and the Company.

The SO shall furnish to the Company an Additional Insured Endorsement with respect to such insurance in substantially the following form:

"In consideration of the premium charged, Entergy New Orleans, LLC, and its affiliated and associated companies are named as additional insureds with respect to liabilities arising out of the Subscriber Organization's use and ownership of the Subscriber Organization's Facility and Interconnection Facilities.

"The inclusion of more than one insured under this policy shall not operate to impair the rights of one insured against another insured and the coverages afforded by this policy will apply as though separate policies had been issued to each insured. The inclusion of more than one insured will not, however, operate to increase the limits of the carrier's liability. Entergy New Orleans, LLC, will not, for reason of its inclusion under this policy, incur liability to the insurance carrier for payment of premium for this policy."

APPENDIX E – COMPANY’S NOTICE OF SATISFACTION

TO: [NAME & ADDRESS OF THE SUBSCRIBER ORGANIZATION (“SO”) REPRESENTATIVE AS DESIGNATED IN ARTICLE IV. L.]

RE: [DESCRIPTION OF THE SO’S FACILITIES]

This is to acknowledge that all the SO’s Facilities necessary for the parallel operation of the Company’s and the SO’s systems pursuant to the Interconnection and Parallel Operation of Community Solar Generating Facilities Agreement, dated \_\_\_\_\_, between the Company and the SO, have been completed to the Company’s satisfaction.

\_\_\_\_\_  
Company Representative

DATE: \_\_\_\_\_

APPENDIX F – CUSTOMER'S (SUBSCRIBER ORGANIZATION'S ("SO")) NOTICE OF SATISFACTION

TO: [NAME AND ADDRESS OF THE COMPANY REPRESENTATIVE AS  
DESIGNATED IN ARTICLE IV. L.]

RE: [DESCRIPTION OF THE COMPANY FACILITIES]

This is to acknowledge that all the Company Facilities necessary for the parallel operation of the Company's and the SO's systems pursuant to the Interconnection and Parallel Operation of Community Solar Generating Facilities Agreement, dated \_\_\_\_\_, between the Company and the SO, have been completed to the SO's satisfaction.

\_\_\_\_\_  
SO Representative

DATE: \_\_\_\_\_

APPENDIX G – THIRD PARTY FACILITY OWNER’S CONSENT TO CONTRACT

If the Owner of the Facility and the SO are not the same person or entity, then the undersigned Facility Owner hereby agrees and consents to the terms of this Agreement and hereby authorizes SO to perform any and all acts necessary ~~on its behalf~~ to carry out the duties, responsibilities, and obligations provided for herein ~~on its behalf as SO~~.

\_\_\_\_\_  
Facility Owner Representative

\_\_\_\_\_  
SO Representative

DATE: \_\_\_\_\_

**INTERCONNECTION AND PARALLEL OPERATION OF  
COMMUNITY SOLAR GENERATING FACILITY AGREEMENT**

**BY AND BETWEEN**

---

**and**

**ENTERGY NEW ORLEANS, LLC**

**Form CSG-3**

TABLE OF CONTENTS

Article I - Definitions.....	4
Article II –Term of Agreement.....	6
Article III – Interconnection Specifications.....	7
A. Description	
B. Operations Date	
Article IV - General Terms and Conditions .....	7
A. Electric Services Supplied by the Company.....	7
B. Construction.....	8
C. Operation.....	11
D. Continuity of Service.....	15
E. Force Majeure.....	16
F. Indemnity.....	17
G. Waiver.....	19
H. Assignment.....	19
I. Governmental Jurisdiction and Authorization.....	19
J. Headings Not To Affect Meaning.....	20
K. Amendments.....	20
L. Notice.....	20
M. Breach, Cure, and Default.....	21
N. Termination of Interconnection Service.....	23
Article V - Insurance.....	24
Article VI - General Provisions.....	25
Appendix A - Interconnection Facilities	
Appendix B - Schedule of Rates	
Appendix C - Special Facilities	
Appendix D - Additional Insured Endorsement	
Appendix E – Company’s Notice Of Satisfaction	
Appendix F – Customer’s Notice Of Satisfaction	
Appendix G – Third-Party Facility Owner’s Consent	

INTERCONNECTION AND PARALLEL OPERATION OF  
COMMUNITY SOLAR GENERATING FACILITY AGREEMENT

BY AND BETWEEN

\_\_\_\_\_

and

ENTERGY NEW ORLEANS, LLC

THIS AGREEMENT is made this \_\_\_\_ day of \_\_\_\_\_, \_\_\_\_ between \_\_\_\_\_, hereinafter called the "Subscriber Organization" or "SO," and Entergy New Orleans, LLC, a limited liability company organized under the laws of the State of Texas, hereinafter called the "Company." The SO and the Company each may be referred to herein as a "Party," or collectively as "Parties." This Agreement is made subject to the current Entergy Standard DR07-01, Distributed Energy Resource Standards for Interconnection ("Standard"). In the event of a conflict between the terms of this Agreement and the current Standard, the terms of the Standard shall apply.

WITNESSETH:

WHEREAS, The SO requires an interconnection to operate in parallel with the Company's electric distribution system.

NOW, THEREFORE, and in consideration of and subject to the mutual covenants contained herein, it is agreed:

## ARTICLE I - DEFINITIONS

Whenever used in this Agreement, Appendices, and attachments hereto, the following terms shall have the following meanings:

Agreement - This Interconnection and Operating Agreement by and between \_\_\_\_\_ and Entergy New Orleans, LLC, also referred to as "the Contract".

ANSI - American National Standards Institute

Company's System - All the facilities owned or controlled by the Company on the Company's side of the Point of Common Coupling related to the provision of electric service, including, but not limited to, the Company's distribution, transmission and interconnection facilities.

Emergency - Any abnormal condition on the Company's System that requires automatic or immediate manual action to prevent or limit loss of distribution facilities or generation supply which loss could adversely affect the reliability of the Company's System or the systems to which the Company's System is directly or indirectly connected.

Good Utility Practice - Any of the practices, methods and acts engaged in or approved by a significant proportion of the electric utility industry during the relevant time period, or any of the practices, methods and acts which, in the exercise of reasonable judgment in light of the facts known at the time the decision was made, could have been expected to accomplish the desired result at the lowest reasonable cost consistent with reliability, safety and expedition. Good Utility Practice is not intended to be limited to the

optimum practice, method or act to the exclusion of all others, but rather to be a spectrum of acceptable practices, methods or acts.

Interconnection Facilities - All facilities presently in place or presently proposed to be installed, as delineated in Appendix A and Appendix B, or required to be installed in the future in order to interconnect the SO's Facility to the Company's System including, but not limited to, connection, transmission, distribution, engineering, administrative, transformation, switching, metering, protective and safety equipment. Interconnection Facilities shall include any additions and/or reinforcements to the Company's System, that the Company, in a reasonable exercise of its judgment, deems to be necessary.

IEEE - Institute of Electrical and Electronics Engineers.

Interconnection Service - The services provided by the Company to interconnect the SO's Facility with the Company's System pursuant to the terms of this Agreement.

Metering Point - The point, shown in Appendix B, where the Metering Facilities of the Company measure the electric energy delivered either to the Company by the SO or to the SO by the Company.

NEC - National Electric Code

NEMA - National Electric Manufacturer's Association

Operation Date - The day commencing at 00:01 hours, following the day during which Interconnection Facilities and equipment of the SO's Facility have been completed to the Company's and the SO's mutual satisfaction and energized in parallel operation of the Company's and the SO's systems as confirmed in writing or electronically in the form included as Appendixes E and F, respectively, hereto.

Point of Common Coupling - The point, shown in Appendix A, where the conductors of the Company connect to the conductors of the SO.

SO's Facility – All the physical assets on the SO's side of the Point of Common Coupling that relate in any way to the SO generation source. The SO's Facility may sometimes be referred to herein as "Facility."

Special Facilities - Those certain Interconnection Facilities presently in place, presently proposed to be installed or required to be installed in the future, which Facilities were installed or will be installed and will be maintained by the Company, but at the SO's expense, and which Facilities are subject to the provisions of Appendix C of this Agreement.

System Protection Facilities - The equipment required to protect (1) the Company's System and its other customers from faults occurring at the SO's Facility or system, and (2) the SO's Facility from faults occurring on the Company's System or on the system of others to which the Company's System is directly or indirectly connected.

## ARTICLE II - TERM OF AGREEMENT

This Agreement shall be binding upon execution and shall remain in effect for a term of \_\_\_\_\_ years from the Operation Date; provided, that the SO may terminate this Agreement by giving written notice thereof to the Company, not less than 90 days prior to the effective date of such termination. Following conclusion of the primary term, this Agreement shall remain in effect on a year-to-year basis, provided, that either the SO or

the Company may terminate this Agreement, for good cause shown, by giving written notice thereof to the other party not less than ninety (90) days prior to the effective date of such termination. The Company may suspend receipt of deliveries, purchases and payment therefor if the SO's failure to comply with this Agreement affects the Company's operation. If, for any reason, delivery and/or payment therefor are suspended, delivery and payment shall promptly resume upon correction or elimination of the condition that gave rise to the suspension.

### ARTICLE III – INTERCONNECTION SPECIFICATIONS

A. DESCRIPTION

The SO's \_\_\_\_\_ KW Facility located at \_\_\_\_\_, \_\_\_\_\_ shall be the location of the Point of Common Coupling. Details of this Point of Common Coupling and the SOs Facility shall be detailed in Appendix A and Appendix B.

B. OPERATIONS DATE

The scheduled Operation Date of the SO's Facility is \_\_\_\_\_,\_\_\_\_\_.

### ARTICLE IV - GENERAL TERMS AND CONDITIONS

A. ELECTRIC SERVICES SUPPLIED BY THE COMPANY

This Agreement does not provide for any electric service by the Company to the SO. If the SO requires electric service from the Company, the SO shall enter into separate contract arrangements with the Company in accordance with the

Company's applicable electric tariffs on file with and authorized by the appropriate regulatory authority.

B. CONSTRUCTION

1. Land Rights

The SO agrees to furnish at no cost to the Company all necessary rights of way upon, over, under, and across lands owned or controlled by the SO and/or its affiliated interests for the construction and operation of necessary lines, substations, and other equipment to accomplish interconnection under this Agreement and shall, at all reasonable times, give the Company, or its agents, free access to such lines, substations, and equipment. An accessible, protected and satisfactory site selected upon mutual agreement by the Parties and located on the SO's premises shall be provided by and at the SO's expense for installation of metering devices, unless the Company elects to install meters on poles or other locations controlled by it. The SO grants to the Company at all reasonable times the right of free ingress and egress to the SO's premises for the purpose of installing, testing, reading, inspecting, repairing, operating, altering or removing any of the Company's property located on the SO's premises or for other purposes necessary to enable the Company to receive or to deliver electric energy or determine the SO's compliance with this Agreement. If any part of the Company's facilities are to be installed on property owned by other than the SO, the SO shall, if the Company is unable to do so without cost to the Company, procure from the owners thereof all necessary permanent rights of way and

easements, in a form satisfactory to the Company, for the construction, operation, maintenance and replacement of the Company facilities upon such property. In the event the SO is unable to secure them (a) by condemnation proceedings or (b) by other means, the SO shall reimburse the Company for all costs incurred by the Company in securing such rights.

2. Facility and Equipment Design and Construction

a. The SO shall be obligated to design, construct, install, own, operate and maintain the SO's Facility and all equipment needed to generate power, except for any Special Facilities constructed, installed and maintained by the Company pursuant to Appendix C (Special Facilities), which is attached hereto. The SO's Facility and equipment shall meet all requirements of applicable codes, including, without limitation, those of IEEE, NEMA, ANSI, and NEC, and further, shall meet all requirements of any duly constituted regulatory authority having jurisdiction. The SO shall submit all specifications for the SO's Facility and equipment, including System Protection Facilities, as defined in Article I and more fully described in Article IV, Paragraph C(1) of this Agreement, to the Company for review prior to connecting the said SO's Facility and equipment to the Company's System. The Company's review of the SO's specifications shall be construed neither as confirming nor as endorsing the design, nor as any warranty as to fitness, safety, durability or reliability of the SO's Facility or any of the equipment. The Company shall not, by reasons of such review or failure to review, be responsible for strength, details of design, adequacy or capacity of

the SO's Facility or equipment, nor shall the Company's acceptance be deemed to be an endorsement of any Facility or equipment. The SO agrees to make changes to its Interconnection Facilities as may be reasonably required to meet changing requirements of the Company's System. It is agreed that such necessary changes will be made by each Party to its facilities on its respective side of the Point of Common Coupling, at its own expense. The Company agrees to give the SO advance written notice of the time such changes are to be completed, and a reasonable opportunity for the SO to accomplish these changes. Contemporaneous with such notice, the Company shall supply complete engineering information and specifications for the SO to use in determining what changes will be necessary on the SO's side of the Point of Common Coupling.

b. The SO shall be obligated to construct, install, own and maintain any facilities on the SO's side of the Point of Common Coupling, which may be required to operate in parallel with the Company. The Company's Interconnection Facilities shall be of a size to accommodate the delivery of the kW amount referred to in Article III (A) of this Agreement. In the event it is necessary for the Company to install any Special Facilities that are essential to accomplish the purposes of this Agreement, the Company may, at its option, require a contribution, facilities charge, or other compensation to make such facilities available to the SO.

3. Metering

The Company shall provide, install, own and maintain metering. All costs associated with metering the energy supplied to the Company by the SO or any subsequent changes requested by the SO to metering shall be borne by the SO.

C. OPERATION

1. Protection and System Quality

a. It shall be the SO's obligation, at its expense, to install or have installed and keep operative System Protective Facilities, including such protective and regulating devices as are identified by order, rule or regulation of any duly constituted regulatory authority having jurisdiction, or as are otherwise necessary to protect personnel and equipment and to minimize deleterious effects to the Company's electric service operation. Any such protective or regulating devices that may be required on the Company's facilities shall be installed by the Company at the SO's expense.

b. Requirements for Protection – The SO shall provide, install, own, and maintain relays, circuit breakers, and all other devices necessary to promptly remove any fault contribution of the SO's generating equipment to any short circuit occurring on the Company's System not otherwise isolated by the Company's equipment. Such protective equipment shall include, without limitation, a disconnecting device or switch with load interrupting capability to be located between the SO's Facility and the Company's System at an accessible, protected, and satisfactory site selected upon mutual agreement of the Parties.

The SO shall be responsible for protection of its Facilities and equipment from such conditions as single-phasing of distribution system, negative sequence currents, over- or under-frequency, sudden load rejection, over- or under-voltage, phase angle jump, and generator loss-of-field. The SO shall be solely responsible for provisions to disconnect its generation when a disturbance on the Company's System results in the SO's Facility becoming isolated from the Company's System.

c. System Quality -

i. The SO's Facility and equipment shall not cause excessive voltage excursions or cause the voltage to drop below or rise above the extents of the range maintained by the Company without the SO's generation. The SO's Facility and equipment shall not cause excessive voltage flicker or introduce excessive distortion to the sinusoidal voltage or current waves.

ii. Excessive voltage excursions, excessive voltage flicker, and excessive distortion to the sinusoidal voltage or current waves shall be determined in accordance with the applicable sections of the Company's most current Entergy Standard DR07-01, Distributed Energy Resource Standards for Interconnection., which Standard shall be provided to the SO by the Company at the SO's request. Failure by the SO to operate the Facility within the limits set forth in this Agreement and the referenced Standard shall result in immediate disconnection by the Company of the SO's Facility from the Company's System.

iii. The operating frequency of the SO's generating equipment shall not deviate more than +0.5 Hertz ("Hz") or -0.7 Hz from a 60 Hz base. The SO shall automatically disconnect the Facility from the Company's System within 15 cycles if this frequency tolerance cannot be maintained. The SO may reconnect when the Company's System voltage and frequency return to normal range and the system is stabilized.

iv. In accordance with IEEE 519 the total harmonic distortion ("THD") voltage shall not exceed 5.0% of the fundamental 60 Hz frequency or 3.0% of the fundamental frequency for any individual harmonic when measured at the Point of Common Coupling with the Company's System.

d. Inspection – The Company shall have the right, but shall have no obligation or responsibility, to: i) observe the SO's tests and/or inspection of any of the SO's protective equipment; ii) review the settings of the SO's protective equipment; and iii) review the SO's maintenance records relative to the SO's Facility and/or protective equipment. The foregoing rights may be exercised by the Company from time to time as deemed necessary by the Company upon reasonable notice to the SO. However, the exercise or non-exercise by the Company of any of the foregoing rights of observation, review or inspection shall be construed neither as an endorsement nor confirmation of any aspect, feature, element, or condition of the SO's Facility or protective equipment or the operation thereof, and shall not constitute a warranty as to fitness, safety, desirability, or reliability of same.

2. Meters

- a. The Company shall inspect and test all the Company-owned meters upon their installation and at regular intervals thereafter. If requested to do so by the SO, the Company shall inspect or test a meter more frequently than required by standard utility practice or any applicable regulations, at the expense of the SO. The Company shall give reasonable notice of the time when any inspection or test shall take place, and the SO may have representatives present at the test or inspection.

3. Communications

- a. At the Company's discretion and upon reasonable notice to the SO, a Remote Terminal Unit ("RTU") shall be installed by the SO, or by the Company at the SO's expense, to gather accumulated and instantaneous data to be telemetered to a location designated by the Company. The SO shall put forth best reasonable efforts to install or facilitate installation of such equipment as soon as practicable, provided that installation shall be accomplished within a time period of no more than one hundred and eighty (180) days following said notice by the Company. The communication protocol for this link will be specified by the Company. Instantaneous analog watt and VAR flow information must be telemetered directly to such location.

4. Disconnection

a. Disconnection in Event of Emergency – The Company and the SO shall have the right to disconnect without notice the Interconnection Facilities if, in the Company’s or the SO’s sole opinion, an Emergency exists and immediate disconnection is necessary to protect persons, the Company’s System or facilities, the SO’s facilities, or the facilities of the Company’s other customers from damages or interference caused by the SO’s interconnection and/or generating equipment, or lack of proper or properly operating protective devices. For purposes of this Article IV, Paragraph C(4), protective devices may be deemed by the Company not to be properly operating if the Company’s review under Article IV, Paragraph C(1)(d) (“Inspection”) discloses irregular or otherwise insufficient maintenance on such devices or that maintenance records do not exist or are otherwise insufficient to demonstrate that adequate maintenance has been and is being performed.

b. Disconnection after Agreement Terminates - Upon termination of this Agreement by its terms, the Company may disconnect the Facility from the Company’s System in accordance with a plan for disconnection upon which the Company and the SO agree.

D. CONTINUITY OF SERVICE

Except in case of Emergency, in order not to interfere unreasonably with the other Party’s operations, the curtailing, interrupting or reducing Party shall give the other Party reasonable prior notice of any curtailment, interruption or

reduction, the reason for its occurrence and its probable duration. The SO always shall notify the Company promptly of any complete or partial outage of the SO's Facility.

E. FORCE MAJEURE

1. The term "Force Majeure" as used herein shall mean an event, occurrence, or circumstance beyond the reasonable control of, and without the fault or negligence of, the Party claiming Force Majeure, including, but not limited to, acts of God, acts of war or the public enemy, flood, earthquakes, storms, fire, lightning, epidemics, riots, civil disturbances, sabotage, explosion, curtailments, orders, regulations or restrictions imposed by governmental or military, or lawfully established civilian authorities, labor dispute (including strikes by employees of one of the Parties hereto) or any other event or cause which is beyond the claiming Party's reasonable control, and which wholly or in part prevents the claiming party from performing its obligations under this Agreement. Mere economic hardship of a Party shall not constitute "Force Majeure." The Party unable to carry out an obligation, imposed on it by this Agreement, due to "Force Majeure," shall notify the other Party in writing or electronically or by telephone within a reasonable time after the occurrence of the cause relied on.
2. The Company shall not be responsible for any non-performance under the Agreement or failure to purchase electric energy under the Agreement due to "Force Majeure" whether occurring on the Company's electric system or any

connecting electric system affecting the Company's operations. The Company shall be excused from whatever performance is affected only while a "Force Majeure" situation exists and the Company attempts in good faith to alleviate such situation.

3. If the SO, because of "Force Majeure," is rendered wholly or partially unable to perform an obligation imposed on it by this Agreement, except for the obligation to make payments of money, the SO shall be excused from whatever performance is affected, but only while a "Force Majeure" situation exists and the SO attempts in good faith to alleviate such situation.

F. INDEMNITY

1. The SO agrees to fully defend indemnify and hold the Company, its shareholders, directors, officers, agents, representatives, employees, servants, its affiliated and associated companies, their respective shareholders and/or its assigns ("SO Indemnified Parties"), harmless from and against any and all claims, demands, liability, losses, damage, costs or expenses including attorney's fees and other costs of defense (collectively "Claims") arising out of any injury, bodily or otherwise, to or death of persons, or for damage to, or destruction of property belonging to SO, Company or others (including the SO's Facility and the Company's system) arising out of or otherwise resulting from the use, ownership, maintenance, or operation of the SO's Facility, resulting from the fault, negligence or willful misconduct of Customer in connection with SO's obligations under this Agreement; provided, however, that the provisions of this

Paragraph shall not apply if such Claims are held to have been caused by the sole negligence and/or the willful misconduct of SO's Indemnified Parties.

2. The Company agrees to fully defend indemnify and hold the SO, its shareholders, directors, officers, agents, representatives, employees, servants, its affiliated and associated companies, their respective shareholders and/or its assigns ("Company's Indemnified Parties"), harmless from and against any and all claims, demands, liability, losses, damage, costs or expenses including attorney's fees and other costs of defense (collectively "Claims") arising out of any injury, bodily or otherwise, to or death of persons, or for damage to, or destruction of property belonging to Company, SO or others (including the SO's Facility and the Company's system) arising out of or otherwise resulting from the use, ownership, maintenance, or operation of the Company's system, resulting from the fault, negligence or willful misconduct of Company in connection with Company's obligations under this Agreement; provided, however, that the provisions of this Paragraph shall not apply if such Claims are held to have been caused by the sole negligence and/or the willful misconduct of Company's Indemnified Parties.

2. Neither Party shall be liable in contract, in tort (including negligence), or otherwise to the other Party for any incidental or consequential loss or damage whatsoever, including, but not limited to, loss of profits or revenue on work not

performed, for loss of use of or under-utilization of the other Party's facilities, or loss of use of revenues or loss of anticipated profits, resulting from either Party's performance or non-performance of an obligation imposed on it by this Agreement.

G. WAIVER

Any waiver at any time by either Party of its rights with respect to a default under this Agreement, or with respect to any other matters arising in connection with this Agreement, shall not be deemed a waiver with respect to any subsequent default or other matter.

H. ASSIGNMENT

Neither Party shall voluntarily assign its rights nor delegate its duties under this Agreement, or any part of such rights or duties, without the written consent of the other Party, except in connection with the sale, merger or transfer of a substantial portion of its properties (or in the case of the Company, its distribution facilities) including Interconnection Facilities which it owns provided that the assignee in such a sale, merger or transfer assumes directly all rights, duties and obligations arising under this Agreement, and such assignor shall be, without further action, released from its obligations hereunder. Any such assignment or delegation made without such written consent shall be null and void. The Company shall be entitled to assign the Agreement to any wholly-owned direct or indirect subsidiary of Entergy Corporation.

I. GOVERNMENTAL JURISDICTION AND AUTHORIZATION

1. This Agreement shall not become effective until all required governmental authorizations and permits are first obtained and copies thereof are submitted to the Company; provided that this Agreement shall not become effective unless it, and all provisions thereof, is authorized and permitted by such governmental agencies without change or condition.
2. This Agreement is subject to present and future valid laws and valid orders, rules and regulations of duly constituted regulatory authorities having jurisdiction. This Agreement shall not become effective until approved by the Council for the City of New Orleans ("Council"), to the extent such approval is required, and/or accepted by any other regulatory bodies having jurisdiction in the premises, if any. Each party expressly reserves, however, the right to appeal and otherwise contest any change ordered by a governmental agency or court having jurisdiction in the rights, terms or conditions specified in this Agreement.

J. HEADINGS NOT TO AFFECT MEANING

The descriptive headings of the various Sections and Articles of this Interconnection Agreement have been inserted for convenience of reference only and shall in no way modify or restrict any of the terms and provisions hereof.

K. AMENDMENTS

This Agreement may be amended by and only by a written instrument duly executed by each of the parties hereto.

L. NOTICES

Any notice, demand or request required or permitted to be given by either Party to the other and any instrument required or permitted to be tendered or delivered by either Party to the other may be so given, tendered or delivered, as the case may be, by depositing the same in any United States Post Office with postage prepaid, for transmission by certified or registered mail, addressed to the Party, or personally delivered to the Party, at the address set out below:

To the Company: Entergy New Orleans, LLC

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

To the SO:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

M. BREACH, CURE AND DEFAULT

1. General. A breach of this Agreement ("Breach") shall occur upon the failure by a Party to perform or observe any material term or condition of this Agreement. A default of this Agreement ("Default") shall occur upon the failure of a Party in Breach of this Agreement to cure such Breach in accordance with the provisions of Article IV(M)(4) of this Agreement.

2. Events of Breach - A Breach of this Agreement shall include:
- (a) The failure to pay any amount when due;
  - (b) The failure to comply with any material term or condition of this Agreement, including but not limited to any material Breach of a representation, warranty or covenant made in this Agreement;
  - (c) If a Party: (1) becomes insolvent; (2) files a voluntary petition in bankruptcy under any provision of any federal or state bankruptcy law or shall consent to the filing of any bankruptcy or reorganization petition against it under any similar law; (3) makes a general assignment for the benefit of its creditors; or (4) consents to the appointment of a receiver, trustee or liquidator;
  - (d) Assignment of this Agreement in a manner inconsistent with the terms of this Agreement;
  - (e) Failure of either Party to provide such access rights, or a Party's attempt to revoke or terminate such access rights, as provided under this Agreement; or
  - (f) Failure of either Party to provide information or data to the other Party as required under this Agreement, provided the Party entitled to the information or data under this Agreement requires such information or data to satisfy its obligations under this Agreement.

3. Continued Operation. In the event of a Breach or Default by either Party, the Parties shall continue to operate and maintain, as applicable, such DC power systems, protection and Metering Equipment, telemetering equipment, SCADA equipment, transformers, secondary systems, communications equipment, building facilities, software, documentation, structural components, and other facilities and appurtenances that are reasonably necessary for the Company to operate and maintain the Company's System, or for the SO to operate and maintain the Facility, in a safe and reliable manner.
  
4. Cure and Default. Upon the occurrence of an event of Breach, the Party not in Breach (hereinafter the "Non-Breaching Party"), when it becomes aware of the Breach, shall give written notice of the Breach to the Breaching Party (the "Breaching Party") and to any other person a Party to this Agreement identifies in writing to the other Party in advance. Such notice shall set forth, in reasonable detail, the nature of the Breach, and where known and applicable, the steps necessary to cure such Breach. Upon receiving written notice of the Breach hereunder, the Breaching Party shall have thirty (30) days to cure such Breach. If the Breach is such that it cannot be cured within thirty (30) days, the Breaching Party will commence in good faith all steps as are reasonable and appropriate to cure the Breach within such thirty (30) day time period and thereafter diligently pursue such action to completion. In the

event the Breaching Party fails to cure the Breach, or to commence reasonable and appropriate steps to cure the Breach, within thirty (30) days of becoming aware of the Breach, the Breaching Party will be in Default of the Agreement.

5. Right to Compel Performance. Notwithstanding the foregoing, upon the occurrence of an event of Default, the non-Defaulting Party shall be entitled to: (1) commence an action to require the Defaulting Party to remedy such Default and specifically perform its duties and obligations hereunder in accordance with the terms and conditions hereof, and (2) exercise such other rights and remedies as it may have in equity or at law.

N. TERMINATION OF INTERCONNECTION SERVICE

1. Expiration of Term. Except as otherwise specified in this Article IV(N), Interconnection Service for the Facility terminates at the conclusion of the Term of this Agreement stated in Article II of this Agreement.
2. Termination. A Party may terminate this Agreement upon the Default of the other Party. Subject to the limitations set forth in Article IV(N)(3 ) below, in the event of a Default, a non-Defaulting Party may terminate this Agreement only upon its giving of written notice of termination to the other Party.
3. Survival of Rights. Termination of this Agreement shall not relieve either Party of any of its liabilities and obligations arising hereunder prior to the

date termination becomes effective, and each Party may take whatever judicial or administrative actions as appear necessary or desirable to enforce its rights hereunder.

#### ARTICLE V - INSURANCE

Without limiting any obligations or liabilities under this Agreement, the SO shall, at its own expense, provide and maintain, in effect for the life of this Agreement, minimum insurance coverage as follows:

- A. Workers' Compensation Insurance in accordance with all applicable State, Federal, and Maritime laws, including Employer's Liability Insurance in the minimum amount of \$1,000,000. Policy shall be endorsed to include a Waiver of Subrogation in favor of the Company and its affiliated and associated companies.
- B. Comprehensive General Liability Insurance, including Contractual Liability Coverage for liabilities assumed under this Agreement and Personal Injury Coverage, with combined single limit of not less than \$5,000,000 each occurrence. The SO shall furnish to the Company an Additional Insured Endorsement with respect to such insurance in substantially the form shown in Appendix D.

The insurance carrier or carriers and form of policies shall be subject to review and approval by the Company, such approval shall not be unreasonably withheld. All of the SO's policies of insurance shall provide the Company with 30 days prior written notice of cancellation, expiration or material adverse change.

Prior to the date the SO's facilities are first operated in parallel with the Company's electric system and annually thereafter during the term of this Agreement, the SO shall furnish Certificate of Insurance to the Company.

ARTICLE VI - GENERAL PROVISIONS

The Company shall not be liable for any costs or damages due to the inability of the SO or its designated representatives to obtain any licenses or permits required by any authority having jurisdiction over such matters.

This Agreement constitutes the entire agreement between the Parties hereto with reference to the subject matter hereof and no change or modification as to any of the provisions hereof shall be binding on either Party unless reduced to writing and approved by the authorized officer or agent of the SO and the President or a Vice President of the Company. The terms and conditions of this Agreement and every Appendix referred to herein shall be amended, as agreed to by the Parties, to comply with changes or alterations made necessary by a valid applicable order of any governmental regulatory authority, or any court, having jurisdiction hereof.

This Agreement includes the following checked appendices which are attached and incorporated herein:

- \_\_\_\_\_ Appendix A - Interconnection Facilities (One Line)
- \_\_\_\_\_ Appendix B - Interconnection Application
- \_\_\_\_\_ Appendix C - Special Facilities

- \_\_\_\_\_ Appendix D - Additional Insured Endorsement
- \_\_\_\_\_ Appendix E – Company’s Notice Of Satisfaction
- \_\_\_\_\_ Appendix F – SO’s Notice Of Satisfaction
- \_\_\_\_\_ Appendix G – Third-Party Facility Owner’s Consent

(Signature Page to Follow)

IN WITNESS WHEREOF, the Parties hereto have caused this Agreement to be duly executed by their duly authorized officers on the day and year first above written.

WITNESSES:

\_\_\_\_\_

**(Subscriber Organization)**

\_\_\_\_\_

By \_\_\_\_\_

\_\_\_\_\_

Title \_\_\_\_\_

**ENERGY NEW ORLEANS, LLC**

\_\_\_\_\_

By \_\_\_\_\_

\_\_\_\_\_

Title \_\_\_\_\_

**APPENDIX A - INTERCONNECTION FACILITIES (ONE LINE)**

This Appendix A is a part of the INTERCONNECTION AND OPERATING AGREEMENT by and between the Subscriber Organization and the Company.

See Drawing No. \_\_\_\_\_ dated \_\_\_\_\_, \_\_\_\_\_, which drawing is attached hereto and made a part hereof.

**APPENDIX B - INTERCONNECTION APPLICATION**

This Appendix B is a part of the INTERCONNECTION AND OPERATING AGREEMENT, Form CSG-3, by and between the Subscriber Organization and the Company.

See Interconnection Application No. \_\_\_\_\_ dated \_\_\_\_\_, \_\_\_\_\_, which is attached hereto and made a part hereof.

**APPENDIX C - SPECIAL FACILITIES**

This Appendix C is a part of the INTERCONNECTION AND OPERATING AGREEMENT, Form CSG-3, by and between the Subscriber Organization and the Company.

#### APPENDIX D - ADDITIONAL INSURED ENDORSEMENT

This Appendix D is a part of the INTERCONNECTION AND OPERATING AGREEMENT, Form CSG-3, by and between the Subscriber Organization ("SO") and the Company.

The SO shall furnish to the Company an Additional Insured Endorsement with respect to such insurance in substantially the following form:

"In consideration of the premium charged, Entergy New Orleans, LLC, and its affiliated and associated companies are named as additional insureds with respect to liabilities arising out of the Subscriber Organization's use and ownership of the Subscriber Organization's Facility and Interconnection Facilities.

"The inclusion of more than one insured under this policy shall not operate to impair the rights of one insured against another insured and the coverages afforded by this policy will apply as though separate policies had been issued to each insured. The inclusion of more than one insured will not, however, operate to increase the limits of the carrier's liability. Entergy New Orleans, LLC, will not, for reason of its inclusion under this policy, incur liability to the insurance carrier for payment of premium for this policy."

APPENDIX E – COMPANY’S NOTICE OF SATISFACTION

TO: [NAME & ADDRESS OF THE SUBSCRIBER ORGANIZATION (“SO”)  
REPRESENTATIVE AS DESIGNATED  
IN ARTICLE IV. L.]

RE: [DESCRIPTION OF THE SO’S FACILITIES]

This is to acknowledge that all the SO’s Facilities necessary for the parallel operation of the Company’s and the SO’s systems pursuant to the Interconnection and Parallel Operation of Community Solar Generating Facilities Agreement, dated \_\_\_\_\_, between the Company and the SO, have been completed to the Company’s satisfaction.

\_\_\_\_\_  
Company Representative

DATE: \_\_\_\_\_

**APPENDIX F – CUSTOMER’S (SUBSCRIBER ORGANIZATION’S (“SO”)) NOTICE OF SATISFACTION**

**TO: [NAME AND ADDRESS OF THE COMPANY REPRESENTATIVE AS DESIGNATED IN ARTICLE IV. L.]**

**RE: [DESCRIPTION OF THE COMPANY FACILITIES]**

This is to acknowledge that all the Company Facilities necessary for the parallel operation of the Company’s and the SO’s systems pursuant to the Interconnection and Parallel Operation of Community Solar Generating Facilities Agreement, dated \_\_\_\_\_, between the Company and the SO, have been completed to the SO’s satisfaction.

\_\_\_\_\_  
SO Representative

DATE: \_\_\_\_\_

**APPENDIX G – THIRD PARTY FACILITY OWNER’S CONSENT TO CONTRACT**

If the Owner of the Facility and the SO are not the same person or entity, then the undersigned Facility Owner hereby agrees and consents to the terms of this Agreement and hereby authorizes SO to perform any and all acts necessary to carry out the duties, responsibilities, and obligations provided for herein on its behalf.

\_\_\_\_\_  
Facility Owner Representative

\_\_\_\_\_  
SO Representative

DATE: \_\_\_\_\_

## Standard Offer Community Solar Power Purchase Agreement

### Form CSG-4

This Standard Offer Community Solar Power Purchase Agreement (“Agreement”) is made and entered into this \_\_\_\_ day of \_\_\_\_\_ 20\_\_\_\_, by and between Entergy New Orleans, LLC (“ENO” or “Company”), a Texas limited liability company, whose principal place of business is 1600 Perdido Street, New Orleans, Louisiana 70112 and \_\_\_\_\_ (“Subscriber Organization”) a \_\_\_\_\_ whose principal place of business is \_\_\_\_\_, each of which may be referred to herein individually as a “Party” or collectively as the “Parties.” Subscriber Organization [owns and operates] [operates] the CSG Facility defined below.

#### RECITALS:

This Agreement governs the relationship between ENO and Subscriber Organization, both on behalf of itself and as authorized agent for Subscribers (as defined in Section 1.22 below) and the CSG Facility Owner (as defined in Section 1.6 below), if applicable, with respect to the Output generated by the community solar generating facility (the “CSG Facility”) installed, or to be installed, at the location described in Exhibit A attached hereto, with a generating capacity rating of \_\_\_\_\_ [not to exceed two megawatts as measured by the alternating current rating of the inverter ( $MW_{AC}$ )].

Any references to “Rules” pertain to the New Orleans Community Solar Rules promulgated by the Council for the City of New Orleans (“Council”) in Docket UD-18-03.

In consideration of the premises and mutual covenants herein contained, the Parties hereto agree as follows:

### **ARTICLE I** **DEFINITIONS**

As used herein, the following terms shall have the meanings specified or referred to below which shall apply equally to single and plural forms. Except as otherwise provided for herein, capitalized terms shall have the meanings set forth in the Rules, which specify the facilities, entities, functions and requirements of the New Orleans community solar program (“Community Solar Program”), implemented by the City Council of New Orleans, as of the date of this Agreement.

1.1. “Allocation” shall mean the monthly allocation, stated in kilowatts (“kW”) as a share of the total nameplate capacity of the CSG Facility, applicable to each Subscriber’s Subscription reflecting such Subscriber’s allocable portion of Output produced by the CSG Facility in a particular Production Month. In accordance with Section 4.6 below, the Subscriber Organization is required to timely provide the Allocation to ENO monthly, which ENO will in turn use to calculate the Credit for each billing month.

1.2. "Baseline Annual Usage" shall refer to a Subscriber's accumulated electricity use in kilowatt-hours (kWh) for the previous 12-month period at the time the Subscription is entered into, as measured at ENO's meter, net of any distributed generation provided by the Subscriber to the utility system at that meter. For a Subscriber that does not have a record of 12 months of electricity use at the time of the Subscriber's most recent Subscription, an estimate of the Subscriber's accumulated 12 months of electricity use in kWh, determined in a manner specified in the Community Solar Program Implementation Plan submitted by ENO and approved by the Council in Council Docket UD-18-03 ("Plan").

1.3. "Community Solar Generating Facility" or "CSG Facility" shall mean a solar energy facility that: (i) converts solar energy to electricity; (ii) has a generating capacity/nameplate rating that does not exceed two (2) megawatts (MW); (iii) can provide power to or is connected to ENO's distribution system; (iv) is located in ENO's service territory; (v) is individually metered; (vi) has at least three Subscribers; (vii) sells the Output from the facility to ENO and which the purchase of the Output from the facility shall take the form of a credit against the Subscriber's electric bill; and (viii) the beneficial use and renewable attributes of the Output of the facility belongs to the Subscribers.

1.4. "Council" mean the Council of the City of New Orleans.

1.5. "Credit" shall mean the dollar amount per kilowatt hour ("kWh") paid by ENO to each Subscriber as a credit on the Subscriber's monthly retail electric service bill to compensate the Subscriber for its allocated share of Output produced by the applicable CSG Facility and delivered to ENO, in accordance with ENO's Community Solar Generating Facilities Subscription Service rate schedule ("Schedule CSGF").

1.6. "CSG Facility Owner" shall mean the entity or entities holding legal title or otherwise having full rights of ownership in and to the CSG Facility. If the CSG Facility Owner is the same entity as Subscriber Organization, then Section 3.2 hereof shall not be applicable.

1.7. "Customer" means a retail electric customer account holder of ENO. For purposes of this Agreement, this term shall not be applied to a Subscriber Organization that is issued a retail electric customer account number for a CSG Facility by ENO.

1.8. "Date of Commercial Operation" shall mean the day upon which Commercial Operation is first achieved pursuant to Section 4.3 hereof.

1.9. "Electric Tariffs" shall mean ENO's rates for electric service as in effect and on file with the Council from time to time.

1.10. "Force Majeure" shall have the meaning as set forth in Section 6.1 of this Agreement.

1.11. "House Power" shall mean the supply of retail power for consumption at the Site.

1.12. "Initial Subscriber Report" shall mean the list of potential Subscribers for a CSG Facility provided by the Subscriber Organization to ENO as required by the Plan. The Initial

Subscriber Report shall be in the form required by ENO and shall include for each potential Subscriber the name, identifying information, and the proposed Allocation applicable to the Subscription such that ENO can verify the potential Subscriber's eligibility to participate in the program.

1.13. "Interconnection Agreement" shall mean the separate agreement to be entered into between ~~Developer-Subscriber Organization~~ and ENO providing the terms and conditions by which ~~Developer-Subscriber Organization~~ will interconnect and operate the CSG Facility in parallel with ENO's electric distribution system at the Site.

1.14. "Low-Income Customer" shall mean a Customer whose gross annual household income is at or below fifty percent (50%) of the Area Median Income for the year of subscription or who is certified for any federal, state or local assistance program that limits participation to households whose income is at or below fifty percent (50%) of the Area Median Income.

1.15. "Low-Income Subscriber" means a Subscriber who is a Low-Income Customer.

1.16. "Monthly Subscription Information" shall mean the information submitted to ENO on the Initial Subscription Report as modified by the information provided on the Monthly CSG Facility Subscription Updates required by the Plan and as described in Section 4.6, below.

1.17. "Output" means the energy and power produced by a CSG Facility.

1.18. "Production Month" shall mean the calendar month during which Output is produced by the CSG Facility and delivered to ENO at the Service Connection.

1.19. "Renewable Energy Credit" or "REC" shall mean a contractual right to the full set of non-energy attributes, including any and all credits, benefits, emissions reductions, offsets and allowances, howsoever entitled, directly attributable to a specific amount of electric energy generated from a renewable energy resource.

1.20. "Service Connection" is the location on the CSG Facility's premises/facilities at which a point of delivery of power between ENO and the CSG Facility is established.

1.21. "Site" shall mean the parcel of real property within ENO's territory on which the CSG Facility will be constructed and located, including any easements, rights of way, surface use agreements and other interests or rights in real estate reasonably necessary for the construction, operation and maintenance of the CSG Facility. The Site is more specifically described in Exhibit A to this Agreement.

1.22. "Subscriber" shall mean a Customer of ENO that holds a Subscription to one or more CSG Facilities and has identified one or more individual meters or accounts related to electric service to which the Subscription(s) shall be attributed. A "Subscriber" shall also mean a Low-Income Subscriber.

1.23. "Subscription" shall mean a proportional interest owned or held by a Subscriber in the CSG Facility, which meets all of the requirements set forth in Section 3.3, below.

1.24. "Unsubscribed Energy" refers to any energy Output of a CSG Facility in kWh that is not allocated to a Subscriber as part of a Subscription.

**ARTICLE II**  
**SALE AND DELIVERY OF OUTPUT AND OWNERSHIP OF RENEWABLE**  
**ENERGY CREDITS**

2.1 Sale and Delivery of Subscribed Output. Effective upon the Date of Commercial Operation, Subscriber Organization shall sell and deliver to ENO at the Production Meter all of the Output produced by the CSG Facility and attributable to Subscriptions held by all Subscribers in the CSG Facility. As set forth in the Rules, ENO shall not be obligated to make any payment to Subscriber Organization for the Subscribed Output but instead will render monthly Credits to Subscribers as described below.

2.2 For each Subscriber, ENO shall apply a monthly Credit each billing period to such Subscriber's bill for retail electric service in accordance with ENO's Rate Schedule CSGF based upon the Allocation as set forth in the applicable Monthly Subscription Information. ENO is only obligated to apply monthly bill Credits for Subscribed Output produced and delivered by the CSG Facility to the Production Meter.

2.3 For purposes of applying the monthly Credit to Subscribers' bills, ENO shall be entitled to rely exclusively on the Monthly Subscription Information as updated by Subscriber Organization in accordance with the procedures required by the Plan referenced in Section 4.6, below. The correction of previously-applied monthly Credits among Subscribers due to any inaccuracy reflected in such Monthly Subscription Information with regard to a Subscriber's Subscription in the CSG Facility and the beneficial share of Output produced by the CSG Facility shall be the full responsibility of the Subscriber Organization.

2.4 The ownership and title to all renewable energy attributes or RECs associated with the CSG Facilities shall belong to the individual Subscribers.

2.5 If the Subscriber Organization can demonstrate an increased value provided directly to Subscribers with ownership and title of the RECs by the Subscriber Organization, the Subscriber Organization should provide said support to the Council, which may allow the Subscriber Organization to offer Subscribers the opportunity to redeem the value of such RECs on an individual or consolidated basis.

2.6 Purchase and Sale of Unsubscribed Energy. Effective upon the Date of Commercial Operation, Subscriber Organization agrees to sell, and ENO agrees to purchase, up to twenty percent (20%) of the monthly Unsubscribed Energy produced by the CSG Facility and delivered to ENO at the Production Meter. The rate per kWh that ENO shall pay Subscriber Organization for the up-to-twenty percent (20%) portion of Unsubscribed Energy pursuant to this Section shall be ENO's estimated avoided energy costs for the appropriate time period from ENO's most recent biennial filing with the Clerk of Council of the City of New Orleans pursuant to the Public Utilities Regulatory Policies Act of 1978, Section 201. As provided in the Rules, ENO shall receive all Unsubscribed Energy beyond the up-to-twenty percent (20%) portion without any obligation or

requirement to render payment therefor. The amount of monthly Unsubscribed Energy shall be determined after all Subscribers have been billed and credited based on the monthly Output of each applicable CSG Facility.

2.7 Title, Risk of Loss, and Warranty of Title. As between the Parties, Subscriber Organization shall be deemed to be in control of the energy output from the CSG Facility up to and until delivery and receipt by ENO at the Service Connection and ENO shall be deemed to be in control of such energy from and after delivery and receipt at such Service Connection. Subscriber Organization warrants and represents to ENO that it has or will have at the time of delivery good and sufficient title to all Output and/or the ability to transfer good and sufficient title of same to ENO.

2.8 Exclusive Dealing. Subscriber Organization shall not sell any Output generated from the CSG Facility to any person or entity other than ENO during the Term of this Agreement.

### **ARTICLE III** **REPRESENTATIONS OF THE PARTIES AND CONDITIONS PRECEDENT**

3.1 Subscriber Organization represents and warrants as follows:

- (a) it is registered with the Council and has a valid identification number, which shall be maintained and renewed annually in accordance with the Rules;
- (b) it has and will maintain acceptable proof of Site control such as evidence of property ownership, an executed lease agreement, or a signed option to purchase a lease;
- (c) it has the right and authority to sell the Unsubscribed Energy produced by the CSG Facility to ENO on behalf of the CSG Facility Owner, the Subscribers and itself; and
- (d) it will at all times maintain a valid Interconnection Agreement.

3.2 If the CSG Facility Owner and the Subscriber Organization are not the same person, then the undersigned CSG Facility Owner hereby agrees and consents to the terms of this Agreement and hereby authorizes Subscriber Organization to perform any and all acts necessary on its behalf to carry out the duties, responsibilities and obligations provided for herein as Subscriber Organization, and to sell on the CSG Facility Owner's behalf any and all of CSG Facility Owner's interest in the Output produced by the CSG Facility to ENO in accordance with the terms hereof.

3.3 Requirements and Restrictions Applicable to Subscribers and Subscriptions. The conditions set forth in the following subparagraphs (a) through (d) of this Section 3.3 must be satisfied at all times during the Term of this Agreement, except as specifically provided otherwise below. ENO reserves the right to refuse to accept any additions, deletions or changes to the Monthly Subscription Information to the extent such addition, deletion or change results in non-compliance with any of such conditions. For purposes of this Agreement, the Allocation for any Subscriber or Subscription that no longer satisfies the below conditions for qualification as a valid Subscriber or Subscription shall be treated as an unsubscribed portion, and the Monthly Subscription Information automatically changed accordingly, unless and until such Allocation is changed by Subscriber Organization in a manner that satisfies all such conditions.

(a) A Customer may not hold Subscriptions representing a total amount of energy in the Community Solar Program that exceeds 100 percent (100%) of the value of the Subscriber's Baseline Annual Usage and must comply with the provisions of Section III.A.(3) of the Rules.

(b) No Customer may own more than a forty percent (40%) interest in the beneficial use of the electricity generated by the CSG Facility, including without limitation, the renewable energy and RECs associated with or attributable to the CSG Facility.

(c) Each Subscription shall be sized to represent at least one kW of the CSG Facility's nameplate rating. The minimum one kW sizing requirement herein shall not apply to Subscriptions owned by an eligible Low-Income Subscriber.

(d) CSG Facilities shall be classified into one of two categories: (i) Open Category: CSG Facilities of any size up to two MW as measured by the alternating current rating of the system's inverter; and (ii) Low-Income Category: CSG Facilities of any size up to two MW as measured by the alternating current rating of the system's inverter in which a minimum of 30 percent (30%) of the CSG Facility's Output is provided to Low-Income Subscribers.

3.4 Requirements and Restrictions Applicable to the CSG Facility. The conditions set forth in the following subparagraphs (a) through (d) of this Section 3.4 must be satisfied at all times during the Term of this Agreement. ENO shall have the right hereunder to refuse to purchase any and all Output from the CSG Facility during the period it is not in compliance with any of such conditions if the Subscriber Organization does not remedy the deficiency in a timely manner.

(a) The CSG Facility shall have at least three (3) Subscribers.

(b) The CSG Facility's generating capacity/nameplate rating must not exceed two (2) MW as measured by the alternating current rating of the system's inverter.

(c) The CSG Facility must be located within ENO's service territory, must be individually metered and must connect to ENO's distribution system.

(d) The total number of accounts per CSG Facility may be determined by the Subscriber Organization; however, each Subscription shall be sized to represent at least one kW of the CSG Facility's nameplate rating. The minimum one kW sizing requirement herein shall not apply to Subscriptions owned by an eligible Low-Income Subscriber.

3.5 Responsibility for Verification of Subscriber Eligibility. The Subscriber Organization and ENO shall jointly verify that each Subscriber is eligible to be a Subscriber in the CSG Facility, except for a Subscriber's eligibility to be considered a Low-Income Subscriber, which shall be the sole responsibility of the Subscriber Organization. The Subscriber Organization shall provide an Initial Subscriber Report to ENO within the deadline and in the form required by the Plan. Should ENO determine that any of the customer information provided is either incorrect or incomplete, the Subscriber Organization shall correct the deficiency within the required deadline. The Initial Subscriber Report shall include, at a minimum, each potential Subscriber's name and ENO Account number, the percentage share of the CSG Facility Allocation owned by the Subscriber, the effective date of the ownership of that Subscription, ~~and~~ the premises to which

the Subscription is attributed for the purpose of applying billing credits, and whether the Subscriber meets the criteria to be eligible as a Low-Income Subscriber. Changes in the Subscriber enrollment records shall be communicated by the Subscriber Organization to ENO electronically using the Monthly CSG Facility Subscription Update form required by the Plan, as described in Section 4.6, below. Transfers of Subscriptions shall also be communicated by the Subscriber Organization to ENO using the required Monthly CSG Facility Subscription Update form and will be handled as described in the Plan and Section 4.6, below.

3.6 Compliance with Laws. A Subscriber Organization, and, where relevant, third-party-owner/developer, are responsible for ensuring that its CSG Facility is constructed, maintained, and operated in compliance with all relevant local, state and federal laws, rules, regulations and standards, including but not limited to, reliability, safety, zoning, permitting, occupational safety and health, and environmental laws, rules, regulations and standards, as well as adherence to ENO's interconnection policies and procedures and the Rules.

3.7 False Representation. Any representation or warranty made by Subscriber Organization in this Agreement that shall prove to have been false or misleading in any material respect when made or ceases to remain true during the Term if such cessation would reasonably be expected to result in a material adverse impact on ENO, shall constitute an event of default subject to Section 7.1 hereof.

3.8 ENO Disclaimer. Nothing in this Agreement shall be construed as a representation or warranty by ENO of the design, installation or operation of the CSG Facility or any component thereof, and ENO expressly disclaims all warranties of the equipment as to workmanship, quality, or performance, including the fitness of the equipment for the purpose intended.

#### ARTICLE IV TERM, COMMERCIAL OPERATION AND PERFORMANCE

4.1 Term. This Agreement shall become effective upon its execution by the Parties and shall continue in effect for a Term of 20 years from and after the Date of Commercial Operation, subject to early termination as set forth herein, or until the termination of any Interconnection Agreement associated with the CSG Facility, whichever occurs first. Applicable provisions of this Agreement shall continue in effect after termination, including early termination, to the extent necessary to enforce or complete the duties, obligations or responsibilities of the Parties arising prior to termination and, as applicable, to provide for final billings and adjustments related to the period prior to termination, repayment of any money due and owing to either Party pursuant to this Agreement, and the indemnifications specified in this Agreement.

4.2 Project Development. Prior to the Commercial Operation Date, Subscriber Organization agrees to provide Company with a schedule of the projected completion and in-service dates for the project, and timely inform Company of any changes to the schedule within five (5) business days of the time that the Subscriber Organization becomes aware of such changes. ~~(i) submit semi-annual progress reports to Company including current status of each Construction Milestone (as specified on Exhibit B), any significant developments or delays along with an action plan for making up delays, and Subscriber Organization's best estimate of the Commercial Operation Date; (ii) provide copies of reports submitted to the Facility Lender relating to status, progress and development of the project, (iii) Upon Company request,~~

~~meet with the Company to participate in semi-annual meetings to discuss the progress reports, answer questions, and assess the schedule, and (iv) participate in semi-annual progress review and issue remediation meetings when requested by the Company. Subscriber Organization shall make all relevant contractors available to Company in order to keep the Company fully informed on the status of the development. The semi-annual progress reports are due on every 6-month interval determined from the date the application is created by ENO, ceasing once Commercial Operation has been obtained.~~ Upon request, the Company shall have the right to monitor the ~~construction, start-up, testing~~ and operation of the CSG Facility at the CSG Facility for compliance with this Agreement, *provided, however, that* Company shall comply with all of Subscriber Organization's applicable safety and health rules and requirements. Company's monitoring of the CSG Facility shall not be construed as inspections or endorsing the design thereof nor as any express or implied warranties including performance, safety, durability, or reliability of the CSG Facility.

4.3 Commercial Operation. Commercial Operation is achieved when: (a) 100% of the nameplate capacity of the CSG Facility is installed; (b) the CSG Facility has operated without experiencing any abnormal or unsafe operating conditions, as witnessed by ENO personnel at the Site; (c) all permits necessary to authorize the production and, if applicable, delivery to ENO of Output generated by the CSG Facility have been obtained; (d) the Production Meter has been installed; and (e) the Interconnection Agreement has been entered into between ENO and Subscriber Organization and the CSG Facility has been interconnected with ENO's electric distribution system pursuant to the Interconnection Agreement.

4.4 Deposit. If Commercial Operation is not achieved within 12 months of any approved application, Subscriber Organization shall provide to ENO an additional deposit of \$50 per kW to continue under the Community Solar Program as required under Section VII(D)(11) of the Rules. ENO shall return the CSG Facility deposit upon commencement of Commercial Operation, unless the CSG Facility fails to begin operating within 18 months of an approved application, in which case the deposit shall be forfeited, and this Agreement terminated.

4.5 Maintenance and Repair of CSG Facility. The Subscriber Organization shall maintain the CSG Facility and the individual components thereof in good working order at all times during the Term of this Agreement. If, during the Term of this Agreement the CSG Facility or any of the individual components of the system should be damaged or destroyed, the Subscriber Organization shall provide ENO written notice and promptly repair or replace the equipment to its original specifications, tilt and orientation at the Subscriber Organization's sole expense. All of ENO's obligations hereunder during the period of such repair or replacement shall be suspended, except for making payment for any Output generated and delivered prior to such damage or destruction; provided, however, that if the time period for repair or replacement is reasonably anticipated to exceed one hundred and eighty (180) days, ENO shall have the right, exercisable at its sole option, to terminate this Agreement upon not less than thirty (30) days written notice, with no further obligation of the Parties to perform hereunder following the effective date of such termination. In all other situations, if the CSG Facility is out of operation for more than ninety (90) consecutive days during the Term of this Agreement, ENO shall have the right to terminate this Agreement by providing written notice to Subscriber Organization anytime during the period following the expiration of such ninety (90) days and before the CSG Facility has been made fully operational again. If this Agreement is terminated pursuant to this Section

4.5, then Subscriber Organization shall pay ENO liquidated damages in an amount equal to two times the estimated annual generation of the CSG Facility, as determined via PV WATTS, ~~multiplied by the number of years remaining in the Term as of the effective date of such termination,~~ multiplied by the average annual Locational Marginal Price ("LMP") for the ENO Load Zone for the prior calendar year.

4.6 Updating of Subscription Information. Subscriber Organizations are required to provide real time reporting of production as specified by ENO. For CSG Facilities greater than 250 kW, the Subscriber Organization shall provide real time access to production data. ENO may require different real time reporting for CSG Facilities 250 kW and smaller. As required by the Plan, the Subscriber Organization will provide electronically to ENO a Monthly CSG Facility Subscription Update for each CSG Facility listing Subscribers who have been added or deleted since the prior month along with their applicable Subscription amounts. The monthly update shall follow a standard format specified by ENO in order to integrate data into ENO's billing system. The monthly update shall also include the amount of the CSG Facility's capacity that remains unsubscribed. The update must be provided within the deadline imposed by the Council-approved Plan for updates to take effect for the first billing cycle of the next month. If the Subscriber Organization provides the update after the specified deadline, updates would take effect on the first billing cycle of the month following the next month.

4.7 Certification of Low-Income Qualification. The Subscriber Organization shall certify to ENO in writing that the Subscriber Organization has verified the eligibility of all Low-Income Subscribers needed to qualify for the program prior to receiving permission to operate from ENO. By May 1 of each year, the Subscriber Organization shall re-certify in writing to the Company the Low-Income Subscriber status of all Subscribers to its CSG Facilities that are designated as such.

4.8 Audits. ENO reserves the right, upon thirty (30) days written notice, to audit Subscriber Organization's Subscriber and Subscription records and to inspect the CSG Facility at any time during the Term of this Agreement, and for an additional period of one year thereafter.

## ARTICLE V PRODUCTION METER AND INTERCONNECTION

5.1 Production Meter. Upon the initial satisfaction of all of the conditions set forth in Sections 3.3 and 3.4 above, and any applicable requirements of the Distribution Interconnection Standards, ENO shall install, and thereafter own, operate, maintain and read the Production Meter, which shall be sufficiently sized to measure all Output generated by the CSG Facility, and Subscriber Organization shall reimburse ENO for the cost of installing the Production Meter. Such reimbursement shall be due within thirty (30) days from the date a bill is presented to Subscriber Organization by ENO after the Production Meter is installed. If Subscriber Organization does not make payment in full within that time, the unpaid balance shall bear interest at the rate of one and one half percent (1.5%) per month. ENO reserves the right to replace the Production Meter, at its sole cost, at any time and for any reason.

5.2 Telecommunications Equipment. Subscriber Organization shall cause to be provided, and shall own, operate and maintain at the Subscriber Organization's sole cost any

necessary electronic communications equipment or devices that are required to provide real-time access to 15-minute interval data regarding the Output produced by the CSG Facility. Unless otherwise notified in writing by ENO that an alternative telecommunication device is acceptable, such equipment shall include an active, wired telephone or data line capable of transmitting the monthly 15-minute interval data to ENO. ENO reserves the right to replace the telecommunication equipment at its sole cost.

5.3 Failure to Maintain Telecommunication Line. If the telecommunication line required to be maintained by Subscriber Organization pursuant to Section 5.2 is inactive or non-operational during any Production Month when ENO attempts to access measurement data from the telemetry equipment on the Production Meter, Subscriber Organization shall be assessed a Trip Charge applicable to non-gratuitous labor service at the currently-effective rate set forth in the Schedule of Charges for Rendering Service section of ENO's electric tariff. If the telecommunication line is inactive or non-operational for three consecutive Production Months, then, in addition to the applicable Trip Charges, all energy produced and delivered from the CSG Facility shall be treated and priced as unsubscribed energy hereunder effective as of the first calendar day of such third Production Month and continuing until the subsequent Production Month during which the telecommunication line is made operational and active. Subscriber Organization's payment of Trip Charges hereunder shall be due within thirty (30) days from the date a bill is presented to Subscriber Organization by ENO. If Subscriber Organization does not make payment in full within that time, the unpaid balance shall bear interest at the rate of one and one half percent (1.5%) per month to be invoiced monthly.

5.4 House Power. This Agreement does not provide for House Power. Subscriber Organization shall be solely responsible for arranging retail electric service exclusively from ENO in accordance with ENO's Electric Tariffs. Subscriber Organization shall obtain House Power solely through separately metered retail service and shall not obtain House Power through any other means, and waives any regulatory or other legal right to the contrary, except the right to self-generate as provided in this Section 5.4. Subscriber Organization's right to self-generate hereunder shall be limited to the electrical energy consumed at the Site that is directly related to the CSG Facility's generation, including system operation, performance monitoring and associated communications, and shall not include energy necessary for domestic or other purposes, such as for perimeter lighting, a visitor's center or any other structures or facilities at the Site. The Parties acknowledge and agree that the performance of their respective obligations with respect to House Power shall be a separate from this Agreement and shall be interpreted independently of the Parties' respective obligations under this Agreement. Notwithstanding any other provision in this Agreement, nothing with respect to the arrangements for House Power shall alter or modify Subscriber Organization's or ENO's rights, duties, and obligations under this Agreement. This Agreement shall not be construed to create any rights between Subscriber Organization and ENO with respect to the arrangements for House Power.

5.5 Interconnection Agreement. The Parties recognize that Subscriber Organization and ENO will enter into a separate Interconnection Agreement consistent with the provisions of Entergy's Distribution Design Basis/Standards DR7-01 or DR7-02. The Parties acknowledge and agree that the performance of their respective obligations with respect to the interconnection of the CSG Facility pursuant to the Interconnection Agreement shall be subject to the prior satisfaction of all of the conditions set forth in Sections 3.3 and 3.4 above, but that in all other respects the

Interconnection Agreement shall be a separate and free-standing contract and shall be interpreted independently of the Parties' respective obligations under this Agreement. Notwithstanding any other provision in this Agreement, nothing in the Interconnection Agreement shall alter or modify Subscriber Organization's or ENO's rights, duties and obligations under this Agreement. This Agreement shall not be construed to create any rights between Subscriber Organization and ENO with respect to the Interconnection Agreement.

## ARTICLE VI FORCE MAJEURE

6.1 Definition of Force Majeure. (a) The term "Force Majeure," as used in this Agreement, means causes or events beyond the reasonable control of, and without the fault or negligence of the Party claiming Force Majeure, including, without limitation, acts of God, sudden actions of the elements such as floods, earthquakes, hurricanes, or tornadoes; high winds of sufficient strength or duration to materially damage a CSG Facility or significantly impair its operation such that it is no longer capable of generating Output; long-term material changes in Output flows across the CSG Facility caused by climatic change, lightning, fire, ice storms, sabotage, vandalism caused by others despite reasonable efforts of Subscriber Organization to secure and protect the CSG Facility, terrorism, war, riots, fire; explosion, insurrection, strike, slow down or labor disruptions (even if such difficulties could be resolved by conceding to the demands of a labor group), and actions or inactions by any governmental authority taken after the date hereof (including the adoption or change in any rule or regulation or environmental constraints lawfully imposed by such governmental authority), but only if such requirements, actions, or failures to act prevent or delay performance, and inability, despite due diligence, to obtain any licenses, permits, or approvals required by any governmental authority having jurisdiction.

(b) The term Force Majeure does not include (i) any acts or omissions of a n y third party, including, without limitation, any vendor, materialman, customer, or supplier of Subscriber Organization, unless such acts or omissions are themselves excused by reason of Force Majeure; (ii) any full or partial curtailment in the electric output of the CSG Facility that is caused by or arises from a mechanical or equipment breakdown or other mishap or events or conditions attributable to normal wear and tear or flaws, unless such mishap is caused by one of the following: catastrophic equipment failure; acts of God; sudden actions of the elements, including, but not limited to: floods; hurricanes, tornadoes; sabotage; terrorism; war; riots; and emergency orders issued by a governmental authority or (iii) changes in market conditions that affect the cost of ENO's or Subscriber Organization's supplies, or that affect demand or price for any of ENO's or Subscriber Organization's products.

6.2 Applicability of Force Majeure. (a) Neither Party shall be responsible or liable for any delay or failure in its performance under this Agreement, nor shall any delay, failure, or other occurrence or event become an event of default, to the extent such delay, failure, occurrence or event is substantially caused by conditions or events of Force Majeure, provided that:

- i. the non-performing Party gives the other Party prompt written notice describing the particulars of the occurrence of the Force Majeure;
- ii. the suspension of performance is of no greater scope and of no longer duration than is required by the Force Majeure;

- iii. the non-performing Party proceeds with reasonable diligence to remedy its inability to perform and provides weekly progress reports to the other Party describing actions taken to end the Force Majeure; and
- iv. when the non-performing Party is able to resume performance of its obligations under this Agreement, that Party shall give the other Party written notice to that effect.

(b) Except as otherwise expressly provided for in this Agreement, the existence of a condition or event of Force Majeure shall not relieve the Parties of their obligations under this Agreement (including, but not limited to, payment obligations) to the extent that performance of such obligations is not precluded by the condition or event of Force Majeure. Notwithstanding this provision, ENO shall have no obligation to make any payment for Output under this Agreement except for actual production as measured by the metering provisions of this Agreement.

6.3 Limitations on Effect of Force Majeure. In no event will any delay or failure of performance caused by any conditions or events of Force Majeure extend this Agreement beyond its stated Term. In the event that any delay or failure of performance caused by conditions or events of Force Majeure continues for an uninterrupted period of three hundred sixty-five (365) days from its occurrence or inception, as noticed pursuant to Section 6.2(a)(i) above, the Party not claiming Force Majeure may, at any time following the end of such three hundred sixty-five (365) day period terminate this Agreement upon written notice to the affected Party, without further obligation by either Party except as to costs and balances incurred prior to the effective date of such termination. The Party not claiming Force Majeure may, but shall not be obligated to, extend such three hundred sixty-five (365) day period, for such additional time as it, at its sole discretion, deems appropriate, if the affected Party is exercising due diligence in its efforts to cure the conditions or events of Force Majeure.

## **ARTICLE VII**

### **DEFAULT, REMEDIES AND DISPUTE RESOLUTION**

7.1 Events of default. Any of the following events shall constitute an event of default if such event has not been cured as provided for below:

(A) Third-party owner/developer, Subscriber Organization and their affiliated and parent companies' failure at any time during the Term of this Agreement to meet the requirements under ~~Section 5.1 (Construction Timeline)~~ or Section 3.1(d) (Interconnection Agreement). In such event Company may, and in its sole discretion, terminate this Agreement. Upon such termination Company shall have no further financial or other obligation to the Subscriber Organization as a result of such termination. The provisions of paragraph 7.3 shall not apply to an event of default under this paragraph.

(B) The failure by either Party to perform or observe any other material term or provision of this Agreement, that is not excused by Force Majeure, and such failure remains unremedied for 30 days after notice thereof shall have been given by the non-defaulting Party.

7.2 Prior to commencing any action to enforce this Agreement, the non-defaulting Party shall provide written notice of default to the Party asserted to be in default and the Party asserted to be in default shall have a period of thirty (30) days following receipt of such written

notice within which to cure the asserted default (or if the asserted default is of a nature which cannot reasonably be cured within such 30-day period, to commence and thereafter diligently pursue a cure thereof.)

7.3 Failure of either Party to assert a default or to enforce any term or condition of this Agreement shall not constitute a waiver of any other similar or other default, or waiver of such term or condition or of any other term or condition of this Agreement. Each Party hereby irrevocably and unconditionally waives any right to a trial by jury for the resolution of any dispute arising under this Agreement.

7.4 If any disputes arise concerning this Agreement, including but not limited to enforcement of any term or condition of the Agreement, the prevailing Party in any action brought for the purpose of enforcing such provisions shall be entitled to recover its reasonable attorney fees, expenses and costs of such action from the non-prevailing Party.

## **ARTICLE VIII** **LIABILITY AND INDEMNIFICATION**

8.1 Limitation of Liability. ENO shall not be responsible or liable for any personal injury or property damage caused by the CSG Facility or any individual component equipment of the system. ENO shall not be liable to the Subscriber Organization for any punitive, special, exemplary or consequential damages, including but not limited to, lost profits, loss of use, and costs of replacement, whether based in contract, tort, upon any theory of indemnity, or otherwise. ENO makes no warranty or representation concerning the taxable consequences, if any, to Subscriber Organization with respect to the production and sale of Output, and Subscriber Organization is urged to seek professional advice regarding this issue.

8.2 Indemnification by Subscriber Organization. Subscriber Organization shall indemnify, defend, and hold ENO, its employees, agents, successors, assigns, subsidiaries and affiliates harmless against any and all claims, demands, liens, lawsuits, judgments or actions of whatsoever nature that may be brought on account of the installation, maintenance, operation, repair, or replacement of the CSG Facility or any component equipment of the system, or Subscriber Organization's administration of Subscriptions or the performance of its responsibilities as a subscriber organization.

## **ARTICLE IX** **LAWS AND REGULATORY BODIES**

9.1 Agreement Subject to Laws and Regulations. This Agreement and the rights and obligations of the Parties hereunder shall be subject to all valid applicable state, local and federal laws, rules, regulations, ordinances, orders and decisions issued or promulgated for or by any court or regulatory agency having or asserting jurisdiction over this Agreement, the services to be performed hereunder, or either of the Parties hereto.

9.2 Rights Upon Regulatory Agency or Court Action. Except as may be otherwise provided herein, in the event that any court or regulatory agency having or asserting jurisdiction over these premises takes any action or issues any determination that directly or indirectly prohibits

performance to a material extent under this Agreement by either or both parties or otherwise makes such performance illegal or impossible, such action or determination will be considered to be an event of Force Majeure. In the event that any such court or regulatory agency takes any action or issues any determination that directly or indirectly effects a material adverse change to any substantive provision of this Agreement, in the terms of performance or with respect to the rights or obligations of either party hereto (in that party's reasonable good faith opinion), then the party materially adversely affected may: (i) continue to perform its obligations under the Agreement as changed, (ii) seek to renegotiate the terms of this Agreement by providing written notice to the other party of its desire to renegotiate, or (iii) at any time during a period of ninety (90) days next following receipt by the other party of written notice of any such action by any such court or regulatory agency, terminate this Agreement by providing written notice to the other party hereto on or before the end of such ninety (90) day period, such termination to be effective on the first day of the month next following ninety (90) days after the receipt of such notice of termination; provided however that, if such action or determination is rescinded prior to the effectiveness of such notice, such notice will be deemed invalid. In the event the Agreement terminates under this provision, all further rights and obligations of ENO and Subscriber Organization under this Agreement will be null and void. Each party hereto shall provide reasonable and prompt notice to the other party hereto as to any regulatory proceedings or actions described herein that could affect the rights and obligations of the Parties hereto.

9.3 Performance Pending Renegotiation or Termination. Irrespective of any action by any court or regulatory agency as contemplated by Sections 9.1 or 9.2, above, each of the Parties hereto shall continue to honor and perform all of their respective warranties, representations and obligations under this Agreement including, but not limited to, the obligations of Subscriber Organization to sell and deliver the Output of the CSG Facility to ENO and the obligations of ENO to accept and pay Subscriber Organization as provided herein, until the Parties either mutually renegotiate the terms of this Agreement or until this Agreement terminates pursuant to the provisions of Section 9.2 above.

9.4 Governing Law. This Agreement shall be governed by and interpreted in accordance with the laws of the State of Louisiana.

## **ARTICLE X**

### **MISCELLANEOUS PROVISIONS**

10.1 Counterparts. This Agreement may be executed in two or more counterparts, each of which shall be deemed an original, but all constitute one and the same instrument. The Parties agree that a facsimile copy of a counterpart signed by the other Party will be deemed original and binding.

10.2 Assignment, Successors and Assigns. This Agreement shall be binding upon and inure to the benefit of the successors and assigns of the respective Parties hereto and shall not be assigned by either Party without the written consent of the non-assigning Party, which consent shall not be unreasonably withheld. In no event shall any assignment by Subscriber Organization become effective before a new Subscriber Agency Agreement has been entered into between Subscriber Organization's assignee and each and every Subscriber.

10.3 Relationship of the Parties. Nothing herein is intended nor shall ever be construed to create a joint venture, partnership or any other type of association between the Parties, nor shall either Party have the right to act in behalf of or bind the other for any liability, cost, expense or undertaking except as set forth in this Agreement.

10.4 Amendments or Modifications. No amendment, modification, or change of this Agreement shall be binding upon the Parties unless such amendment, modification, or change is in writing and executed by the Parties.

10.5 Construction. No understandings or agreements not expressly stated herein shall be binding on the Parties in the construction or fulfillment hereof unless such understandings or agreements are reduced to writing and signed by the respective parties. The rule of construction that ambiguous provisions shall be interpreted against the drafter shall not apply to this Agreement.

10.6 No Third-Party Beneficiaries. Except as otherwise specifically provided herein, this Agreement is not intended to, and shall not, create rights, remedies, or any benefits of any character whatsoever, in favor of any person, corporation or other entity other than the Parties hereto, and the obligations herein assumed are for the use and benefit of the Parties, their successors in interest, and permitted assigns.

10.7 Remedies Cumulative. Except as otherwise specifically provided herein, each remedy provided for under this Agreement shall be taken and construed as cumulative and in addition to every other remedy provided for herein or available at law or in equity.

10.8 Notices. All notices, reports or other communications provided for in this Agreement shall be in writing and shall be deemed to have been sent when delivered by hand, sent by facsimile with verification, or when deposited in the United States mail, postage prepaid and properly addressed or when sent via overnight courier:

If to ENO:

\_\_\_\_\_

If to Subscriber Organization:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

or at such other address as either party may hereafter designate to the other in writing.

[INTENTIONALLY LEFT BLANK]

IN WITNESS WHEREOF, the undersigned Parties have executed this Agreement as of the date and year first above written.

**SUBSCRIBER ORGANIZATION**

Name (printed): \_\_\_\_\_

Title: \_\_\_\_\_

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**ENTERGY NEW ORLEANS, LLC**

Name (printed): \_\_\_\_\_

Title: \_\_\_\_\_

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**CSG FACILITY OWNER (if different from Subscriber Organization)**

Name (printed): \_\_\_\_\_

Title: \_\_\_\_\_

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

No. \_\_\_\_\_

## **Exhibit A**

*DESCRIPTION OF CSG Facility SITE:*



**Exhibit B**  
**to Construction Milestones**

<b>DATE</b>		<b>RESULTS ACHIEVED</b>
	<b>1</b>	
	<b>2</b>	
	<b>3</b>	
	<b>4</b>	
	<b>5</b>	
	<b>6</b>	
	<b>7</b>	
	<b>8</b>	
	<b>9</b>	
	<b>10</b>	
	<b>11</b>	
	<b>12</b>	
	<b>13</b>	
	<b>14</b>	
	<b>15</b>	
	<b>16</b>	

## Standard Offer Community Solar Power Purchase Agreement

### Form CSG-4

This Standard Offer Community Solar Power Purchase Agreement (“Agreement”) is made and entered into this \_\_\_\_ day of \_\_\_\_\_ 20\_\_\_\_, by and between Entergy New Orleans, LLC (“ENO” or “Company”), a Texas limited liability company, whose principal place of business is 1600 Perdido Street, New Orleans, Louisiana 70112 and \_\_\_\_\_ (“Subscriber Organization”) a \_\_\_\_\_ whose principal place of business is \_\_\_\_\_, each of which may be referred to herein individually as a “Party” or collectively as the “Parties.” Subscriber Organization [owns and operates] [operates] the CSG Facility defined below.

#### RECITALS:

This Agreement governs the relationship between ENO and Subscriber Organization, both on behalf of itself and as authorized agent for Subscribers (as defined in Section 1.22 below) and the CSG Facility Owner (as defined in Section 1.6 below), if applicable, with respect to the Output generated by the community solar generating facility (the “CSG Facility”) installed, or to be installed, at the location described in Exhibit A attached hereto, with a generating capacity rating of \_\_\_\_ [not to exceed two megawatts as measured by the alternating current rating of the inverter ( $MW_{AC}$ )].

Any references to “Rules” pertain to the New Orleans Community Solar Rules promulgated by the Council for the City of New Orleans (“Council”) in Docket UD-18-03.

In consideration of the premises and mutual covenants herein contained, the Parties hereto agree as follows:

### **ARTICLE I** **DEFINITIONS**

As used herein, the following terms shall have the meanings specified or referred to below which shall apply equally to single and plural forms. Except as otherwise provided for herein, capitalized terms shall have the meanings set forth in the Rules, which specify the facilities, entities, functions and requirements of the New Orleans community solar program (“Community Solar Program”), implemented by the City Council of New Orleans, as of the date of this Agreement.

1.1. “Allocation” shall mean the monthly allocation, stated in kilowatts (“kW”) as a share of the total nameplate capacity of the CSG Facility, applicable to each Subscriber’s Subscription reflecting such Subscriber’s allocable portion of Output produced by the CSG Facility in a particular Production Month. In accordance with Section 4.6 below, the Subscriber Organization is required to timely provide the Allocation to ENO monthly, which ENO will in turn use to calculate the Credit for each billing month.

1.2. "Baseline Annual Usage" shall refer to a Subscriber's accumulated electricity use in kilowatt-hours (kWh) for the previous 12-month period at the time the Subscription is entered into, as measured at ENO's meter, net of any distributed generation provided by the Subscriber to the utility system at that meter. For a Subscriber that does not have a record of 12 months of electricity use at the time of the Subscriber's most recent Subscription, an estimate of the Subscriber's accumulated 12 months of electricity use in kWh, determined in a manner specified in the Community Solar Program Implementation Plan submitted by ENO and approved by the Council in Council Docket UD-18-03 ("Plan").

1.3. "Community Solar Generating Facility" or "CSG Facility" shall mean a solar energy facility that: (i) converts solar energy to electricity; (ii) has a generating capacity/nameplate rating that does not exceed two (2) megawatts (MW); (iii) can provide power to or is connected to ENO's distribution system; (iv) is located in ENO's service territory; (v) is individually metered; (vi) has at least three Subscribers; (vii) sells the Output from the facility to ENO and which the purchase of the Output from the facility shall take the form of a credit against the Subscriber's electric bill; and (viii) the beneficial use and renewable attributes of the Output of the facility belongs to the Subscribers.

1.4. "Council" mean the Council of the City of New Orleans.

1.5. "Credit" shall mean the dollar amount per kilowatt hour ("kWh") paid by ENO to each Subscriber as a credit on the Subscriber's monthly retail electric service bill to compensate the Subscriber for its allocated share of Output produced by the applicable CSG Facility and delivered to ENO, in accordance with ENO's Community Solar Generating Facilities Subscription Service rate schedule ("Schedule CSGF").

1.6. "CSG Facility Owner" shall mean the entity or entities holding legal title or otherwise having full rights of ownership in and to the CSG Facility. If the CSG Facility Owner is the same entity as Subscriber Organization, then Section 3.2 hereof shall not be applicable.

1.7. "Customer" means a retail electric customer account holder of ENO. For purposes of this Agreement, this term shall not be applied to a Subscriber Organization that is issued a retail electric customer account number for a CSG Facility by ENO.

1.8. "Date of Commercial Operation" shall mean the day upon which Commercial Operation is first achieved pursuant to Section 4.3 hereof.

1.9. "Electric Tariffs" shall mean ENO's rates for electric service as in effect and on file with the Council from time to time.

1.10. "Force Majeure" shall have the meaning as set forth in Section 6.1 of this Agreement.

1.11. "House Power" shall mean the supply of retail power for consumption at the Site.

1.12. "Initial Subscriber Report" shall mean the list of potential Subscribers for a CSG Facility provided by the Subscriber Organization to ENO as required by the Plan. The Initial

Subscriber Report shall be in the form required by ENO and shall include for each potential Subscriber the name, identifying information, and the proposed Allocation applicable to the Subscription such that ENO can verify the potential Subscriber's eligibility to participate in the program.

1.13. "Interconnection Agreement" shall mean the separate agreement to be entered into between Subscriber Organization and ENO providing the terms and conditions by which Subscriber Organization will interconnect and operate the CSG Facility in parallel with ENO's electric distribution system at the Site.

1.14. "Low-Income Customer" shall mean a Customer whose gross annual household income is at or below fifty percent (50%) of the Area Median Income for the year of subscription or who is certified for any federal, state or local assistance program that limits participation to households whose income is at or below fifty percent (50%) of the Area Median Income.

1.15. "Low-Income Subscriber" means a Subscriber who is a Low-Income Customer.

1.16. "Monthly Subscription Information" shall mean the information submitted to ENO on the Initial Subscription Report as modified by the information provided on the Monthly CSG Facility Subscription Updates required by the Plan and as described in Section 4.6, below.

1.17. "Output" means the energy and power produced by a CSG Facility.

1.18. "Production Month" shall mean the calendar month during which Output is produced by the CSG Facility and delivered to ENO at the Service Connection.

1.19. "Renewable Energy Credit" or "REC" shall mean a contractual right to the full set of non-energy attributes, including any and all credits, benefits, emissions reductions, offsets and allowances, howsoever entitled, directly attributable to a specific amount of electric energy generated from a renewable energy resource.

1.20. "Service Connection" is the location on the CSG Facility's premises/facilities at which a point of delivery of power between ENO and the CSG Facility is established.

1.21. "Site" shall mean the parcel of real property within ENO's territory on which the CSG Facility will be constructed and located, including any easements, rights of way, surface use agreements and other interests or rights in real estate reasonably necessary for the construction, operation and maintenance of the CSG Facility. The Site is more specifically described in Exhibit A to this Agreement.

1.22. "Subscriber" shall mean a Customer of ENO that holds a Subscription to one or more CSG Facilities and has identified one or more individual meters or accounts related to electric service to which the Subscription(s) shall be attributed. A "Subscriber" shall also mean a Low-Income Subscriber.

1.23. "Subscription" shall mean a proportional interest owned or held by a Subscriber in the CSG Facility, which meets all of the requirements set forth in Section 3.3, below.

1.24. "Unsubscribed Energy" refers to any energy Output of a CSG Facility in kWh that is not allocated to a Subscriber as part of a Subscription.

**ARTICLE II**  
**SALE AND DELIVERY OF OUTPUT AND OWNERSHIP OF RENEWABLE**  
**ENERGY CREDITS**

2.1 Sale and Delivery of Subscribed Output. Effective upon the Date of Commercial Operation, Subscriber Organization shall sell and deliver to ENO at the Production Meter all of the Output produced by the CSG Facility and attributable to Subscriptions held by all Subscribers in the CSG Facility. As set forth in the Rules, ENO shall not be obligated to make any payment to Subscriber Organization for the Subscribed Output but instead will render monthly Credits to Subscribers as described below.

2.2 For each Subscriber, ENO shall apply a monthly Credit each billing period to such Subscriber's bill for retail electric service in accordance with ENO's Rate Schedule CSGF based upon the Allocation as set forth in the applicable Monthly Subscription Information. ENO is only obligated to apply monthly bill Credits for Subscribed Output produced and delivered by the CSG Facility to the Production Meter.

2.3 For purposes of applying the monthly Credit to Subscribers' bills, ENO shall be entitled to rely exclusively on the Monthly Subscription Information as updated by Subscriber Organization in accordance with the procedures required by the Plan referenced in Section 4.6, below. The correction of previously-applied monthly Credits among Subscribers due to any inaccuracy reflected in such Monthly Subscription Information with regard to a Subscriber's Subscription in the CSG Facility and the beneficial share of Output produced by the CSG Facility shall be the full responsibility of the Subscriber Organization.

2.4 The ownership and title to all renewable energy attributes or RECs associated with the CSG Facilities shall belong to the individual Subscribers.

2.5 If the Subscriber Organization can demonstrate an increased value provided directly to Subscribers with ownership and title of the RECs by the Subscriber Organization, the Subscriber Organization should provide said support to the Council, which may allow the Subscriber Organization to offer Subscribers the opportunity to redeem the value of such RECs on an individual or consolidated basis.

2.6 Purchase and Sale of Unsubscribed Energy. Effective upon the Date of Commercial Operation, Subscriber Organization agrees to sell, and ENO agrees to purchase, up to twenty percent (20%) of the monthly Unsubscribed Energy produced by the CSG Facility and delivered to ENO at the Production Meter. The rate per kWh that ENO shall pay Subscriber Organization for the up-to-twenty percent (20%) portion of Unsubscribed Energy pursuant to this Section shall be ENO's estimated avoided energy costs for the appropriate time period from ENO's most recent biennial filing with the Clerk of Council of the City of New Orleans pursuant to the Public Utilities Regulatory Policies Act of 1978, Section 201. As provided in the Rules, ENO shall receive all Unsubscribed Energy beyond the up-to-twenty percent (20%) portion without any obligation or

requirement to render payment therefor. The amount of monthly Unsubscribed Energy shall be determined after all Subscribers have been billed and credited based on the monthly Output of each applicable CSG Facility.

2.7 Title, Risk of Loss, and Warranty of Title. As between the Parties, Subscriber Organization shall be deemed to be in control of the energy output from the CSG Facility up to and until delivery and receipt by ENO at the Service Connection and ENO shall be deemed to be in control of such energy from and after delivery and receipt at such Service Connection. Subscriber Organization warrants and represents to ENO that it has or will have at the time of delivery good and sufficient title to all Output and/or the ability to transfer good and sufficient title of same to ENO.

2.8 Exclusive Dealing. Subscriber Organization shall not sell any Output generated from the CSG Facility to any person or entity other than ENO during the Term of this Agreement.

### **ARTICLE III** **REPRESENTATIONS OF THE PARTIES AND CONDITIONS PRECEDENT**

3.1 Subscriber Organization represents and warrants as follows:

- (a) it is registered with the Council and has a valid identification number, which shall be maintained and renewed annually in accordance with the Rules;
- (b) it has and will maintain acceptable proof of Site control such as evidence of property ownership, an executed lease agreement, or a signed option to purchase a lease;
- (c) it has the right and authority to sell the Unsubscribed Energy produced by the CSG Facility to ENO on behalf of the CSG Facility Owner, the Subscribers and itself; and
- (d) it will at all times maintain a valid Interconnection Agreement.

3.2 If the CSG Facility Owner and the Subscriber Organization are not the same person, then the undersigned CSG Facility Owner hereby agrees and consents to the terms of this Agreement and hereby authorizes Subscriber Organization to perform any and all acts necessary on its behalf to carry out the duties, responsibilities and obligations provided for herein as Subscriber Organization, and to sell on the CSG Facility Owner's behalf any and all of CSG Facility Owner's interest in the Output produced by the CSG Facility to ENO in accordance with the terms hereof.

3.3 Requirements and Restrictions Applicable to Subscribers and Subscriptions. The conditions set forth in the following subparagraphs (a) through (d) of this Section 3.3 must be satisfied at all times during the Term of this Agreement, except as specifically provided otherwise below. ENO reserves the right to refuse to accept any additions, deletions or changes to the Monthly Subscription Information to the extent such addition, deletion or change results in non-compliance with any of such conditions. For purposes of this Agreement, the Allocation for any Subscriber or Subscription that no longer satisfies the below conditions for qualification as a valid Subscriber or Subscription shall be treated as an unsubscribed portion, and the Monthly Subscription Information automatically changed accordingly, unless and until such Allocation is changed by Subscriber Organization in a manner that satisfies all such conditions.

(a) A Customer may not hold Subscriptions representing a total amount of energy in the Community Solar Program that exceeds 100 percent (100%) of the value of the Subscriber's Baseline Annual Usage and must comply with the provisions of Section III.A.(3) of the Rules.

(b) No Customer may own more than a forty percent (40%) interest in the beneficial use of the electricity generated by the CSG Facility, including without limitation, the renewable energy and RECs associated with or attributable to the CSG Facility.

(c) Each Subscription shall be sized to represent at least one kW of the CSG Facility's nameplate rating. The minimum one kW sizing requirement herein shall not apply to Subscriptions owned by an eligible Low-Income Subscriber.

(d) CSG Facilities shall be classified into one of two categories: (i) Open Category: CSG Facilities of any size up to two MW as measured by the alternating current rating of the system's inverter; and (ii) Low-Income Category: CSG Facilities of any size up to two MW as measured by the alternating current rating of the system's inverter in which a minimum of 30 percent (30%) of the CSG Facility's Output is provided to Low-Income Subscribers.

3.4 Requirements and Restrictions Applicable to the CSG Facility. The conditions set forth in the following subparagraphs (a) through (d) of this Section 3.4 must be satisfied at all times during the Term of this Agreement. ENO shall have the right hereunder to refuse to purchase any and all Output from the CSG Facility during the period it is not in compliance with any of such conditions if the Subscriber Organization does not remedy the deficiency in a timely manner.

(a) The CSG Facility shall have at least three (3) Subscribers.

(b) The CSG Facility's generating capacity/nameplate rating must not exceed two (2) MW as measured by the alternating current rating of the system's inverter.

(c) The CSG Facility must be located within ENO's service territory, must be individually metered and must connect to ENO's distribution system.

(d) The total number of accounts per CSG Facility may be determined by the Subscriber Organization; however, each Subscription shall be sized to represent at least one kW of the CSG Facility's nameplate rating. The minimum one kW sizing requirement herein shall not apply to Subscriptions owned by an eligible Low-Income Subscriber.

3.5 Responsibility for Verification of Subscriber Eligibility. The Subscriber Organization and ENO shall jointly verify that each Subscriber is eligible to be a Subscriber in the CSG Facility, except for a Subscriber's eligibility to be considered a Low-Income Subscriber, which shall be the sole responsibility of the Subscriber Organization. The Subscriber Organization shall provide an Initial Subscriber Report to ENO within the deadline and in the form required by the Plan. Should ENO determine that any of the customer information provided is either incorrect or incomplete, the Subscriber Organization shall correct the deficiency within the required deadline. The Initial Subscriber Report shall include, at a minimum, each potential Subscriber's name and ENO Account number, the percentage share of the CSG Facility Allocation owned by the Subscriber, the effective date of the ownership of that Subscription, the premises to which the

Subscription is attributed for the purpose of applying billing credits, and whether the Subscriber meets the criteria to be eligible as a Low-Income Subscriber. Changes in the Subscriber enrollment records shall be communicated by the Subscriber Organization to ENO electronically using the Monthly CSG Facility Subscription Update form required by the Plan, as described in Section 4.6, below. Transfers of Subscriptions shall also be communicated by the Subscriber Organization to ENO using the required Monthly CSG Facility Subscription Update form and will be handled as described in the Plan and Section 4.6, below.

3.6 Compliance with Laws. A Subscriber Organization, and, where relevant, third-party-owner/developer, are responsible for ensuring that its CSG Facility is constructed, maintained, and operated in compliance with all relevant local, state and federal laws, rules, regulations and standards, including but not limited to, reliability, safety, zoning, permitting, occupational safety and health, and environmental laws, rules, regulations and standards, as well as adherence to ENO's interconnection policies and procedures and the Rules.

3.7 False Representation. Any representation or warranty made by Subscriber Organization in this Agreement that shall prove to have been false or misleading in any material respect when made or ceases to remain true during the Term if such cessation would reasonably be expected to result in a material adverse impact on ENO, shall constitute an event of default subject to Section 7.1 hereof.

3.8 ENO Disclaimer. Nothing in this Agreement shall be construed as a representation or warranty by ENO of the design, installation or operation of the CSG Facility or any component thereof, and ENO expressly disclaims all warranties of the equipment as to workmanship, quality, or performance, including the fitness of the equipment for the purpose intended.

#### **ARTICLE IV** **TERM, COMMERCIAL OPERATION AND PERFORMANCE**

4.1 Term. This Agreement shall become effective upon its execution by the Parties and shall continue in effect for a Term of 20 years from and after the Date of Commercial Operation, subject to early termination as set forth herein, or until the termination of any Interconnection Agreement associated with the CSG Facility, whichever occurs first. Applicable provisions of this Agreement shall continue in effect after termination, including early termination, to the extent necessary to enforce or complete the duties, obligations or responsibilities of the Parties arising prior to termination and, as applicable, to provide for final billings and adjustments related to the period prior to termination, repayment of any money due and owing to either Party pursuant to this Agreement, and the indemnifications specified in this Agreement.

4.2 Project Development. Prior to the Commercial Operation Date, Subscriber Organization agrees to provide Company with a schedule of the projected completion and in-service dates for the project, and inform Company of any changes to the schedule within five (5) business days of the time that the Subscriber Organization becomes aware of such changes. Upon request, the Company shall have the right to monitor the testing and operation of the CSG Facility at the CSG Facility for compliance with this Agreement, *provided, however, that* Company shall comply with all of Subscriber Organization's applicable safety and health rules and requirements. Company's monitoring of the CSG Facility shall not be construed as inspections or endorsing the design thereof nor as any express or implied warranties including

performance, safety, durability, or reliability of the CSG Facility.

4.3 Commercial Operation. Commercial Operation is achieved when: (a) 100% of the nameplate capacity of the CSG Facility is installed; (b) the CSG Facility has operated without experiencing any abnormal or unsafe operating conditions, as witnessed by ENO personnel at the Site; (c) all permits necessary to authorize the production and, if applicable, delivery to ENO of Output generated by the CSG Facility have been obtained; (d) the Production Meter has been installed; and (e) the Interconnection Agreement has been entered into between ENO and Subscriber Organization and the CSG Facility has been interconnected with ENO's electric distribution system pursuant to the Interconnection Agreement.

4.4 Deposit. If Commercial Operation is not achieved within 12 months of any approved application, Subscriber Organization shall provide to ENO an additional deposit of \$50 per kW to continue under the Community Solar Program as required under Section VII(D)(11) of the Rules. ENO shall return the CSG Facility deposit upon commencement of Commercial Operation, unless the CSG Facility fails to begin operating within 18 months of an approved application, in which case the deposit shall be forfeited, and this Agreement terminated.

4.5 Maintenance and Repair of CSG Facility. The Subscriber Organization shall maintain the CSG Facility and the individual components thereof in good working order at all times during the Term of this Agreement. If, during the Term of this Agreement the CSG Facility or any of the individual components of the system should be damaged or destroyed, the Subscriber Organization shall provide ENO written notice and promptly repair or replace the equipment to its original specifications, tilt and orientation at the Subscriber Organization's sole expense. All of ENO's obligations hereunder during the period of such repair or replacement shall be suspended, except for making payment for any Output generated and delivered prior to such damage or destruction; provided, however, that if the time period for repair or replacement is reasonably anticipated to exceed one hundred and eighty (180) days, ENO shall have the right, exercisable at its sole option, to terminate this Agreement upon not less than thirty (30) days written notice, with no further obligation of the Parties to perform hereunder following the effective date of such termination. In all other situations, if the CSG Facility is out of operation for more than ninety (90) consecutive days during the Term of this Agreement, ENO shall have the right to terminate this Agreement by providing written notice to Subscriber Organization anytime during the period following the expiration of such ninety (90) days and before the CSG Facility has been made fully operational again. If this Agreement is terminated pursuant to this Section 4.5, then Subscriber Organization shall pay ENO liquidated damages in an amount equal to two times the estimated annual generation of the CSG Facility, as determined via PV WATTS, multiplied by the average annual Locational Marginal Price ("LMP") for the ENO Load Zone for the prior calendar year.

4.6 Updating of Subscription Information. Subscriber Organizations are required to provide real time reporting of production as specified by ENO. For CSG Facilities greater than 250 kW, the Subscriber Organization shall provide real time access to production data. ENO may require different real time reporting for CSG Facilities 250 kW and smaller. As required by the Plan, the Subscriber Organization will provide electronically to ENO a Monthly CSG Facility Subscription Update for each CSG Facility listing Subscribers who have been added or deleted since the prior month along with their applicable Subscription amounts. The monthly update shall

follow a standard format specified by ENO in order to integrate data into ENO's billing system. The monthly update shall also include the amount of the CSG Facility's capacity that remains unsubscribed. The update must be provided within the deadline imposed by the Council-approved Plan for updates to take effect for the first billing cycle of the next month. If the Subscriber Organization provides the update after the specified deadline, updates would take effect on the first billing cycle of the month following the next month.

4.7 Certification of Low-Income Qualification. The Subscriber Organization shall certify to ENO in writing that the Subscriber Organization has verified the eligibility of all Low-Income Subscribers needed to qualify for the program prior to receiving permission to operate from ENO. By May 1 of each year, the Subscriber Organization shall re-certify in writing to the Company the Low-Income Subscriber status of all Subscribers to its CSG Facilities that are designated as such.

4.8 Audits. ENO reserves the right, upon thirty (30) days written notice, to audit Subscriber Organization's Subscriber and Subscription records and to inspect the CSG Facility at any time during the Term of this Agreement, and for an additional period of one year thereafter.

## **ARTICLE V**

### **PRODUCTION METER AND INTERCONNECTION**

5.1 Production Meter. Upon the initial satisfaction of all of the conditions set forth in Sections 3.3 and 3.4 above, and any applicable requirements of the Distribution Interconnection Standards, ENO shall install, and thereafter own, operate, maintain and read the Production Meter, which shall be sufficiently sized to measure all Output generated by the CSG Facility, and Subscriber Organization shall reimburse ENO for the cost of installing the Production Meter. Such reimbursement shall be due within thirty (30) days from the date a bill is presented to Subscriber Organization by ENO after the Production Meter is installed. If Subscriber Organization does not make payment in full within that time, the unpaid balance shall bear interest at the rate of one and one half percent (1.5%) per month. ENO reserves the right to replace the Production Meter, at its sole cost, at any time and for any reason.

5.2 Telecommunications Equipment. Subscriber Organization shall cause to be provided, and shall own, operate and maintain at the Subscriber Organization's sole cost any necessary electronic communications equipment or devices that are required to provide real-time access to 15-minute interval data regarding the Output produced by the CSG Facility. Unless otherwise notified in writing by ENO that an alternative telecommunication device is acceptable, such equipment shall include an active, wired telephone or data line capable of transmitting the monthly 15-minute interval data to ENO. ENO reserves the right to replace the telecommunication equipment at its sole cost.

5.3 Failure to Maintain Telecommunication Line. If the telecommunication line required to be maintained by Subscriber Organization pursuant to Section 5.2 is inactive or non-operational during any Production Month when ENO attempts to access measurement data from the telemetry equipment on the Production Meter, Subscriber Organization shall be assessed a Trip Charge applicable to non-gratuitous labor service at the currently-effective rate set forth in the

Schedule of Charges for Rendering Service section of ENO's electric tariff. If the telecommunication line is inactive or non-operational for three consecutive Production Months, then, in addition to the applicable Trip Charges, all energy produced and delivered from the CSG Facility shall be treated and priced as unsubscribed energy hereunder effective as of the first calendar day of such third Production Month and continuing until the subsequent Production Month during which the telecommunication line is made operational and active. Subscriber Organization's payment of Trip Charges hereunder shall be due within thirty (30) days from the date a bill is presented to Subscriber Organization by ENO. If Subscriber Organization does not make payment in full within that time, the unpaid balance shall bear interest at the rate of one and one half percent (1.5%) per month to be invoiced monthly.

5.4 House Power. This Agreement does not provide for House Power. Subscriber Organization shall be solely responsible for arranging retail electric service exclusively from ENO in accordance with ENO's Electric Tariffs. Subscriber Organization shall obtain House Power solely through separately metered retail service and shall not obtain House Power through any other means, and waives any regulatory or other legal right to the contrary, except the right to self-generate as provided in this Section 5.4. Subscriber Organization's right to self-generate hereunder shall be limited to the electrical energy consumed at the Site that is directly related to the CSG Facility's generation, including system operation, performance monitoring and associated communications, and shall not include energy necessary for domestic or other purposes, such as for perimeter lighting, a visitor's center or any other structures or facilities at the Site. The Parties acknowledge and agree that the performance of their respective obligations with respect to House Power shall be a separate from this Agreement and shall be interpreted independently of the Parties' respective obligations under this Agreement. Notwithstanding any other provision in this Agreement, nothing with respect to the arrangements for House Power shall alter or modify Subscriber Organization's or ENO's rights, duties, and obligations under this Agreement. This Agreement shall not be construed to create any rights between Subscriber Organization and ENO with respect to the arrangements for House Power.

5.5 Interconnection Agreement. The Parties recognize that Subscriber Organization and ENO will enter into a separate Interconnection Agreement consistent with the provisions of Entergy's Distribution Design Basis/Standards DR7-01 or DR7-02. The Parties acknowledge and agree that the performance of their respective obligations with respect to the interconnection of the CSG Facility pursuant to the Interconnection Agreement shall be subject to the prior satisfaction of all of the conditions set forth in Sections 3.3 and 3.4 above, but that in all other respects the Interconnection Agreement shall be a separate and free-standing contract and shall be interpreted independently of the Parties' respective obligations under this Agreement. Notwithstanding any other provision in this Agreement, nothing in the Interconnection Agreement shall alter or modify Subscriber Organization's or ENO's rights, duties and obligations under this Agreement. This Agreement shall not be construed to create any rights between Subscriber Organization and ENO with respect to the Interconnection Agreement.

## ARTICLE VI FORCE MAJEURE

6.1 Definition of Force Majeure. (a) The term "Force Majeure," as used in this Agreement, means causes or events beyond the reasonable control of, and without the fault or

negligence of the Party claiming Force Majeure, including, without limitation, acts of God, sudden actions of the elements such as floods, earthquakes, hurricanes, or tornadoes; high winds of sufficient strength or duration to materially damage a CSG Facility or significantly impair its operation such that it is no longer capable of generating Output; long-term material changes in Output flows across the CSG Facility caused by climatic change, lightning, fire, ice storms, sabotage, vandalism caused by others despite reasonable efforts of Subscriber Organization to secure and protect the CSG Facility, terrorism, war, riots, fire; explosion, insurrection, strike, slow down or labor disruptions (even if such difficulties could be resolved by conceding to the demands of a labor group), and actions or inactions by any governmental authority taken after the date hereof (including the adoption or change in any rule or regulation or environmental constraints lawfully imposed by such governmental authority), but only if such requirements, actions, or failures to act prevent or delay performance, and inability, despite due diligence, to obtain any licenses, permits, or approvals required by any governmental authority having jurisdiction.

(b) The term Force Majeure does not include (i) any acts or omissions of any third party, including, without limitation, any vendor, materialman, customer, or supplier of Subscriber Organization, unless such acts or omissions are themselves excused by reason of Force Majeure; (ii) any full or partial curtailment in the electric output of the CSG Facility that is caused by or arises from a mechanical or equipment breakdown or other mishap or events or conditions attributable to normal wear and tear or flaws, unless such mishap is caused by one of the following: catastrophic equipment failure; acts of God; sudden actions of the elements, including, but not limited to: floods; hurricanes, tornadoes; sabotage; terrorism; war; riots; and emergency orders issued by a governmental authority or (iii) changes in market conditions that affect the cost of ENO's or Subscriber Organization's supplies, or that affect demand or price for any of ENO's or Subscriber Organization's products.

6.2 Applicability of Force Majeure. (a) Neither Party shall be responsible or liable for any delay or failure in its performance under this Agreement, nor shall any delay, failure, or other occurrence or event become an event of default, to the extent such delay, failure, occurrence or event is substantially caused by conditions or events of Force Majeure, provided that:

- i. the non-performing Party gives the other Party prompt written notice describing the particulars of the occurrence of the Force Majeure;
- ii. the suspension of performance is of no greater scope and of no longer duration than is required by the Force Majeure;
- iii. the non-performing Party proceeds with reasonable diligence to remedy its inability to perform and provides weekly progress reports to the other Party describing actions taken to end the Force Majeure; and
- iv. when the non-performing Party is able to resume performance of its obligations under this Agreement, that Party shall give the other Party written notice to that effect.

(b) Except as otherwise expressly provided for in this Agreement, the existence of a condition or event of Force Majeure shall not relieve the Parties of their obligations under this Agreement (including, but not limited to, payment obligations) to the extent that performance of such obligations is not precluded by the condition or event of Force Majeure. Notwithstanding this provision, ENO shall have no obligation to make any payment for Output under this

Agreement except for actual production as measured by the metering provisions of this Agreement.

6.3 Limitations on Effect of Force Majeure. In no event will any delay or failure of performance caused by any conditions or events of Force Majeure extend this Agreement beyond its stated Term. In the event that any delay or failure of performance caused by conditions or events of Force Majeure continues for an uninterrupted period of three hundred sixty-five (365) days from its occurrence or inception, as noticed pursuant to Section 6.2(a)(i) above, the Party not claiming Force Majeure may, at any time following the end of such three hundred sixty-five (365) day period terminate this Agreement upon written notice to the affected Party, without further obligation by either Party except as to costs and balances incurred prior to the effective date of such termination. The Party not claiming Force Majeure may, but shall not be obligated to, extend such three hundred sixty-five (365) day period, for such additional time as it, at its sole discretion, deems appropriate, if the affected Party is exercising due diligence in its efforts to cure the conditions or events of Force Majeure.

## **ARTICLE VII**

### **DEFAULT, REMEDIES AND DISPUTE RESOLUTION**

7.1 Events of default. Any of the following events shall constitute an event of default if such event has not been cured as provided for below:

(A) Third-party owner/developer, Subscriber Organization and their affiliated and parent companies' failure at any time during the Term of this Agreement to meet the requirements under Section 3.1(d) (Interconnection Agreement). In such event Company may, and in its sole discretion, terminate this Agreement. Upon such termination Company shall have no further financial or other obligation to the Subscriber Organization as a result of such termination. The provisions of paragraph 7.3 shall not apply to an event of default under this paragraph.

(B) The failure by either Party to perform or observe any other material term or provision of this Agreement, that is not excused by Force Majeure, and such failure remains unremedied for 30 days after notice thereof shall have been given by the non-defaulting Party.

7.2 Prior to commencing any action to enforce this Agreement, the non-defaulting Party shall provide written notice of default to the Party asserted to be in default and the Party asserted to be in default shall have a period of thirty (30) days following receipt of such written notice within which to cure the asserted default (or if the asserted default is of a nature which cannot reasonably be cured within such 30-day period, to commence and thereafter diligently pursue a cure thereof.)

7.3 Failure of either Party to assert a default or to enforce any term or condition of this Agreement shall not constitute a waiver of any other similar or other default, or waiver of such term or condition or of any other term or condition of this Agreement. Each Party hereby irrevocably and unconditionally waives any right to a trial by jury for the resolution of any dispute arising under this Agreement.

7.4 If any disputes arise concerning this Agreement, including but not limited to enforcement of any term or condition of the Agreement, the prevailing Party in any action brought for the purpose of enforcing such provisions shall be entitled to recover its reasonable attorney

fees, expenses and costs of such action from the non-prevailing Party.

## **ARTICLE VIII** **LIABILITY AND INDEMNIFICATION**

8.1 Limitation of Liability. ENO shall not be responsible or liable for any personal injury or property damage caused by the CSG Facility or any individual component equipment of the system. ENO shall not be liable to the Subscriber Organization for any punitive, special, exemplary or consequential damages, including but not limited to, lost profits, loss of use, and costs of replacement, whether based in contract, tort, upon any theory of indemnity, or otherwise. ENO makes no warranty or representation concerning the taxable consequences, if any, to Subscriber Organization with respect to the production and sale of Output, and Subscriber Organization is urged to seek professional advice regarding this issue.

8.2 Indemnification by Subscriber Organization. Subscriber Organization shall indemnify, defend, and hold ENO, its employees, agents, successors, assigns, subsidiaries and affiliates harmless against any and all claims, demands, liens, lawsuits, judgments or actions of whatsoever nature that may be brought on account of the installation, maintenance, operation, repair, or replacement of the CSG Facility or any component equipment of the system, or Subscriber Organization's administration of Subscriptions or the performance of its responsibilities as a subscriber organization.

## **ARTICLE IX** **LAWS AND REGULATORY BODIES**

9.1 Agreement Subject to Laws and Regulations. This Agreement and the rights and obligations of the Parties hereunder shall be subject to all valid applicable state, local and federal laws, rules, regulations, ordinances, orders and decisions issued or promulgated for or by any court or regulatory agency having or asserting jurisdiction over this Agreement, the services to be performed hereunder, or either of the Parties hereto.

9.2 Rights Upon Regulatory Agency or Court Action. Except as may be otherwise provided herein, in the event that any court or regulatory agency having or asserting jurisdiction over these premises takes any action or issues any determination that directly or indirectly prohibits performance to a material extent under this Agreement by either or both parties or otherwise makes such performance illegal or impossible, such action or determination will be considered to be an event of Force Majeure. In the event that any such court or regulatory agency takes any action or issues any determination that directly or indirectly effects a material adverse change to any substantive provision of this Agreement, in the terms of performance or with respect to the rights or obligations of either party hereto (in that party's reasonable good faith opinion), then the party materially adversely affected may: (i) continue to perform its obligations under the Agreement as changed, (ii) seek to renegotiate the terms of this Agreement by providing written notice to the other party of its desire to renegotiate, or (iii) at any time during a period of ninety (90) days next following receipt by the other party of written notice of any such action by any such court or regulatory agency, terminate this Agreement by providing written notice to the other party hereto on or before the end of such ninety (90) day period, such termination to be effective on the first day of the month next following ninety (90) days after the receipt of such notice of termination; provided however that,

if such action or determination is rescinded prior to the effectiveness of such notice, such notice will be deemed invalid. In the event the Agreement terminates under this provision, all further rights and obligations of ENO and Subscriber Organization under this Agreement will be null and void. Each party hereto shall provide reasonable and prompt notice to the other party hereto as to any regulatory proceedings or actions described herein that could affect the rights and obligations of the Parties hereto.

9.3 Performance Pending Renegotiation or Termination. Irrespective of any action by any court or regulatory agency as contemplated by Sections 9.1 or 9.2, above, each of the Parties hereto shall continue to honor and perform all of their respective warranties, representations and obligations under this Agreement including, but not limited to, the obligations of Subscriber Organization to sell and deliver the Output of the CSG Facility to ENO and the obligations of ENO to accept and pay Subscriber Organization as provided herein, until the Parties either mutually renegotiate the terms of this Agreement or until this Agreement terminates pursuant to the provisions of Section 9.2 above.

9.4 Governing Law. This Agreement shall be governed by and interpreted in accordance with the laws of the State of Louisiana.

## **ARTICLE X**

### **MISCELLANEOUS PROVISIONS**

10.1 Counterparts. This Agreement may be executed in two or more counterparts, each of which shall be deemed an original, but all constitute one and the same instrument. The Parties agree that a facsimile copy of a counterpart signed by the other Party will be deemed original and binding.

10.2 Assignment, Successors and Assigns. This Agreement shall be binding upon and inure to the benefit of the successors and assigns of the respective Parties hereto and shall not be assigned by either Party without the written consent of the non-assigning Party, which consent shall not be unreasonably withheld. In no event shall any assignment by Subscriber Organization become effective before a new Subscriber Agency Agreement has been entered into between Subscriber Organization's assignee and each and every Subscriber.

10.3 Relationship of the Parties. Nothing herein is intended nor shall ever be construed to create a joint venture, partnership or any other type of association between the Parties, nor shall either Party have the right to act in behalf of or bind the other for any liability, cost, expense or undertaking except as set forth in this Agreement.

10.4 Amendments or Modifications. No amendment, modification, or change of this Agreement shall be binding upon the Parties unless such amendment, modification, or change is in writing and executed by the Parties.

10.5 Construction. No understandings or agreements not expressly stated herein shall be binding on the Parties in the construction or fulfillment hereof unless such understandings or agreements are reduced to writing and signed by the respective parties. The rule of construction that ambiguous provisions shall be interpreted against the drafter shall not apply to this Agreement.

10.6 No Third-Party Beneficiaries. Except as otherwise specifically provided herein, this Agreement is not intended to, and shall not, create rights, remedies, or any benefits of any character whatsoever, in favor of any person, corporation or other entity other than the Parties hereto, and the obligations herein assumed are for the use and benefit of the Parties, their successors in interest, and permitted assigns.

10.7 Remedies Cumulative. Except as otherwise specifically provided herein, each remedy provided for under this Agreement shall be taken and construed as cumulative and in addition to every other remedy provided for herein or available at law or in equity.

10.8 Notices. All notices, reports or other communications provided for in this Agreement shall be in writing and shall be deemed to have been sent when delivered by hand, sent by facsimile with verification, or when deposited in the United States mail, postage prepaid and properly addressed or when sent via overnight courier:

If to ENO:

\_\_\_\_\_

If to Subscriber Organization:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

or at such other address as either party may hereafter designate to the other in writing.

[INTENTIONALLY LEFT BLANK]

IN WITNESS WHEREOF, the undersigned Parties have executed this Agreement as of the date and year first above written.

**SUBSCRIBER ORGANIZATION**

Name (printed): \_\_\_\_\_

Title: \_\_\_\_\_

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**ENTERGY NEW ORLEANS, LLC**

Name (printed): \_\_\_\_\_

Title: \_\_\_\_\_

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**CSG FACILITY OWNER (if different from Subscriber Organization)**

Name (printed): \_\_\_\_\_

Title: \_\_\_\_\_

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

No. \_\_\_\_\_

**Exhibit A**

*DESCRIPTION OF CSG Facility SITE:*



**SUBSCRIBER AGENCY AGREEMENT  
FOR NEW ORLEANS COMMUNITY SOLAR PROGRAM**

**Form CSG-8**

Subscriber Name:

\_\_\_\_\_

Subscriber Entergy Retail Customer Account No.:

\_\_\_\_\_

Subscriber Service Address:

\_\_\_\_\_

Subscriber E-mail Address:

\_\_\_\_\_

Subscriber Mailing Address:

\_\_\_\_\_

\_\_\_\_\_

Subscriber Telephone No: \_\_\_\_\_ (Primary)

\_\_\_\_\_ (Alt.)

Subscriber Organization Name:

\_\_\_\_\_

\_\_\_\_\_

Community Solar Generating Facility No.:

\_\_\_\_\_

Name and Location of Community Solar Generating Facility:

\_\_\_\_\_

\_\_\_\_\_

Subscriber's Initial Subscription Share (in kilowatts, or "kW"): \_\_\_\_\_ kW

The undersigned Subscriber hereby authorizes \_\_\_\_\_  
("Subscriber Organization"), and Subscriber Organization hereby accepts the responsibility, to  
act as Subscriber's agent for purposes of selling to Entergy New Orleans, LLC ("ENO") all of  
Subscriber's beneficial interest in and to the Output generated by, and delivered to ENO from, the  
CSG Facility identified above, ~~including full authority for Subscriber Organization to enter into a  
long term contract on behalf of Subscriber for such sale and to administer such contract,~~ all  
pursuant to the Council of the City of New Orleans ("Council")' Community Solar Program and  
ENO's Rate Schedule CSGF on file with the Council ~~of the City of New Orleans ("Council")~~ and  
in effect from time to time. Capitalized words have the meaning assigned herein or in the New  
Orleans Community Solar Rules established by the Council.

1. Duties of Subscriber Organization Generally. Subscriber Organization shall be responsible for issuing and managing the subscriptions of all Subscribers in the CSG Facility and for selling to ENO the subscribed portions of the Output generated by the CSG Facility and delivered to ENO at the service connection located at the Site. In performing such functions, Subscriber Organization shall communicate directly to ENO Subscriber's information concerning its subscription in the CSG Facility, including its beneficial interest in the Output generated and produced by the CSG Facility. Subscriber acknowledges and agrees that ENO shall exclusively rely on such information as regularly and timely communicated from the Subscriber Organization for the purpose of calculating the credit that will be applied by ENO and reflected on Subscriber's subsequent electric service bills as compensation for ENO's receipt of Subscriber's share of the Output generated and produced by the CSG Facility, in accordance with applicable Rate Schedule.

2. Subscription Credits. ENO shall apply credits to each Subscriber's monthly bill using the most recently updated monthly Subscriber list and Output data provided by the Subscriber Organization on a two-month lag where actual operational results and the associated bill credit will show up two months following ENO's receipt of the Output data for the CSG Facility. ENO shall determine the amount of CSG Facility monthly kWh Output to be credited to each Subscriber by multiplying the Subscriber's most recent generation proportion of the CSG Facility by the ENO metered Output of the CSG Facility. ENO shall be entitled to rely exclusively on the Monthly Subscription Information as timely entered or changed by Subscriber Organization via the monthly CSG Facility Subscription update form. The correction of previously-applied monthly Credits due to any inaccuracy reflected in such Monthly Subscription Information with regard to a Subscriber's Subscription in the CSG Facility and the beneficial share of Output produced by the CSG Facility shall be the full responsibility of the Subscriber Organization.

3. Limitation of Agency. This Agency Agreement shall only serve to authorize Subscriber Organization to act as Subscriber's agent with respect to Subscriber's beneficial interest in and to the Output generated by the CSG Facility and delivered to ENO to the extent that Subscriber's subscription continues from time-to-time to qualify as a valid subscription in the CSG Facility.

4. Term of Agency and Termination. (a) This Agency Agreement shall become effective upon its execution by both Subscriber and Subscriber Organization and shall continue in effect for so long as a valid and existing contract between ENO and Subscriber Organization for the purchase and sale of such Output remains in effect.

(b) This Agency Agreement may be terminated by either Subscriber Organization or Subscriber upon ENO's receipt of notice that Subscriber's subscription in the CSG Facility has been terminated or transferred in its entirety, or that Subscriber no longer holds an interest in the beneficial use of the Output generated by the CSG Facility.

(c) This Agency Agreement shall automatically terminate upon: (i) the effective date of the termination of the contract between Subscriber Organization and ENO for the purchase and sale of Output generated by the CSG Facility; or (b) in the event of an

effective assignment by Subscriber Organization of such contract, where ENO has consented to such assignment in writing, the effective date of a replacement agency agreement between Subscriber and the new owner or subscriber organization of the CSG Facility that has taken assignment of such contract from Subscriber Organization.

5. Representation and Acknowledgement. By executing this Subscriber Agency Agreement, Subscriber represents and warrants that the information stated herein is true and correct to the best of Subscriber's knowledge and belief and that Subscriber has signed up for the stated subscription share size in the CSG Facility through Subscriber Organization.

6. Consent to Disclose Account Information. By signing this Form CSG-8, Subscriber Agency Agreement, Subscriber grants consent to Subscriber Organization to request and obtain from ENO information regarding Subscriber's past and present electric usage at the Service Address(es) identified above in order for Subscriber Organization independently to verify the extent of Subscriber's eligibility to hold a Subscription in the CSG Facility.

IN WITNESS WHEREOF, this Agency Agreement was duly executed by the undersigned authorized representatives of Subscriber and Subscriber Organization.

**SUBSCRIBER**

**SUBSCRIBER ORGANIZATION**

By: \_\_\_\_\_

By: \_\_\_\_\_

Name: \_\_\_\_\_

Name: \_\_\_\_\_

Title: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

Date: \_\_\_\_\_

**SUBSCRIBER AGENCY AGREEMENT  
FOR NEW ORLEANS COMMUNITY SOLAR PROGRAM**

**Form CSG-8**

Subscriber Name:

\_\_\_\_\_

Subscriber Entergy Retail Customer Account No.:

\_\_\_\_\_

Subscriber Service Address:

\_\_\_\_\_

Subscriber E-mail Address: \_\_\_\_\_

Subscriber Mailing Address: \_\_\_\_\_

\_\_\_\_\_

Subscriber Telephone No: \_\_\_\_\_ (Primary)

\_\_\_\_\_ (Alt.)

Subscriber Organization Name: \_\_\_\_\_

\_\_\_\_\_

Community Solar Generating Facility No.:

\_\_\_\_\_

Name and Location of Community Solar Generating Facility:

\_\_\_\_\_

\_\_\_\_\_

Subscriber's Initial Subscription Share (in kilowatts, or "kW"): \_\_\_\_\_ kW

The undersigned Subscriber hereby authorizes \_\_\_\_\_  
("Subscriber Organization"), and Subscriber Organization hereby accepts the responsibility, to act as Subscriber's agent for purposes of selling to Entergy New Orleans, LLC ("ENO") all of Subscriber's beneficial interest in and to the Output generated by, and delivered to ENO from, the CSG Facility identified above, all pursuant to the Council of the City of New Orleans ("Council") Community Solar Program and ENO's Rate Schedule CSGF on file with the Council and in effect from time to time. Capitalized words have the meaning assigned herein or in the New Orleans Community Solar Rules established by the Council.

1. Duties of Subscriber Organization Generally. Subscriber Organization shall be responsible for issuing and managing the subscriptions of all Subscribers in the CSG Facility and for selling to ENO the subscribed portions of the Output generated by the CSG Facility and delivered to ENO at the service connection located at the Site. In performing such functions, Subscriber Organization shall communicate directly to ENO Subscriber's information concerning its subscription in the CSG Facility, including its beneficial interest in the Output generated and produced by the CSG Facility. Subscriber acknowledges and agrees that ENO shall exclusively rely on such information as regularly and timely communicated from the Subscriber Organization for the purpose of calculating the credit that will be applied by ENO and reflected on Subscriber's subsequent electric service bills as compensation for ENO's receipt of Subscriber's share of the Output generated and produced by the CSG Facility, in accordance with applicable Rate Schedule.

2. Subscription Credits. ENO shall apply credits to each Subscriber's monthly bill using the most recently updated monthly Subscriber list and Output data provided by the Subscriber Organization on a two-month lag where actual operational results and the associated bill credit will show up two months following ENO's receipt of the Output data for the CSG Facility. ENO shall determine the amount of CSG Facility monthly kWh Output to be credited to each Subscriber by multiplying the Subscriber's most recent generation proportion of the CSG Facility by the ENO metered Output of the CSG Facility. ENO shall be entitled to rely exclusively on the Monthly Subscription Information as timely entered or changed by Subscriber Organization via the monthly CSG Facility Subscription update form. The correction of previously-applied monthly Credits due to any inaccuracy reflected in such Monthly Subscription Information with regard to a Subscriber's Subscription in the CSG Facility and the beneficial share of Output produced by the CSG Facility shall be the full responsibility of the Subscriber Organization.

3. Limitation of Agency. This Agency Agreement shall only serve to authorize Subscriber Organization to act as Subscriber's agent with respect to Subscriber's beneficial interest in and to the Output generated by the CSG Facility and delivered to ENO to the extent that Subscriber's subscription continues from time-to-time to qualify as a valid subscription in the CSG Facility.

4. Term of Agency and Termination. (a) This Agency Agreement shall become effective upon its execution by both Subscriber and Subscriber Organization and shall continue in effect for so long as a valid and existing contract between ENO and Subscriber Organization for the purchase and sale of such Output remains in effect.

(b) This Agency Agreement may be terminated by either Subscriber Organization or Subscriber upon ENO's receipt of notice that Subscriber's subscription in the CSG Facility has been terminated or transferred in its entirety, or that Subscriber no longer holds an interest in the beneficial use of the Output generated by the CSG Facility.

(c) This Agency Agreement shall automatically terminate upon: (i) the effective date of the termination of the contract between Subscriber Organization and ENO for the purchase and sale of Output generated by the CSG Facility; or (b) in the event of an

effective assignment by Subscriber Organization of such contract, where ENO has consented to such assignment in writing, the effective date of a replacement agency agreement between Subscriber and the new owner or subscriber organization of the CSG Facility that has taken assignment of such contract from Subscriber Organization.

5. Representation and Acknowledgement. By executing this Subscriber Agency Agreement, Subscriber represents and warrants that the information stated herein is true and correct to the best of Subscriber's knowledge and belief and that Subscriber has signed up for the stated subscription share size in the CSG Facility through Subscriber Organization.

6. Consent to Disclose Account Information. By signing this Form CSG-8, Subscriber Agency Agreement, Subscriber grants consent to Subscriber Organization to request and obtain from ENO information regarding Subscriber's past and present electric usage at the Service Address(es) identified above in order for Subscriber Organization independently to verify the extent of Subscriber's eligibility to hold a Subscription in the CSG Facility.

IN WITNESS WHEREOF, this Agency Agreement was duly executed by the undersigned authorized representatives of Subscriber and Subscriber Organization.

**SUBSCRIBER**

By: \_\_\_\_\_

Name: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

**SUBSCRIBER ORGANIZATION**

By: \_\_\_\_\_

Name: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

**ENTERGY NEW ORLEANS, LLC**  
ELECTRIC SERVICE

SCHEDULE CSGF

Effective: xxx x, 20xx  
Filed: ~~August 29, 2019~~ January 10, 2020  
Supersedes: New Schedule  
Schedule Consists of: Three Pages and  
Attachment A

---

**COMMUNITY SOLAR GENERATING FACILITIES**

---

**I. AVAILABILITY**

This Community Solar Generating Facilities Subscription Service ("CSGF") schedule is available to all customers qualifying as Subscribers to a Community Solar Generating ("CSG") Facility pursuant to the Community Solar Rules approved by the Council of the City of New Orleans ("Council").

**II. DESCRIPTION**

Pursuant to the Community Solar Rules, Entergy New Orleans, LLC ("ENO" or "Company"), customers have the option to subscribe to a portion of the Output from one or more CSG Facilities. ENO will provide a monthly credit to customers with such Subscriptions based on the customer's proportionate share of the CSG Facility's monthly energy Output times a dollars per kWh rate. Participating ENO customers are Subscribers with a Subscriber Organization. The Subscriber Organization is responsible for providing ENO with the Subscription information necessary for monthly billing under this schedule in timely manner.

**III. MONTHLY BILLING TO CSG SUBSCRIBERS**

The monthly Subscriber credit will be based on the applicable metered CSG Facility energy Output on a two-month lag basis.

- A. Monthly Subscriber Energy = (Customer's kW Subscription for the applicable CSG Facility / Capacity of applicable CSG Facility) x applicable metered Monthly CSG Facility kWh Output.
- B. Credit for Customers who do not qualify as Low-Income Subscribers:  
Monthly Subscriber Credit = Monthly Subscriber Energy x CSG per kWh credit as defined in Section VIII.E of the Community Solar Rules per Council Resolution R-19-111 and shown on CSGF Attachment A.
- C. Credit for Customers who qualify as Low-Income Subscribers:
- i. ~~Monthly Low-Income Subscriber Credit = Monthly Subscriber Energy x the dollars per kWh value representative of applicable retail rates shown on CSGF Attachment A.~~
  - ii. ~~The dollar per kWh value representative of the applicable monthly retail rate will be determined each year based on the applicable retail energy-related revenue by rate schedule and the corresponding kWh as recorded on the Company's financial records, exclusive of amounts attributable to nonbypassable riders, and the corresponding kWh as reported in the Annual FERC Form 1 for the previous year. Such value will be applied on a two month lag basis.~~

In a monthly billing period, if the Subscriber's credit exceeds the Subscriber's bill for electric service, the excess billing credit will be rolled over as a dollar amount bill credit from month to month. Such credits will apply to the final bill if customer terminates service, however,

no payment from ENO will be made for any remaining bill credit associated with the Subscriber's Subscription if the amount of the credit exceeds the final bill.

#### IV. DEFINITIONS

**Baseline Annual Usage** - A Subscriber's accumulated kWh electricity use for the previous 12-month period at the time the subscription is entered into, as measured at the ENO meter, net of any distributed generation provided by the Subscriber to the utility system at that meter. For a Subscriber that does not have a record of 12 months of electricity use at the time of the Subscriber's most recent Subscription, an estimate of the Subscriber's accumulated 12 months of electricity use in kWh would be developed based on historical data for the customer class.

**CSG Facility** - A solar energy facility that meets the definition and requirements of the Community Solar Rules.

**Low-Income Subscriber** - A Subscriber whose gross annual household income is at or below 50 percent of Area Median Income for the year of subscription or who is certified as eligible for any federal, state, or local assistance program that limits participation to households whose income is at or below 50 percent of Area Median Income. The operator of a low-income multi-family dwelling unit may apply to the Council to qualify as a Low-Income Subscriber for the purposes of the Community Solar Program. The operator should demonstrate to the Council that the Subscription Credits will be credited to the tenants of the low-income multi-family dwelling.

**Output** - The energy and power produced by a CSG Facility. CSG Facility Output will be measured on a calendar month basis.

**Subscriber** - An ENO customer that holds a Subscription to one or more CSG Facilities and has identified one or more individual meters or accounts related to electric service to which the Subscription(s) shall be attributed.

**Subscriber Organization** - A person or legal entity that owns and operates a CSG Facility, or operates a CSG Facility that is built and owned by a third party under contract with such Subscriber Organization. A Subscriber Organization may also be a Subscriber to the facility, subject to the Limitations on Subscriptions as described in the Community Solar Rules.

**Subscription** - The portion or proportionate interest of Output of a CSG Facility that is allocated to a Subscriber, including the Renewable Energy Credits associated with or attributable to the CSG Facility.

#### V. TERMS OF SERVICE

- A. All customer classes are eligible to subscribe to a CSG Facility. A customer may subscribe to a CSG Facility regardless of the customer's participation in other ENO-sponsored renewable programs, such as Net Metering Service, provided that the customer's participation does not violate, individually or collectively, eligibility limits as specified in Section III of the Council's Community Solar Rules.
- B. A customer may not hold Subscriptions representing a total amount of energy exceeding 100 percent of the value of the Subscriber's Baseline Annual Usage, as estimated by the Company.

- C. A customer may purchase multiple Subscriptions from one or more CSG Facilities provided that the total of the Subscriptions does not exceed the Subscriber's Baseline Annual Usage, as estimated by the Company.
- D. No customer may own more than 40 percent interest in the capacity and associated Output from a CSG Facility.
- E. Solar Rules including but not limited to requirements for eligibility, capacity limits, registration and records, verification of low-income status, and any other obligations as described in the Community Solar Rules.
- F. Changes in Subscriber enrollment records will be communicated by Subscriber Organization to ENO, in electronic form, on a monthly basis.
- G. A Subscriber may release all or part of a Subscription back to the Subscriber Organization making it available for transfer to a person or entity who qualifies to be a Subscriber.
- H. Through a Subscriber Organization, a Subscriber who moves to a different location within ENO's service area may change the premises to which the Subscription is attributed. If necessary, the Subscriber must adjust his Subscription, so that it does not exceed 100 percent of the Baseline Annual Usage at the new location as estimated by the Company.
- I. Subscriber Organizations will provide the Company with updated Subscriber information no later than the tenth calendar day of each month for CSG credits to be reflected on customer bills during the upcoming billing month. Any updated Subscriber information provided after the tenth calendar day of the month will be reflected on customer bills during the next billing month following the upcoming billing month.

Attachment A  
Page 1 of 1  
Effective Date: xxx xx, 20xx2020

ENTERGY NEW ORLEANS, LLC  
COMMUNITY SOLAR GENERATING FACILITIES  
CSGF

CSG SUBSCRIBER:	
Non Low Income Credit	\$-x.xxx per kWh
<del>Residential Low Income Credit</del>	<del>\$-x.xxx per kWh</del>

**ENTERGY NEW ORLEANS, LLC**  
ELECTRIC SERVICE

SCHEDULE CSGF

Effective: xxx x, 20xx  
Filed: January 10, 2020  
Supersedes: New Schedule  
Schedule Consists of: Three Pages and  
Attachment A

---

**COMMUNITY SOLAR GENERATING FACILITIES**

---

**I. AVAILABILITY**

This Community Solar Generating Facilities Subscription Service ("CSGF") schedule is available to all customers qualifying as Subscribers to a Community Solar Generating ("CSG") Facility pursuant to the Community Solar Rules approved by the Council of the City of New Orleans ("Council").

**II. DESCRIPTION**

Pursuant to the Community Solar Rules, Entergy New Orleans, LLC ("ENO" or "Company"), customers have the option to subscribe to a portion of the Output from one or more CSG Facilities. ENO will provide a monthly credit to customers with such Subscriptions based on the customer's proportionate share of the CSG Facility's monthly energy Output times a dollars per kWh rate. Participating ENO customers are Subscribers with a Subscriber Organization. The Subscriber Organization is responsible for providing ENO with the Subscription information necessary for monthly billing under this schedule in timely manner.

**III. MONTHLY BILLING TO CSG SUBSCRIBERS**

The monthly Subscriber credit will be based on the applicable metered CSG Facility energy Output on a two-month lag basis.

- A. Monthly Subscriber Energy = (Customer's kW Subscription for the applicable CSG Facility / Capacity of applicable CSG Facility) x applicable metered Monthly CSG Facility kWh Output.
- B. Credit for Customers who do not qualify as Low-Income Subscribers:  
Monthly Subscriber Credit = Monthly Subscriber Energy x CSG per kWh credit as defined in Section VIII.E. of the Community Solar Rules per Council Resolution R-19-111 and shown on CSGF Attachment A.
- C. Credit for Customers who qualify as Low-Income Subscribers:  
Monthly Low-Income Subscriber Credit = Monthly Subscriber Energy x the dollar per kWh value representative of the monthly retail rate based on the applicable retail energy-related revenue by rate schedule and the corresponding kWh as recorded on the Company's financial records, exclusive of amounts attributable to nonbypassable riders. Such value will be applied on a two month lag basis.

In a monthly billing period, if the Subscriber's credit exceeds the Subscriber's bill for electric service, the excess billing credit will be rolled over as a dollar amount bill credit from month to month. Such credits will apply to the final bill if customer terminates service, however, no payment from ENO will be made for any remaining bill credit associated with the Subscriber's Subscription if the amount of the credit exceeds the final bill.

#### IV. DEFINITIONS

**Baseline Annual Usage** - A Subscriber's accumulated kWh electricity use for the previous 12-month period at the time the subscription is entered into, as measured at the ENO meter, net of any distributed generation provided by the Subscriber to the utility system at that meter. For a Subscriber that does not have a record of 12 months of electricity use at the time of the Subscriber's most recent Subscription, an estimate of the Subscriber's accumulated 12 months of electricity use in kWh would be developed based on historical data for the customer class.

**CSG Facility** - A solar energy facility that meets the definition and requirements of the Community Solar Rules.

**Low-Income Subscriber** - A Subscriber whose gross annual household income is at or below 50 percent of Area Median Income for the year of subscription or who is certified as eligible for any federal, state, or local assistance program that limits participation to households whose income is at or below 50 percent of Area Median Income. The operator of a low-income multi-family dwelling unit may apply to the Council to qualify as a Low-Income Subscriber for the purposes of the Community Solar Program. The operator should demonstrate to the Council that the Subscription Credits will be credited to the tenants of the low-income multi-family dwelling.

**Output** - The energy and power produced by a CSG Facility. CSG Facility Output will be measured on a calendar month basis.

**Subscriber** - An ENO customer that holds a Subscription to one or more CSG Facilities and has identified one or more individual meters or accounts related to electric service to which the Subscription(s) shall be attributed.

**Subscriber Organization** - A person or legal entity that owns and operates a CSG Facility, or operates a CSG Facility that is built and owned by a third party under contract with such Subscriber Organization. A Subscriber Organization may also be a Subscriber to the facility, subject to the Limitations on Subscriptions as described in the Community Solar Rules.

**Subscription** - The portion or proportionate interest of Output of a CSG Facility that is allocated to a Subscriber, including the Renewable Energy Credits associated with or attributable to the CSG Facility.

#### V. TERMS OF SERVICE

- A. All customer classes are eligible to subscribe to a CSG Facility. A customer may subscribe to a CSG Facility regardless of the customer's participation in other ENO-sponsored renewable programs, such as Net Metering Service, provided that the customer's participation does not violate, individually or collectively, eligibility limits as specified in Section III of the Council's Community Solar Rules.
- B. A customer may not hold Subscriptions representing a total amount of energy exceeding 100 percent of the value of the Subscriber's Baseline Annual Usage, as estimated by the Company.
- C. A customer may purchase multiple Subscriptions from one or more CSG Facilities provided that the total of the Subscriptions does not exceed the Subscriber's Baseline Annual Usage, as estimated by the Company.
- D. No customer may own more than 40 percent interest in the capacity and associated Output from a CSG Facility.

- E. Solar Rules including but not limited to requirements for eligibility, capacity limits, registration and records, verification of low-income status, and any other obligations as described in the Community Solar Rules.
- F. Changes in Subscriber enrollment records will be communicated by Subscriber Organization to ENO, in electronic form, on a monthly basis.
- G. A Subscriber may release all or part of a Subscription back to the Subscriber Organization making it available for transfer to a person or entity who qualifies to be a Subscriber.
- H. Through a Subscriber Organization, a Subscriber who moves to a different location within ENO's service area may change the premises to which the Subscription is attributed. If necessary, the Subscriber must adjust his Subscription, so that it does not exceed 100 percent of the Baseline Annual Usage at the new location as estimated by the Company.
- I. Subscriber Organizations will provide the Company with updated Subscriber information no later than the tenth calendar day of each month for CSG credits to be reflected on customer bills during the upcoming billing month. Any updated Subscriber information provided after the tenth calendar day of the month will be reflected on customer bills during the next billing month following the upcoming billing month.

Attachment A  
Page 1 of 1  
Effective Date: xxx xx, 2020

ENTERGY NEW ORLEANS, LLC  
COMMUNITY SOLAR GENERATING FACILITIES  
CSGF

<b>CSG SUBSCRIBER:</b>	
Non Low Income Credit	\$-x.xxx per kWh



# Distributed Energy Resource Standards for Interconnection

**Effective December 15, 2019**

A transition period will exist from December 15, 2019 through December 31, 2019 in which a new Interconnection Agreement may be approved to meet the revised 2018 Customer Installation Standards for Electric Service.

*This document is not copyrighted. Copying is encouraged.*

The latest version is available at [www.entergy.com](http://www.entergy.com).

(Under "for producers" click on your State. On your State webpage, under "your business", click on Builder Standards)

The Entergy name and logo are registered service marks of Entergy Corporation and may not be used without the express, written consent of Entergy Corporation.



**Utility Operations  
 DISTRIBUTION DESIGN BASIS**


TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
PREPARED BY: <b>Michael R. Gray Distribution Design Basis</b>	APPROVED BY: <b>Larry W. Phillips Manager, Distribution Design Basis</b>	

**INTRODUCTION AND SUMMARY OF INTERCONNECTION TYPES**

The Distributed Energy Standards for Interconnection contemplate seven distinct configurations (Cases) based on the project type that is being connected, planned to be connected, or facility additions and/or modifications to existing facilities interconnected to the Distribution System of one of the utility operating companies.

Distributed Energy Resources (DER) (or generators) installed within one of the Company's utility's service areas will fall into one of seven cases:

Case 1.	<p>The Customer may build facilities that are NEVER connected to the Company Distribution System; some examples are:</p> <ul style="list-style-type: none"> <li>• A backup generator with automatic open-circuit transfer switch.</li> <li>• An emergency generator, where electric cords are run directly to the generator for essential lights and appliances.</li> <li>• A house with a switch, rated for the Customer's generator size that does not allow electricity to flow from the generator into the facility when the facility is connected to the electric utility system.</li> <li>• <b>No Interconnection Application is required unless the Customer is participating in a demand response program.</b></li> </ul>
---------	---

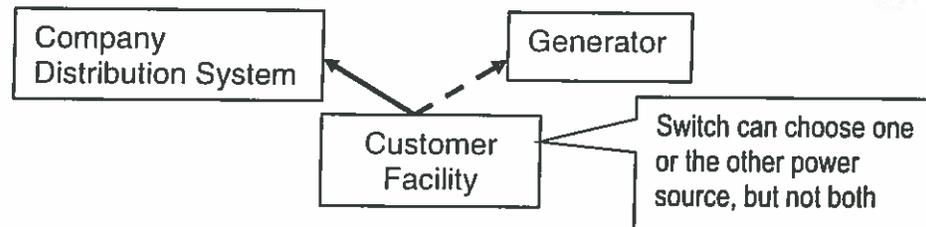

**Refer to your local electrical inspector in this case (if applicable).**

Case 2.	<p>The Customer may build facilities that are connected to their building or internal electrical system and are not intended to be connected to the Company's Distribution System. The Customer shall supply an open and visible break verifiable by Company personnel. The location shall be on the outside of the facility accessible to Company personnel at all hours. A main disconnect in the off position qualifies as an open break. It is recommended that the Customer tag the disconnect to help prevent accidental closing.</p> <ul style="list-style-type: none"> <li>• <b>Failure to have a visible Disconnect Switch is a reason for being disconnected</b> and may subject Customer to liability for resulting injury to people or property.</li> <li>• <b>No Interconnection Application is required.</b></li> </ul>
---------	---

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

Case 3.	The Customer may build facilities that are NOT NORMALLY connected to the Company Distribution System. Total connection time is 10 CYCLES OR LESS (@60 cycles/second). Some or all loads' generated capacity could become displaced. No energy is sold or exported to the Company. <ul style="list-style-type: none"> <li>• <b>An Interconnection Application is required.</b></li> </ul>
Case 4.	The Customer may build facilities that are connected to the Company Distribution System more than 10 cycles (may be hours, days, months, etc.). Some or all of the Customer's load may become displaced. Stand-by facilities may or may not be requested. No energy is sold or sent to the Company. <ul style="list-style-type: none"> <li>• <b>An Interconnection Application is required.</b></li> </ul>
Case 5.	The Customer may build facilities that are normally connected to the Company Distribution System. Some or all of the Customer's load may become displaced. Stand-by facilities are requested. Depending on the jurisdiction, some form of contract may be required for Customer to export energy to the Company and to be credited or compensated for said energy deliveries. <ul style="list-style-type: none"> <li>• <b>An Interconnection Application is required.</b></li> </ul>
Case 6	The Customer may build facilities that are normally connected to the Company Distribution System. The Customer has no significant on-site load (mainly station-service load). Depending on the jurisdiction, some form of contract may be required for Customer to export energy to the Company and to be credited or compensated for said energy deliveries. <ul style="list-style-type: none"> <li>• <b>An Interconnection Application is required.</b></li> </ul>
Case 7.	The Customer may build facilities that are normally connected to the Company Distribution System. Depending on the jurisdiction and only if allowed by law, some form of contract is required with the Company for wheeling energy output to the Midcontinent Independent System Operator, Inc. (MISO) wholesale market. The differentiation between Case 6 and Case 7 is MISO involvement. <ul style="list-style-type: none"> <li>• <b>An Interconnection Application is required.</b></li> </ul>

The above provisions are the minimum requirements for any DER operating in parallel with the Company's Distribution System for voltages up to and including 34.5kV.

DERs of significant size on radial distribution systems can cause relaying and voltage control problems. The Company therefore retains the option to require upgrades where necessary to maintain reliable service or to refuse interconnection of any DER at distribution voltage if such DER will cause reliability issues that cannot be adequately mitigated.

Interconnections of any DER to the Company's Distribution System shall be directly connected to electrical circuits/feeders configured in one of the following options:

**Express Feeder** – dedicated distribution circuit constructed to strictly support the proposed interconnected DER application.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	---	--------------------------------------

**Existing Feeder** – existing distribution circuit/network. The Customer must request interconnection of the DER requiring evaluation in support of parallel operations and possibly the exporting of energy if the size of the DER and/or its configuration will lead to exports to the Company's Distribution System.

Hosting capacity for any existing feeder will be one of the determining factors for evaluating an Interconnection Application along with any required design changes and/or infrastructure upgrades specified to support the Interconnection Application request.

**Unintentional Islanding**

Under no circumstances will a Customer's DER be allowed to sustain an island condition with any part of the Company's Distribution System beyond the Point of Common Coupling due to potential damage to Company or other Customers' equipment. The Customer's DER must be equipped with protection to sense a possible island and disengage from the Company's Distribution System within the 2-second time frame of the formation of an island condition as specified by Institute of Electrical and Electronics Engineers (IEEE) Standard 1547-2018 (or any successor standard).

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

## Table of Contents

1.0 Introduction .....	9
1.1 Purpose .....	9
1.1.1 Interconnection Agreement Requirements .....	10
1.1.2 Explicit Criteria for Parallel Operations .....	10
1.1.2.1 Safety .....	10
1.1.2.2 Customer/Producer Impact .....	10
1.1.2.3 Protective Device Requirements .....	11
1.1.2.4 Hazards .....	11
1.2 How to Interpret and Apply the Standard .....	12
2.0 Definitions.....	14
3.0 Details .....	20
3.1 The Electrical Distribution System.....	20
3.2 Multi-grounded Neutral Distribution Service .....	20
3.3 Types of Allowed Generators .....	20
3.3.1 Limits on Single Phase Generators .....	21
3.3.2 Limits on Three Phase Generators .....	21
3.4 Pre-Installation Information .....	21
3.5 Interconnection Agreement Required.....	21
3.6 Pre-interconnection Study .....	21
3.6.1 Scoping Meeting .....	21
3.6.2 Feasibility Study .....	22
3.6.3 System Impact Study .....	23
3.6.4 Facilities Study .....	24
3.7 Required Drawings.....	25
3.8 Allowable Tie Points .....	25
3.9 Central Business District Networks .....	25
3.10 General Interconnection Requirements .....	26
3.11 Customer/Producer’s Equipment and Interconnection Standards.....	26
3.12 Rating of Customer/Producer’s Equipment .....	26
3.13 Protection of Customer/Producer’s Equipment .....	26

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	---	--------------------------------------

3.14 Manually Operated Load Break Switch / Reasons for Disconnect from the Distribution Delivery System .....27

3.15 Remotely-Operated Load Break Switch / Reasons for Disconnect from the Distribution Delivery System .....27

3.16 Direct Transfer Trip .....28

3.17 Customer's Owned Systems .....28

3.18 Company Partnerships or Company-Owned Systems .....28

3.19 Transformation Requirements .....29

3.20 Dedicated Distribution Transformer .....31

3.21 Grounding .....30

3.22 General Equipment Design and Operating Requirements .....30

    3.22.1 General Equipment Protection Requirements .....31

    3.22.2 Typical Volt/VAR Curves .....32

    3.22.3 Typical Types of Generation Systems .....33

        3.22.3.1 Induction Generators ..... 34

        3.22.3.2 Synchronous Generators ..... 35

        3.22.3.3 Static Power Converters / Inverter Technology ..... 36

        3.22.3.4 Battery Storage System using Inverter Technology ..... 37

3.23 Synchronizing Requirements .....39

3.24 Power Quality Parameters .....39

3.25 Energy Flow During Emergencies .....39

3.26 Power Factor .....39

3.27 Reactive Power Requirements .....39

3.28 Voltage Surges or Sags .....40

3.29 Voltage Flicker, Harmonic Distortion, Transients and other Power Quality Issues .....41

3.30 Frequency .....41

3.31 Specifying Protective Equipment .....41

3.32 Common Protection Requirements .....41

<b>TITLE: Distributed Energy Resource Standards for Interconnection</b>	<b>STANDARD NUMBER: DR07-01, Rev. 17</b>	<b>EFFECTIVE DATE: 12/15/2019</b>
---	--	-----------------------------------

3.33 Protection/Interface Requirements .....	43
3.34 Service Interruption Equipment .....	43
3.35 Fault Interrupting Device .....	43
3.36 Susceptibility to Transmission Faults .....	43
3.37 Changes to Company Fault Interruption Equipment .....	43
3.38 Equipment to Block Energizing Dead Circuits .....	44
3.39 Communication Criteria for Requiring Telemetry .....	44
3.40 Metering Requirements .....	46
3.41 Design Requirements .....	46
3.41.1 Distribution Circuit Models .....	47
3.41.2 Summary of Protective Function Requirements .....	47
3.41.3 Facilities Parallel Generation Under 300 KVA .....	47
3.41.4 Facilities Parallel Generation 300 KVA to 20 MVA .....	48
A. Facilities Rated 300 KVA to Below 10 MVA .....	48
B. Facilities Rated 10 MVA and Above .....	48
3.42 Categories for Distribution Level Interconnections .....	49
3.43 Tests of the Producer's Equipment .....	54
3.44 Pre-parallel Testing .....	54
3.44.1 Certified Equipment .....	55
3.44.2 Non-Certified Equipment .....	56
3.44.3 Verification of Settings .....	56
3.45 Requirements for Commerical Parallel Operation .....	56
3.46 Responsibility for Producer's Operations .....	58
3.47 Load Shed Responsibilities .....	58
3.48 Reconnection to Distribution Delivery System .....	58
3.49 Disconnecting Service to a Customer Facility .....	58
3.50 Responsibility for Customer/Producer's Maintenance .....	58
3.51 Alterations to Existing Service .....	59
3.52 System Changes .....	59

<b>TITLE: Distributed Energy Resource Standards for Interconnection</b>	<b>STANDARD NUMBER: DR07-01, Rev. 17</b>	<b>EFFECTIVE DATE: 12/15/2019</b>
---	--	-----------------------------------

- 3.52.1 Company Changes to Distribution System .....59
- 3.52.2 Customer/Producer Changes to Interconnection .....59
  
- 3.53 Penalty for Interconnecting without Company Authorization .....59
  
- 3.54 Periodic Testing .....60
  
- 4.0 References .....61
  
- 5.0 Responsibilities .....61
  
- 5.1 Interpretation .....61
  
- 5.2 Deviation .....61

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	---	--------------------------------------

## 1.0 Introduction

### 1.1 Purpose

The Distribution Interconnection Process is the overall process for queuing, processing, executing, and maintaining Interconnection Agreements for any DER 20 mega volt ampere (MVA) and smaller in size connecting to a Company utility via its Distribution System. The purpose of this standard is to describe the requirements for safe and effective connection and operation of a DER on the Company Distribution System. A Customer proposing to install a generator larger than 20 MVA or who would interconnect at transmission-level voltage (69kV and above) should contact the Company's Transmission organization. **Customers are encouraged to contact the Company early in the process and learn about interconnection requirements due to the size of the proposed DER, its configuration, and its location on the electric grid.** Customers may call 1-800-ENERGY to get a local engineer involved to assist with the interconnection process.

A Customer shall operate 60 Hertz (Hz), three-phase or single-phase equipment in parallel with the Distribution System pursuant to an executed Interconnection Agreement, provided that the equipment meets or exceeds the Company standards. Certain Federal Energy Regulatory Commission (FERC) Qualifying Facilities or small power producers may have specified rates and requirements in each jurisdiction allowing for the sale of energy to the Company. Customers shall not inject energy onto the Company's Distribution System without an express written agreement with the Company.

The interconnection process is initiated by a Customer (or their designated representative) submitting a completed Interconnection Application signed by the Customer along with a single-line diagram of the proposed design of the interconnected DER.

This standard describes typical interconnection requirements. Certain specific interconnection locations and conditions may require more information from the Customer and/or the installation of infrastructure upgrades and use of more sophisticated protective devices and operating schemes.

If the Company concludes that an Interconnection Application describes a DER that may require additional infrastructure upgrades including devices and operating schemes, the Company shall make those additional requirements known to the Customer at the time any required interconnection studies are completed.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 1.1.1 Interconnection Agreement Requirements

A written Interconnection Agreement will be required between the Company and the Customer outlining the liability provisions, indemnities, payment of costs to modify the Distribution System (if not paid in advance), and other items affecting service under this standard. This Interconnection Agreement will explain in detail the authority or responsibilities of the parties involved. **An interconnection of a DER between the Company and a Customer will not be allowed prior to the execution of a written Interconnection Agreement covering parallel operation.**

### 1.1.2 Explicit Criteria for Parallel Operation

These requirements apply to interconnecting a DER that is intended to operate in parallel with the Company's Distribution System and in some cases, export energy to the Company's Distribution System.

A Customer that produces energy may elect to operate a DER in parallel with the Company's Distribution System or as a separate system with the capability of non-parallel load transfer between the two independent electrical systems. The requirements provided in this standard are applicable to interconnect a DER intending to operate in parallel or non-parallel load transfer with some control of the Customer-owned DER by the Company subject to agreement with Customer.

#### 1.1.2.1 Safety

The Customer's DER will be held to the same Standard of Care as the Company is required to maintain of its own facilities. In addition, the safety of the general public and the personnel and equipment of the Company shall in no way be reduced or impaired as a result of an interconnection.

The Customer's DER shall be equipped with Protective Functions designed to prevent the DER from being connected to a de-energized circuit owned by the Company.

The Customer's DER shall be equipped with the necessary Protective Functions designed to prevent connection or Parallel Operation of the Customer's DER with the Company's Distribution System unless the Distribution System service voltage and frequency are of normal magnitude. The design of some DERs provide these Protective Functions without adding equipment at the Point of Common Coupling. Each DER not providing additional protective devices at the Point of Common Coupling must be shown to be capable of providing these Protective Functions without adding such equipment.

#### 1.1.2.2 Customer Impact

The quality, reliability, and availability of service to the Company's other customers shall not be diminished or impaired as a result of

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

the proposed interconnection. This standard describes typical interconnection requirements. Some DER installations, however, may require more extensive Interconnection Facilities, and will be addressed on a case-by-case basis. For example, this situation may be triggered when more than one Customer desires to connect a DER to the same transformer or on the same distribution feeder.

### **1.1.2.3 Protective Device Requirements**

Operating a DER while interconnected to the Company's Distribution System requires that certain protective devices (relay, circuit breakers, isolation devices, etc.) must be installed at any location where a Customer desires to operate its DER. The purpose of these devices is to isolate faults from the Distribution System and promptly disconnect the Customer's DER from the Company's Distribution System when faults or abnormal operating conditions jeopardize the reliable operation of equipment or the safety of Company personnel or the public. Certain modifications to the Company's Distribution System and/or protective relays may also be required in order to accommodate parallel operation. The Company assumes no responsibility for determining protective equipment needed to protect the Customer's facilities.

### **1.1.2.4 Hazards**

Distribution lines are subject to a variety of natural and human-made hazards. Among these hazards are lightning, storms, animals, fire, earthquakes, damage from vehicles, mischief, and human error. Customers that self-generate energy are subject to these same hazards, but not necessarily to the same degree since the Company's Distribution System has greater exposure to hazards given its configuration and location in public right-of-way.

The electric problems that can result from these hazards principally involve short circuits, grounded conductors, and broken conductors. These fault conditions require that damaged equipment be de-energized as soon as possible to ensure public safety and continued operation of the remaining Distribution System.

The Company has the responsibility to install protective equipment as necessary to detect faulted equipment or other operating abnormalities and to isolate the problem from the remaining Distribution System. A non-utility-owned DER interconnected to and operated in parallel with the Company's Distribution System can represent another source of power on the energized Distribution System. The Company requires that such DERs also have adequate protective devices installed to react to abnormal electric system conditions and isolate from the interconnected

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	---	--------------------------------------

Distribution System to preserve the reliability of the distribution system. The following are specific Distribution System hazards requiring response:

- A. **Unintended Islanding:** A DER operating in parallel with the Company's Distribution System must also be equipped to detect another condition referred to as "unintended islanding." Unintended Islanding is the abnormal operating condition where a portion of the Company's Distribution System and loads become isolated from the remainder of the Distribution System while still connected to and receiving energy from one or more DERs within an electrical island. When unintentional islanding occurs, all DERs within the electrical island must be disconnected to prevent continued operation and damage to the connected loads.

The protective devices and other specified requirements are intended to provide protection against hazards associated with unintentional islanding by ensuring that DERs operating in parallel with the Company's Distribution System are disconnected when Abnormal Operating Conditions occur.

- B. **Loss of Phase:** A DER operating in parallel with the Company's Distribution System shall be equipped to detect a loss of any one phase for which an immediate shutdown is required. The DER shall have the ability to detect, cease to energize, and trip all phases to which the DER is connected for any open phase condition occurring directly at the Point of Common Coupling. The DER shall cease to energize and trip within 2.0 seconds of the open phase condition.
- C. **Loss of Synchronization:** Operation of the Customer's synchronous generator (or other DER) out of synchronization with the Company's Distribution System may cause large voltage fluctuations to other connected customers and may cause severe damage to the Customer's generator (or DER). In any situation in which a loss-of-synchronization (out-of-step) is likely to occur for a DER installation, a specific detection relaying scheme shall be required and implemented.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	---	--------------------------------------

## 1.2 How to Interpret and Apply the Standard

When reading this document, the following terms will be interpreted as defined:

**Shall:** Any requirement that uses the term "shall" is mandatory and strictly enforced.

**Should:** Any requirement that uses the term "should" indicates that options may exist, but that the requirement specifies the best engineering expertise as written, but such requirements are not mandatory.

**Recommend:** Any requirement using the term "recommend" has more than one option, and the Company prefers that the Customer use the option given, but such choice is up to the Customer's discretion.

**May:** Any requirement using the term "may" means the Customer has discretion.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

## 2.0 Definitions

**Abnormal Operating Conditions** – When the Company is operating the Distribution System in other than normal configuration or under conditions that do not normally exist. Examples of Abnormal Operating Conditions include: (1) peak load days when customers may be requested to conserve energy or, (2) switching feeders out of use for repairs and switching in alternate feeders to deliver energy to customers.

**Ampere (Amp):** The unit of measurement of the rate of flow of electricity. It is the unit of current produced in a circuit by one volt acting through a resistance of one ohm.

**Agreement for Service (or Contract):** The agreement between the Company and the Customer under which service is taken. Unless and until a written Agreement for Service has been signed, service rendered by the Company is subject solely to the provisions of the applicable Company's service regulations, policies, and applicable rate schedule and riders. The provisions of the Company's standard application or terms of service will be presumed to apply. The supplying and taking of such service shall constitute an Agreement for Service.

**Authority (Having Jurisdiction) ("AHJ"):** The organization, office, or individual responsible for approving equipment, materials, an installation, or a procedure. Among other things, the role of an AHJ is to verify that a Customer DER installation complies with the National Electrical Code ("NEC"), Company policies and procedures, and requirements imposed by Company's Retail Regulator.

**Central Business District ("CBD") Networks, Spot Networks and Downtown Underground Radially-Fed Installations:** Typically located in downtown areas in cities including New Orleans, Baton Rouge, Lake Charles, West Monroe, Beaumont, Jackson, Little Rock, Pine Bluff, and Hot Springs. The common CBD setup is to have two or more transformers, each connected to a separate feeder and paralleled on the low voltage side through network protectors associated with each transformer. These protectors are commonly configured so that a small amount of fault current (usually in the range of one Amp) will cause the protector to trip. Injecting energy with a DER will have a negative effect on reliability. Also see Network Service.

**Code:** National Electrical Safety Code ("NESC"), current edition and any other applicable Codes and governmental regulations, such as Occupational Safety and Health Administration (OSHA) live working clearance rules. Also, the NEC provides the basis for proper installation and maintenance of electrical systems for the general public to be kept free from hazards and is also the basis for Entergy's Customer Installation Standards for Electric Service.

**Company:** An individual regulated utility Operating Company subsidiary of Entergy Corporation, including its officers, agents, employees, successors, or assigns.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	---	--------------------------------------

**Contract:** See "Agreement for Service".

**Converter (or Power Converter):** An electrical or electro-mechanical device for converting electrical energy. It may be converting AC (single-phase) to AC (3-phase) or from DC to AC, or the voltage or frequency, or some combination of these.

**Current:** The rate of flow of electricity usually measured in amperes. The Company supplies alternating current (AC) and will not supply direct current (DC).

**Customer:** An individual, firm, partnership, association, corporation, organization, or governmental agency that is "taking service" as defined by the Company's Retail Regulator and that is seeking to interconnect and operate a DER. When used in lowercase form (i.e., "customer"), refers to all other Company customers who are not seeking to interconnect, but who may be operationally or otherwise affected by the requested interconnection.

**Customer's Facilities:** In general, all the wires, appliances, devices or apparatus of any kind or character on the Customer's side of the Point of Delivery (or PCC) except the meters, metering devices and facilities of the Company that may be located on the Customer's side of the Point of Delivery used in providing Service to the Customer. The Customer's wiring and electrical equipment within or on the premises shall be installed and maintained in accordance with all applicable building and wiring codes, and local laws and ordinances.

**Displaced Load:** The Customer's entire electrical requirement or a portion of it that, except for the utilization of the Customer's DER, would have been served by the Company.

**Distributed Energy Resource (DER):** Distributed-scale resources connected to the grid at distribution-level voltage; or to the transmission network interconnected directly to a substation at distribution voltage-level. DER may be further defined by Company's Retail Regulator.

**Distributed Generation (DG):** See Distributed Energy Resource.

**Distribution System:** The Company's wires, equipment, and facilities with a voltage below 69kV to which the DER is interconnected.

**Facility:** An electrical generating installation consisting of one or more on-site distributed generation units, which includes a standalone energy storage system or other similar application. The total capacity of a facility's individual on-site distributed generation units may exceed 20 MVA. Units greater than 20 MVA will require consultation with Transmission.

**Energy:** The total work done as distinguished from the rate of doing work (power), usually measured in kilowatt-hours ("kWh"). Its amount depends upon the power

<b>TITLE: Distributed Energy Resource Standards for Interconnection</b>	<b>STANDARD NUMBER: DR07-01, Rev. 17</b>	<b>EFFECTIVE DATE: 12/15/2019</b>
---	--	-----------------------------------

and the time that the power is taken. For instance, a power rate of one kilowatt maintained for one hour is one kilowatt-hour of energy.

**Generator:** a dynamo or similar machine for converting mechanical energy into electricity. Prime mover includes diesel/gasoline/natural gas-fueled combustion engines and turbines, hydroelectric turbine, steam turbine, wind, etc.

**Hertz:** Unit of frequency in cycles per second. For example, the Company furnishes 60 Hertz alternating current (AC).

**Induction Generator (or asynchronous generator)** is a type of alternating current (AC) electrical generator that uses the principles of induction motors to produce electric power. Induction generators operate by mechanically turning their rotors faster than synchronous speed.

**Interconnection:** The physical connection of a DER to the Company's Distribution System in accordance with the requirements of this standard so that parallel operation can occur.

**Interconnection Agreement:** The written executed document that sets forth the contractual conditions under which the Company and a Customer agree that one or more DERs may be interconnected with the Company's Distribution System.

**Interconnection Application:** A document prepared by the Customer (or their designated representative) to facilitate an Interconnection Agreement in which specific capabilities of a Customer's DER are identified along with requirements to support any parallel operations based on hosting capacity of the Company's Distribution System.

**Interconnection Facilities:** All facilities installed solely to interconnect and deliver/receive energy from/to the Customer's DER to/from the Company's system including, but not limited to, connection, transmission, distribution, engineering, administration, transformation, switching, metering, and safety equipment. Interconnection Facilities shall include any additions and/or modifications to the Company's Distribution System deemed by the Company to be necessary to reliably and safely interconnect the Customer's DER.

**Inverter:** Equipment that converts DC power to AC power. Includes auxiliary devices such as transfer switches, alternate source transformers and regulators, input rectifiers (other than battery chargers), and isolation devices (e.g., blocking diodes).

**Islanding:** A condition in which a portion of a Distribution System is energized solely by one or more interconnected DERs through the associated Point of Common Coupling(s) while that portion of the area Distribution System is electrically separated from the rest of the area distribution system.

<b>TITLE: Distributed Energy Resource Standards for Interconnection</b>	<b>STANDARD NUMBER: DR07-01, Rev. 17</b>	<b>EFFECTIVE DATE: 12/15/2019</b>
---	--	-----------------------------------

**Load:** The amount of electric power delivered or required by Customer at any specified point or points on the Company's Distribution System.

**Meter:** A device or devices together with auxiliary equipment used for measuring any of the following: apparent, real, and reactive power and/or energy, which are supplied to any Customer at a single Point of Delivery.

**Momentary Cessation:** A protective mode when no current is injected into the Distribution System by the inverter during low or high voltage conditions outside of its continuous operating range. This is accomplished by blocking the power electronics' firing commands and the inverter does not produce real or reactive current.

**Net Metering:** Refers to a policy implemented by the Company's Retail Regulator that addresses interconnection, operation, and treatment of a qualifying DER on the Company's Distribution System. Refer to the Company's website for additional information governing interconnection and operation of a DER that may be eligible for Net Metering.

**Network Service:** Two or more primary distribution feeder sources electrically tied together on the secondary (or low voltage) side to form one power source for one or more customers. This configuration is designed to maintain service to customers even after the loss of one of these primary distribution feeder sources.

**Ohm:** The unit of measurement of electrical resistance or impedance. It is that resistance through which one volt will produce a current of one ampere.

**On-site Distributed Generation (Distributed Generation or DG):** An electrical generating facility located at Customer's Point of Delivery (Point of Common Coupling) with a generating capacity of twenty MVA (called "apparent power") or less and connected at a voltage less than or equal to 34.5 kilovolts (kV), which may also be connected in parallel operation to the Company's Distribution System.

**Parallel Operation:** The operation of DG by a Customer while the Customer's facilities are electrically connected to the Company's Distribution System.

**Phase (or Number of Phases):** Term which designates characteristics of alternating current. It is a term used in the electric industry relating to the characteristics of the electrical service available or supplied at a given location or required for the operation of a given electrical device.

**Point of Delivery: (also called Point of Common Coupling or PCC):** The physical location where the Customer's service terminals or wires are joined to the Company's facilities or such other point specifically designated by written agreement.

**Power:** The time rate of doing work, generating, transferring, or using electric energy, usually expressed in kilowatts (kW).

<b>TITLE: Distributed Energy Resource Standards for Interconnection</b>	<b>STANDARD NUMBER: DR07-01, Rev. 17</b>	<b>EFFECTIVE DATE: 12/15/2019</b>
---	--	-----------------------------------

**Power Factor:** The ratio of real power (kW) to apparent power (kVA) for any given load and time. Normally, power factor is expressed as a ratio and stated as a percentage.

**Pre-Interconnection Study:** A study or studies that may be undertaken by the Company in response to its receipt of a completed Interconnection Application for interconnection and parallel operation with the Company's Distribution System.

**Protective Functions:** A system that uses hardware (including switching devices), relay protection schemes, and software to prevent unsafe operating conditions from occurring before, during, and after the interconnection of the DER with the Company's Distribution System. Protective Functions may include isolating the Customer's DER or decoupling it from the Company's Distribution System.

**Quality of Service:** An operating state of the Distribution System that provides usable power to a Customer. This state of usable power includes the parameters specified for voltage flicker, voltage surges and sags, power factor, frequency, and harmonics.

**Reactive-kilovolt-amperes (kVAR) (rkVA) (kilovar):** The product of the applied voltage and the magnetizing or charging current, divided by 1,000. Reactive-kilovolt-amperes do no work but must be supplied to magnetic equipment, such as motors. Generators or capacitors supply it.

**Retail Regulator:** The political subdivision or government entity vested with authority to oversee the rates and operations of Company, e.g., the Arkansas Public Service Commission, the Council for the City of New Orleans, the Louisiana Public Service Commission, the Mississippi Public Service Commission, or the Public Utility Commission of Texas.

**Sag (Voltage Sag):** A decrease in AC Voltage at the power frequency for duration of 0.5 cycles to 1 minute. Typical values are 0.1 to 0.9 per unit.

**Service (or Electric Service):** The availability of electric power and energy to the Customer, regardless of whether any power and energy is actually used. Supplying service by the Company consists of the Company maintaining at the Point of Delivery the approximate nominal voltage and frequency by means of facilities adequate for supplying the Customer's contracted load.

**Stabilized:** The Distribution System is considered stabilized when, following a disturbance, the system returns to the normal range of voltage and frequency for a duration of five minutes or a shorter time as mutually agreed to by the Company and Customer.

**Standard of Care:** A term defining the level of awareness to maintain workplace and public safety in the design, installation, and operation of a DER.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	---	--------------------------------------

**System Protection Facilities:** The equipment required to protect the Company's Distribution System and Customers from unsafe operating conditions occurring at the Customers' locations. This includes inverter systems and any other devices provided with a DER that provides system protection functions.

**Synchronous Generator (or alternator):** An electrical machine which converts the mechanical power from a prime mover into AC electrical power at a particular voltage and frequency.

**Transmission:** High voltage (69kV and above) lines and facilities which begin outside of the substation fence (may include 34.5kV lines serving industrial customers; these lines are considered to be transmission lines if they are under direct control of the Transmission Operation Centers.)

**Unsafe Operating Conditions:** A situation that, if left uncorrected, would result in: (1) harm to any Company personnel and/or the public, damage to any equipment, (2) unacceptable system instability or, (3) operating outside legally-established parameters affecting the quality of service to other customers connected to the Company's Distribution System.

**Uninterruptible Power Supply (UPS):** A device that provides battery backup AC power when the normal electrical power source fails or drops to an unacceptable voltage level.

**Volt / Voltage:** A unit of electrical pressure or potential or electromotive force which, if applied to a load of one-ohm resistance, will cause a current of one ampere to flow. Primary distribution and transmission voltages are usually designated in kilovolts (kV). One kilovolt is equal to 1,000 volts.

**Volt-Ampere:** kVA is 1,000 Volt Amperes (VA) and MVA is 1,000,000 VA. The unit of apparent power, volts times amperes, which is composed of both real and reactive power.

**Watt:** An electrical unit of power. Electrical appliances and lamps are rated in watts to indicate their capacity or rate of using power for doing work. For example, a 100-watt lamp used 10 hours will use one kilowatt-hour (kWh) of energy (1,000 watt-hours).

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.0 Details

#### 3.1 The Electrical Distribution System

The Distribution System supplies power to the Company's low voltage network customers from area substations at IEEE medium voltage levels of 4kV, 12.47kV, 13.2kV, 13.8kV, 23.9kV and 34.5kV (phase to phase) for primary service. Note: 69kV and above are considered by Company as Transmission System Voltages. The majority of retail customers receive IEEE low voltage service directly from the Distribution System secondary voltage levels of single-phase (120V and 240V) and three-phase (120/208V and 277/480V). Grounded four-wire distribution (phase to neutral connected loads) is the Company's standard.

#### 3.2 Multi-grounded Neutral Distribution Service

Generally, the following available multi-grounded neutral service is offered for interconnection:

- Single-Phase – 120/240 Volts, 3-wire
- 3-Phase – 120/208 Volts, 4-wire
- 3-Phase – 277/480 Volts, 4-wire
- 3-Phase – 2400/4160 Volts, 4-wire
- 3-Phase – 7200/12470 Volts, 4-wire
- 3-Phase – 7620/13200 Volts, 4-wire
- 3-Phase – 7970/13800 Volts, 4-wire
- 3-Phase – 13800/23900 Volts, 4-wire
- 3-Phase – 19900/34500 Volts, 4-wire

Consult the Company for further information on the availability of distribution voltages not listed.

#### 3.3 Types of Allowed Generators

Single-phase or three-phase alternating current generating units can be operated in parallel with the Distribution System. They may be synchronous generators, induction generators, or inverter-controlled systems. Direct-current generation shall not be directly connected to the Company's alternating-current Distribution System. Typical capacity groups are:

- 15 KVA or Less (and depending on Retail Regulator policy), Single Phase only
- Above 15 KVA to below 150 KVA, Single Phase (study required)
- 150 KVA to below 300 KVA, Three-Phase only (study required)
- 300 KVA to 20 MVA, Three-Phase only (detailed study required)

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	---	--------------------------------------

### **3.3.1 Limits on Single-Phase Generators**

Where necessary to avoid the potential for a generating facility to cause problems with the service of other customers, the Company may limit the capacity and operating characteristics of single-phase generators in a manner consistent with the Company's existing limitations for single-phase motors and local line equipment and configuration.

### **3.3.2 Limits on Three-Phase Generators**

If three-phase service is not available in the area or if Company facilities must be upgraded or increased in order to enable the Customer to connect to these facilities, the Customer must bear the additional cost for such service or improvements as determined by the Company and in conformance with applicable policy of the Company's Retail Regulator. The Company reserves the right to refuse three-phase service under certain circumstances.

### **3.4 Pre-Installation Information**

The Company can expedite service connection and minimize cost to both the Customer and the Company if the Customer consults the Company before the design phase of the installation has begun. The Company is not responsible for the cost of replacing any of the Customer's facilities that do not meet the requirements for service. Connection to the Company's Distribution System is not available prior to approval by the Company. The approval process may include, in addition to the execution of an Interconnection Agreement, the acquisition of permits and/or inspections by authorities having jurisdiction, including the Company's Retail Regulator. Consult the applicable Customer Installation Standards for more information.

### **3.5 Interconnection Agreement Required**

The Customer must execute an Interconnection Agreement with the Company and receive the Company's express written permission before operating a generating facility in parallel with the Company's Distribution System. The Company shall treat all interconnection requests in a non-discriminatory manner, on a first come – first serve basis relative to when the completed documentation was received and reviewed by Company for completeness. The Company shall not unreasonably withhold its permission for parallel operation of the Customer's generating facility with the Company's Distribution System.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.6 Pre-Interconnection Study

A study or studies may be undertaken by the Company in response to its receipt of a completed application for interconnection and parallel operation with the Company's Distribution System. These may include a meeting with the Customer (and/or its designated agent). The purpose of the meeting and studies is to determine if:

- Interference with the system protective equipment may occur;
- Electricity may flow back to the substation and impact transmission;
- Available fault current may be affected;
- Capacitor banks may be impacted;
- Frequency, and/or voltage may be affected under normal and worst-case situations; or
- Conductors/lines or other devices and elements must be resized or undergo settings changes as a result of the proposed interconnection.

If no impacts on the distribution or the transmission systems are identified, the proposed interconnection will be accepted and, depending on the desired operational configuration and relevant regulatory policy involved, Customer Relations will engage with the Customer to determine next steps. Otherwise, Customer Relations will share potential impacts and future studies necessary, quote estimated costs of the chosen study(ies) and possibly provide order of magnitude estimates on costs for necessary upgrades and the interconnection. If Transmission is to be involved to discuss this stage of the process with the Customer, then Customer Relations will have Transmission contact the Customer and discuss what policies and/or procedures are involved as well as what transmission facilities may be impacted.

Pre-Interconnection studies may include, but are not limited to:

#### 3.6.1 Scoping Meetings

- A fact-finding meeting/teleconference with Customer and discussion of Customer responsibilities and requirements and applicable policies. (Customer Relations and Asset Planning). Company to gather information of the Customer project (size, type, role, etc.).
- Determining the minimum information for attaching a Distributed Energy Resource at a particular location on the Distribution System or identifying the necessity of further engineering studies or determining if transmission involvement is necessary.
- Certified inverter-based generating facilities rated 15 kVA or less and located on radial distribution systems may be eligible for direct interconnection without the need for a complete Feasibility Study.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

- If the Company determines the interconnection request is eligible for direct interconnection, the application request shall be approved to proceed forward with the execution of an Interconnection Agreement.
- All other interconnection requests will be required to go through the Feasibility Study Initial Screening Review as well as any other supplemental reviews or studies as determined necessary.

### 3.6.2 Feasibility Study

- The Feasibility Study consists of technical screens and analysis grouped into two segments, the Initial Screening Review and the Supplemental Review Analysis.
- The Company requires a \$1,000 deposit for the Feasibility Study. The study is done at actual cost and the Customer is responsible for any additional cost (or refund) depending on the specific requirements involved.
- The Initial Screening Review addresses the following technical areas, including but not limited to:
  - Generator size and grounding
  - Generator installed location and line configuration
  - Line Penetration
  - Short Circuit Contribution and interrupt ratings
- The Supplemental Review Analysis will further analyze the following technical areas, including but not limited to:
  - Power Quality
  - Voltage
  - Maximum Line Penetration
  - Safety and Reliability
- The output of the Feasibility Study will determine if the proposed interconnection request can proceed forward with the execution of an Interconnection Agreement, require a System Impact Study be performed, or require a Facilities Study be performed.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.6.3 System Impact Study

- The System Impact Study is a detailed formal study intended to identify and detail the electric system impacts that would result if the proposed generating facility were interconnected without project modifications or electric system modifications, including identification of potential system upgrades required to allow the generating facility to interconnect to the Company's Distribution System.
- The System Impact Study will further analyze any potential impacts found within the Feasibility Study, and provide additional detailed analysis related to the following:
  - Power Flows
  - Voltage Deviations
  - Voltage Regulation/Tap Changers
  - Fault Protection and Coordination
  - Grounding and Overvoltage
  - Unintentional Islanding
  - Transfer Trip Analysis
  - Transmission Impacts
- Additional Transmission Engineering Design review is required for any interconnection request that could result in impact on the Transmission system. Consideration of Transmission impact is required for Cases 4 through 7 with any interconnection request for a generator in excess of 5 MVA. Company reserves the right (depending on the specific circumstances involved) to consider Transmission impact for any size generator.
- The Company requires a \$20,000 deposit for the System Impact Study. The study is done at actual cost and the Customer is responsible for any additional cost (or refund) depending on the specific requirements involved.
- The output of the System Impact Study will determine if the proposed interconnection request can proceed forward with the execution of an Interconnection Agreement, or require a Facilities Study be performed based on the system upgrades and interconnection facilities identified by the System Impact Study.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### **3.6.4 Facilities Study**

- A Facilities Study is an extensive study detailing the electric system infrastructure and the impacts to the Transmission and/or Distribution systems that would result if the proposed interconnection request were connected without project modifications or electric system modifications.
- This study shall specify and estimate the cost of the equipment, engineering, procurement and construction work (including protection) needed to implement the conclusions of any System Impact Study(ies).
- The Company requires a deposit of the good faith estimated costs for the Facilities Study as determined by the Company. The study is done at actual cost and Customer is responsible for any additional cost (or refund) depending on the specific requirements involved.

### **3.7 Required Drawings**

Adequate drawings of the Customer's proposed generation facility, which will include a one-line diagram and proposed relay systems, must be submitted to the Company for review during the planning stage. Additional drawings may be required on a case-by-case basis.

### **3.8 Allowable Tie Points**

Normally, only one tie point between the Customer and the Company will be allowed at the Customer's location with any required communication available for utility interconnection at the Point-of-Common Coupling.

### **3.9 Central Business District Networks**

The Company will not allow interconnections involving parallel operation of DERs in Central Business District Underground Secondary Networks and Spot Networks. In Central Business District Underground Secondary Networks and Spot Networks, the installation of a generator could have a negative effect on electric power quality and reliability and the safety of employees that maintain these systems. This policy will affect all Underground Secondary Networks and Spot Networks installations including those in New Orleans, Baton Rouge, Lake Charles, West Monroe, Beaumont, Jackson, Little Rock, Pine Bluff, and Hot Springs. Note: backup generation is allowed only if it complies with the requirements of Cases 1, 2, or 3 and the back-up generator NEVER exports power onto the Company's Distribution System.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### **3.10 General Interconnection Requirements**

The Customer's generation facilities shall meet the technical requirements as prescribed in this section and in the latest revision of IEEE 1547. Review of Customer equipment by the Company can be performed to determine acceptability due to revisioning in the latest versions of Underwriters Laboratories (UL) 1741-SA and IEEE 1547.

### **3.11 Customer's Equipment and Interconnection Standards**

The Customer's generation and interconnection installation must meet all applicable national, state, and local construction and safety codes.

The Customer shall be responsible for the design, installation, operation, testing and maintenance of all equipment and facilities installed or that will be installed on the Customer's side of the Point of Common Coupling. Such design shall meet the latest standards of IEEE, National Electrical Manufacturers Association (NEMA), American National Standards Institute (ANSI), NEC, FERC, or other national codes and any local codes pertaining to the design and construction of electrical facilities. The Customer's generation shall be subject to the requirements of all authorities having jurisdiction and shall comply with all applicable codes and ordinances.

### **3.12 Rating of Customer's Equipment**

The equipment selected by the Customer for interconnection shall be rated for continuous operation with the Company's Distribution System.

### **3.13 Protection of Customer's Equipment**

The Customer will be responsible for protecting its generating equipment in such a manner that distribution delivery system outages, short circuits or other disturbances, including zero sequence currents and ferroresonance over-voltages, do not damage the Customer's equipment. The Customer's protective equipment shall also prevent unnecessary tripping of the Company's Distribution System breakers that would affect the Company's Distribution System's capability to provide reliable service to other Company customers.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### **3.14 Manually-Operated Load Break Switch / Reasons for Disconnect from the Company's Distribution System**

Unless otherwise directed by the applicable Retail Regulator, the Customer's generation facilities shall have a lockable, manually-operated, visible-break isolation load break switch that shall be in a location accessible to the Company's personnel at all hours with no notice. (Pull-out type switches are not accepted). For a three-phase generator, this disconnect must be a group-operated device that through one operation will open/close all three phases simultaneously. Customer shall label meter can with type and size of generator with arrow pointing to it stating distance to disconnect. (Example 300kVA Gas engine generator, 3 ft.⇒) Permanently attached tags are required. The lettering on each tag shall be 3/16 inch or larger and be either raised or incised on each tag. Each tag shall be riveted or glued to the meter can. If the circuit breaker is accessible to Company personnel, this requirement may be waived. The Company reserves the right, but has no responsibility either actual or implied, to open the disconnect switch without prior notice to the Customer for any of the following reasons:

- A. Distribution System emergency,
- B. Routine maintenance, repairs, and modifications,
- C. Elimination of a safety hazard, protection of the public or on-site personnel, or if instructed to do so by public safety personnel (law enforcement, fire department, or other governmental personnel),
- D. Inspection of Customer's generating equipment and protective equipment reveals a hazardous condition, a lack of scheduled maintenance or maintenance records,
- E. The operation of the Customer's generating equipment results in a deteriorated quality of service or safety issue with other Customers or with the operation of the Company's Distribution System, or

The Company may disconnect a Customer's generation unit from the Company's Distribution System under the following conditions:

- F. Expiration or termination of interconnection agreement
- G. Non-compliance with the technical requirements
- H. Lack of approved application and Interconnection Agreement
- I. Unauthorized modifications to the Customer's interface equipment.

When possible, the Company shall provide the Customer with reasonable notice and reconnect the Customer as quickly as reasonably practical.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.15 **Remotely-Operated Load Break Switch / Reasons for Disconnect from the Distribution Delivery System**

Unless otherwise directed by the applicable Retail Regulator, the Company reserves the right to require the Customer's generating facility to be isolated from the Company Distribution System through a dedicated remotely-operated load-break switch. The remotely-operated load-break switch shall either be provided by the Company at the Customer's expense, purchased from the Company by the Customer, or purchased from a third party and conform to the Company's specifications. The purpose of the dedicated remotely-operated load-break switch is to (i) remotely isolate the generating facility at the Point of Common Coupling to avoid any severe power condition that could result in any negative consequence back onto the Company's Distribution System, transmission system, and/or other customers, and (ii) provide any operational support.

This remotely-operated load-break switch shall have the capabilities for communication of telemetry data along with receiving and responding to transfer-trip signals from the substation while isolating upon demand. The device shall be capable of establishing communication (i.e., SCADA) over existing company networks via fiber connection, radio, cellular, or Wi-Fi.

**Typical Application:** Remotely-Operated Isolated Device (i.e., Reclosure) is used for protection coordination within the Company's Distribution System design to guard against any negative results from active generators following the loss of the power grid. Situational examples include, but are not limited to:

- Unintentional islanding from generator providing back-fed power onto the Company's Distribution System that could result in damage to other connected customers' equipment.
- Excessive voltage transformations from generator providing undesired back-fed power onto the transmission system that could result in damage to Company-owned equipment.
- Any interconnection request in which the total proposed generator capacity (including any previously-approved interconnections) would exceed the minimum projected daytime running feeder load.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.16 Direct Transfer Trip

As stated above, the Company reserves the right to require the Customer's generating facility to be isolated from the Company's Distribution System through a dedicated remotely-operated load-break switch. Only Direct Transfer Trip signal from the Company's Distribution System to the Customer shall be allowed for isolation protection. Any isolation protection installed by the Customer shall only operate the Customer's internal dedicated load-break device in isolating the Customer's generating equipment from the Company's Distribution System.

#### Typical Application:

- Generator or other DER with capacity greater than the minimum daytime loading of the connected distribution circuit.
- Generator or other DER with capacity greater than 50% of the total capacity of the connected distribution circuit.

### 3.17 Customer's Owned Systems

Generation systems owned and managed by the Customer shall have no maintenance agreement with the Company for equipment including the step-up transformer supplied by the contracted vendor. The Customer shall perform periodic maintenance as necessary on Customer-owned and operated circuit breakers, relays, transformers, generators, inverters, batteries, and other equipment to meet the Company's specifications unless the manufacturer recommends a more frequent schedule for maintenance.

In the event it is necessary for the Customer to disconnect from Company service, the Customer shall notify the Company of the planned disconnection in advance of the disconnection. When interconnecting another Customer or other work such as routine maintenance will interrupt service to a Customer, the Company will contact the Customer to arrange a mutually-agreeable time, if possible, for such Company work to be performed. When interruption of service is required that impacts Customer, service will be restored as quickly as possible.

### 3.18 Company Partnerships or Company-Owned Systems

All new generators proposed to be interconnected to the Company's Distribution System regardless of size shall operate at the following generally available standard output voltage transformations (+/- 5% from the following nominal):

IEEE Offered Low Voltages:

Single-Phase Voltage: 120V or 240V

Three-Phase Voltage: 208V or 480V with 480V preferred.

IEEE Offered Medium 3-Phase Voltages:

4160V, 12.47kV, 13.2kV, 13.8kV, 23.9kV, or 34.5kV

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.19 Transformation Requirements

Customer is encouraged to contact the Company early in the process and learn about Customer-specific requirements due to the Customer's location (or desired point of interconnection) on the Distribution or Transmission System. Customer may call 1-800-ENTERGY to get a local engineer assigned.

Step-Up Transformer Winding Standard is Wye-Wye. System Impact Study at a minimum is required for Wye-Delta, Delta-Wye, or Delta-Delta Transformer winding configurations.

If Customer's existing generation facilities need additional transformation, a different grounding system, or other upgrades, the Customer shall be required to design, pay for, and maintain all upgrades necessary to comply with Company's interconnection standards and other policies.

The Customer's grounding, transformer, relaying, and generator system shall be designed to handle the normal imbalance on the Company's Distribution System.

The Customer's additional generation-related transformation and other facilities should be owned, operated and maintained by the Customer. At the Company's option, a standard Company-specified transformer / transformer bank may be provided at the Customer's expense.

For Cases 3 through 7, the Customer shall monitor the Company's Distribution System and react based upon specifications in this Standard. Grounded Wye to Grounded Wye transformers are preferred with no impedance or resistance grounds.

System Impact Studies are required to design/specify a monitoring method (transfer trip or another method of reading the Company distribution feeder) if:

- Zero sequence path isolation occurs, some examples of which follow:
  - Impedance/resistance grounds limit fault current and fault signal.
  - Ungrounded connections/ configurations between the Customer's generator and the Company may not consistently detect faults on the Company's Distribution System.
- Delta configurations exist because they:
  - balance the Company's Distribution System load per phase, making the feeder difficult to monitor
  - may be ungrounded.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.20 **Dedicated Distribution Transformer**

The Company reserves the right to require the Customer's generating facility to interconnect to the Company Distribution System through a dedicated transformer. The transformer shall be provided by the Company at the Customer's expense, purchased from the Company by the Customer, or purchased from a third party if it conforms to the Company's specifications. The purpose of the dedicated transformer is to confine the Point of Common Coupling away from existing load and/or generation to support independent isolation and operational support.

### 3.21 **Grounding**

All generators 1 MVA and larger must have ground mats that shall be designed in accordance with good engineering practice per IEEE 80 "Guide for Safety in AC Substation Grounding." If local governmental requirements are more stringent (e.g., building codes), those requirements shall prevail. Customer shall perform appropriate tests, including soil resistivity test, to demonstrate that their ground grid design meets the standard. Mats should be tested at regular intervals to ensure their effectiveness.

### 3.22 **General Equipment Design and Operating Requirements**

From the perspective of interconnection, there are four main types of generation systems that interface to the distribution or transmission system. These include:

- Induction Generators (e.g., Combustion Engine-Driven, Hydro, Wind)
- Synchronous Generators (e.g., Flywheel, Motors, Motor-Generators)
- Static Power Converters (Inverters, Static Converters)
- Battery Storage (Inverter-Charger units)

Each type has its own specific characteristics regarding synchronization equipment, protective functions, starting practices, and electrical operating behavior. Whether the generation is a dynamo machine (i.e., windings) or electro-static (i.e. SCRs/diodes), there are specific common interface requirements that will always apply. There may also be additional specific requirements that may be identified as part of any study (or studies) conducted by the Company for a specific Customer location. Generating facilities operating in parallel with the Company's Distribution System shall be equipped with the following load control functions:

- Voltage and frequency ride-through
- Soft-start reconnection
- Ramp-rate controls
- Constant power factor mode
- Voltage-reactive power mode
- Active power-reactive power mode
- Constant reactive power mode

<b>TITLE: Distributed Energy Resource Standards for Interconnection</b>	<b>STANDARD NUMBER: DR07-01, Rev. 17</b>	<b>EFFECTIVE DATE: 12/15/2019</b>
---	--	-----------------------------------

- Updated unintentional-islanding requirements when disconnected from parallel operations (excludes Synchronous Generators designed for extended ride-through loading)  
The following unintentional-islanding detection methods are approved by the Company:
  - Active: frequency shift
  - Hybrid: rate of change of frequency
- Communication
- Telemetry data
- Remote shutdown command capability
- All communication interfaces shall be available at the PCC.
- Under-voltage time delay for loss of power backup loading in support of designed reclosing (i.e., Reclosure) cycling
- Reclosing lockout during parallel operations to block loss of synchronization (out-of-step) condition (excludes Synchronous Generators designed for extended ride-through loading)
- Loss of phase detection

### 3.22.1 General Equipment Protection Requirements

From the perspective of smart inverter functions, the following features shall be active in the priority listed unless otherwise defined by a Company-performed study:

1. Volt-VAR management
2. Volt-Watt
3. Soft Start
4. Constant power factor (1 MVA or greater)

**TITLE: Distributed Energy Resource Standards for Interconnection**



**STANDARD NUMBER: DR07-01, Rev. 17**

**EFFECTIVE DATE: 12/15/2019**

### 3.22.2 Typical Volt/VAR Curves

Regarding smart inverter functions, the following Volt/VAR Curves should be established unless provided within a detailed study from the Company:

Typical Volt/VAR Settings for Interconnections			
Express Feeder		Existing Feeder	
Point	Values	Point	Values
P1	(0.95, 1)	P1	(0.95, 1)
P2	(0.98, 0)	P2	(0.98, 0)
P3	(1.04, 0)	P3	(1.02, 0)
P4	(1.15, -1)	P4	(1.10, -1)

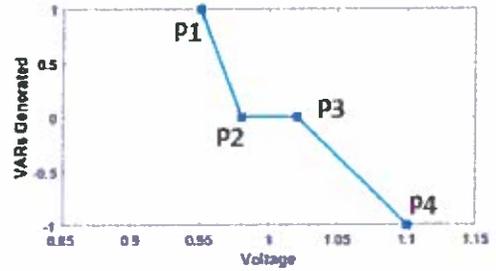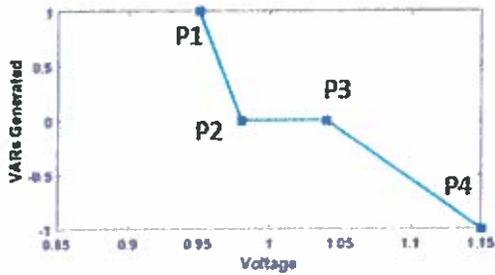

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	---	--------------------------------------

### 3.22.3 Typical Types of Generation Systems

The following sub-sections describe the four main types of interconnected generation systems, which include figures that illustrate typical installation for equipment protection. These are the legends for IEEE device numbers referred to in the figures:

#### Legend

##### **Protective Device Numbers and Description**

- 2 - Time Delay Starting or Closing Relay
- 7 - Rate of Change Relay
- 24 - Volts per Hertz Relay
- 25 - Synchronizing or Synchronization Check Relay
- 27 - Under-voltage Relay
- 29 - Isolating Contactor or Switch
- 31 - Separate Excitation
- 32 - Power Direction Relay
- 40 - Loss of Field Detection Relay
- 46 - Reverse-phase or Phase-Balance Current Relay
- 47 - Voltage Phase Sequence Relay
- 50 - Instantaneous Overcurrent (Breaker Failure) Relay
- 51 - Time Over-current Relay
- 52 - AC Circuit Breaker
- 59 - Over-voltage Relay
- 60 - Voltage or Current Balance Relay
- 64 - Ground Detector Relay
- 67 - Voltage Restrained/Controlled Directional Time Overcurrent Relay
- 78 - Loss of Synchronization (Out-of-Step) Relay
- 79 - Reclosing Relay
- 81 - Over/Under-frequency Relay
- 85 - Communications, Carrier or Pilot-Wire Relay
- 87 - Differential Protective Relay


**NOTE:** for additional information on device number, refer to ANSI C37.2.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.22.3.1 Induction Generators

All new interconnected generators having suitable systems must comply with the Company's minimum operating reliability criteria for governor droop.

These requirements are necessary to provide an equitable and coordinated system response to load/generation imbalances. Governor droop typically ranges between 3% and 5% without excessive dead-bands and will be established based on designed study requirements.

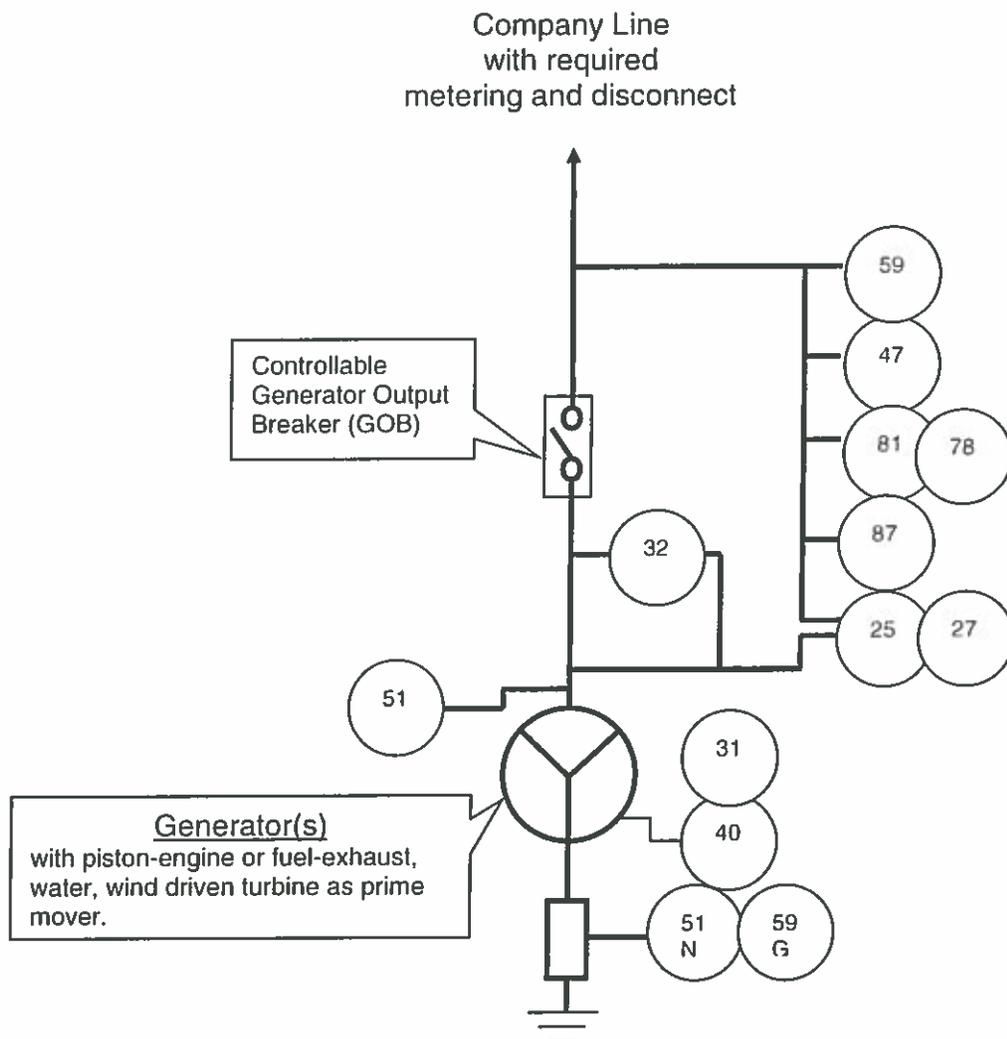


TITLE: Distributed Energy Resource Standards for Interconnection	STANDARD NUMBER: DR07-01, Rev. 17	EFFECTIVE DATE: 12/15/2019
--	-----------------------------------	----------------------------

### 3.22.3.2 Synchronous Generators

Synchronous Generators are to remain in-service during system faults (three-phase faults with normal clearing and single-line-to-ground with delayed clearing) unless clearing the fault effectively disconnects the generator from the system. During the transient period, the generator is required to remain in-service for the low voltage and frequency excursions as specified in the design requirements. The Generator may be tripped after the fault period if this action is intended for direct equipment protection.

A separately excited excitation system is also required on these synchronous generators for additional reactive power (VAR) support during normal parallel/synchronous operation.

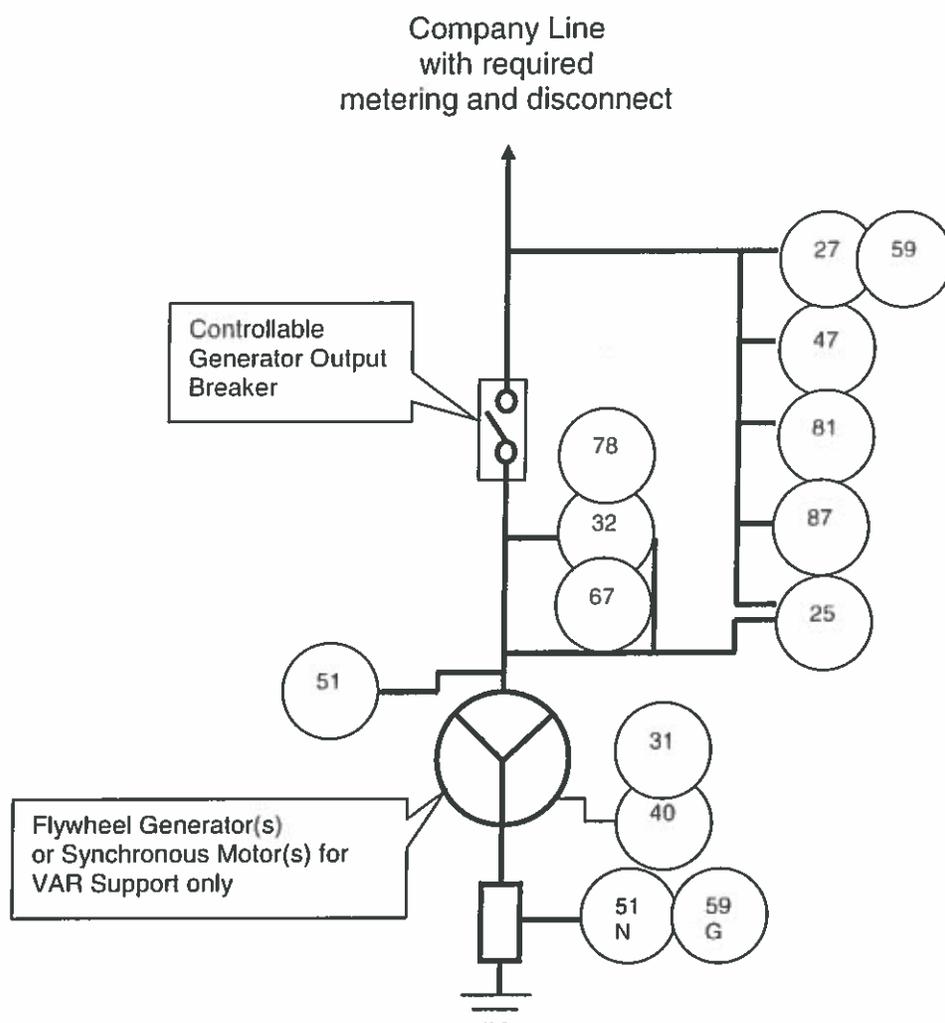


TITLE: Distributed Energy Resource Standards for Interconnection	STANDARD NUMBER: DR07-01, Rev. 17	EFFECTIVE DATE: 12/15/2019
--	-----------------------------------	----------------------------

### 3.22.3.3 Static Power Converters / Inverter Technology

All electro-static power generation systems must use a smart inverter that complies with testing protocol UL 1741-SA and IEEE 1547 latest version. Functions of compliant inverters are noted in the above section: **General Equipment Design and Operating Requirements**; however, the following additional procurement requirements shall be included:

- UPS grade inverters requiring no additional filtering that support direct connection to breaker/fuse-protected loads or a standard distribution class Wye-Wye Transformer winding.

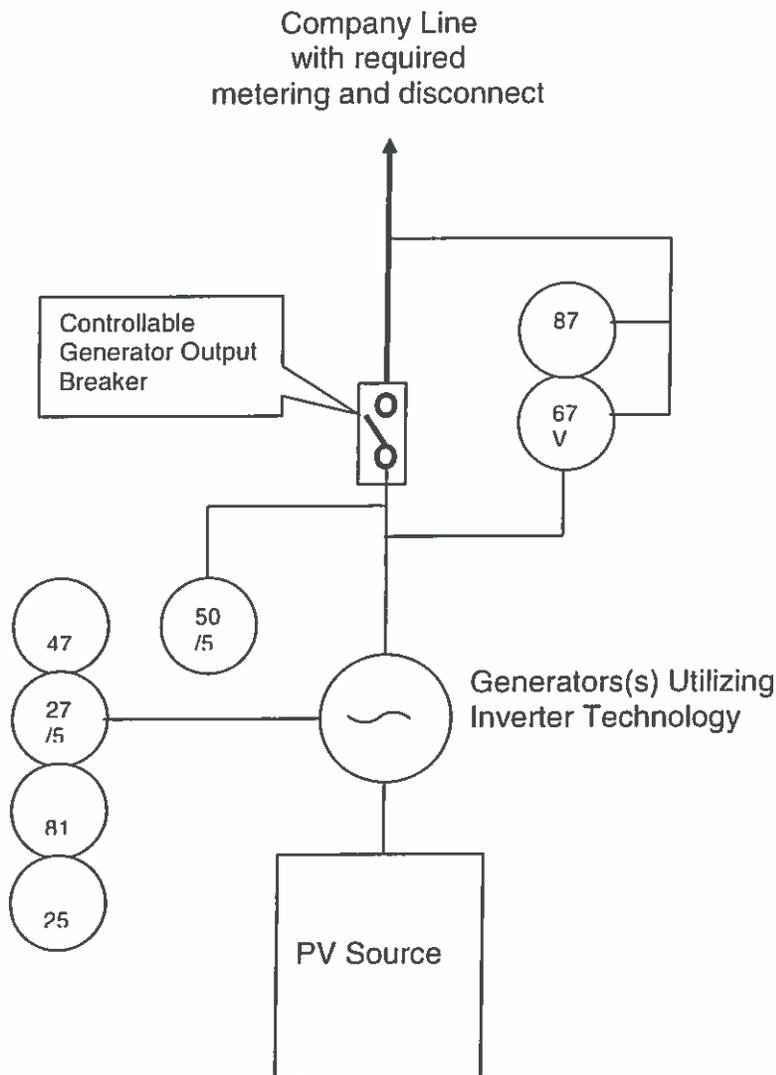


TITLE: Distributed Energy Resource Standards for Interconnection	STANDARD NUMBER: DR07-01, Rev. 17	EFFECTIVE DATE: 12/15/2019
--	-----------------------------------	----------------------------

### 3.22.3.4 Battery Storage System using Inverter Technology

All typical Battery Storage Systems will use Inverter Technology; therefore, smart inverter functions shall be applied that complies with testing protocol UL 1741-SA and IEEE 1547 latest version. Functions of compliant inverters are noted above within the section: **General Equipment Design and Operating Requirements**; however, the following additional procurement requirements shall be included:

- UPS grade inverters requiring no additional filtering that support direct connection to breaker/fuse-protected loads or a standard distribution class Wye-Wye Transformer winding.

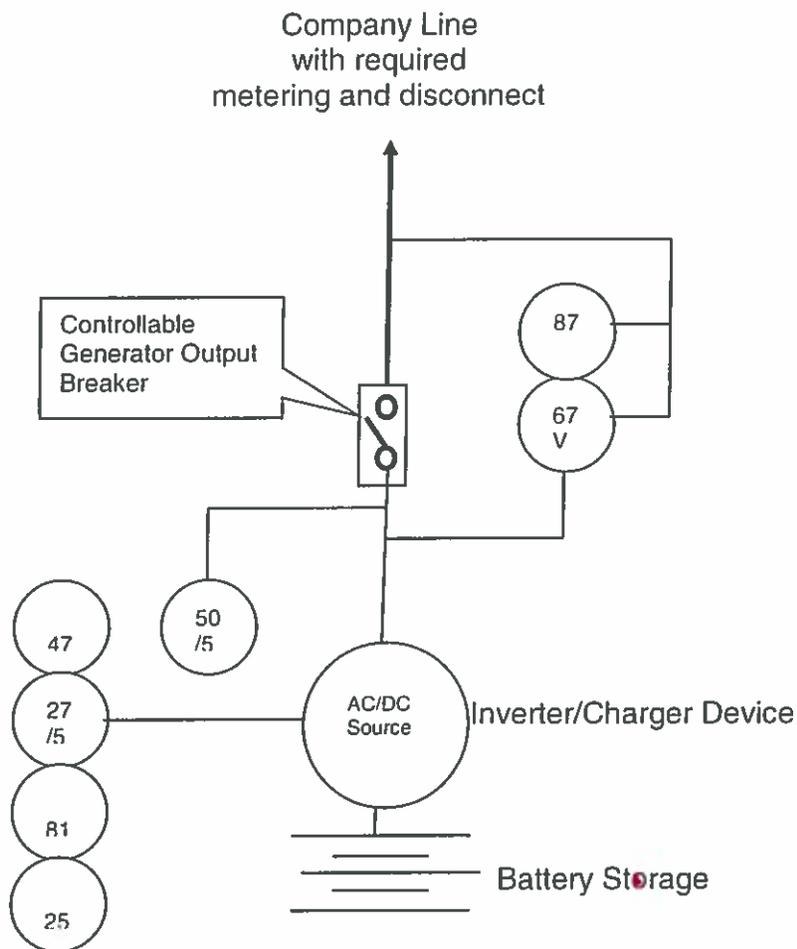

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### **3.23 Synchronizing Requirements**

The Customer shall be solely responsible for synchronizing and properly connecting and disconnecting its electrical system relative to parallel operation with the Company's Distribution System in accordance with the latest version of IEEE 1547. The Customer shall provide an automatic or semi-automatic synchronizing scheme to prevent the closing of its circuit breaker when the two electrical systems are out of synchronization.

### **3.24 Power Quality Parameters**

Standard DZ02-04 "Power Quality Standards for Electrical Service" provides general guidelines on the quality of power a Customer can expect to receive at the point of delivery. Additionally, Standard DZ02-04 lists the restrictions the Company places upon the electrical distortion allowed on the power system that may be caused by a Customer's equipment. These requirements help ensure that the Company's and other customers' equipment will not be adversely impacted by a new Customer's generator or an existing Customer's planned expansion.

The Company should be consulted early in the design phase for new installations and load additions to address specific installation requirements for new facilities and planned expansions.

### **3.25 Energy Flow During Emergencies**

Purchases of energy from or sales of energy to a Customer during periods of system emergencies may be discontinued according to the Retail Regulator's applicable rules and policies, and the Company's rates, riders, and/or contract with the Customer.

### **3.26 Power Factor**

The power factor of the Customer's generation facilities at the interconnection point with the Company shall be maintained according to the applicable rate schedule for the Customer's installation.

### **3.27 Reactive Power Requirements**

The Customer's generation facility shall be capable of injecting reactive power (over-excited) and absorbing reactive power (under-excited) for active power output levels greater than or equal to the minimum steady-state active power capability or per the latest version of IEEE 1547 rated active power, whichever is greater. Should the Customer be unable or unwilling to supply the reactive power, a separate rate schedule shall apply, and the installation shall be metered for VAR flow.

**TITLE: Distributed Energy Resource  
 Standards for Interconnection**

**STANDARD NUMBER:  
 DR07-01, Rev. 17**

**EFFECTIVE DATE:  
 12/15/2019**

### 3.28 Voltage Surges or Sags

The Customer will operate its generating equipment in such a manner that the voltage levels on the Company's Distribution System are in the same range as if the generating equipment were not connected to the Company's Distribution System. The Customer shall be liable for any damages done to their own facilities, the Company's facilities, or the facilities of other Customers due to any under voltage or over voltage contribution from the Customer's equipment.

The Customer shall provide an automatic method of disconnecting the generating equipment from the Company's Distribution System in accordance with Table 11, IEEE Std 1547 latest version.

Shall TRIP – Category I				
Shall TRIP Function	Default Setting		Ranges of allowable Settings	
	Voltage (pu of nominal voltage)	Clearing Time (s)	Voltage (pu of nominal voltage)	Clearing Time (s)
OV2	1.20	0.16	Fixed at 1.20	Fixed at 0.16
OV1	1.10	2.0	1.10 – 1.20	1.0 – 13.0
UV1	0.70	2.0	0.0 – 0.88	2.0 – 21.0
UV2	0.45	0.16	0.0 – 0.50	0.16 – 2.0

Shall TRIP – Category II				
Shall TRIP Function	Default Setting		Ranges of allowable Settings	
	Voltage (pu of nominal voltage)	Clearing Time (s)	Voltage (pu of nominal voltage)	Clearing Time (s)
OV2	1.20	0.16	Fixed at 1.20	Fixed at 0.16
OV1	1.10	2.0	1.10 – 1.20	1.0 – 13.0
UV1	0.70	10.0	0.0 – 0.88	2.0 – 21.0
UV2	0.45	0.16	0.0 – 0.50	0.16 – 2.0

Shall TRIP – Category III				
Shall TRIP Function	Default Setting		Ranges of allowable Settings	
	Voltage (pu of nominal voltage)	Clearing Time (s)	Voltage (pu of nominal voltage)	Clearing Time (s)
OV2	1.20	0.16	Fixed at 1.20	Fixed at 0.16
OV1	1.10	13.0	1.10 – 1.20	1.0 – 13.0
UV1	0.88	21.0	0.0 – 0.88	21.0 – 50.0
UV2	0.50	2.0	0.0 – 0.50	2.0 – 21.0

Voltage ride-through requirements for abnormal operating performance shall be in accordance with the latest version of IEEE Std 1547.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.29 Voltage Flicker, Harmonic Distortion, Transients and other Power Quality Issues

The Customer's generator shall not create objectionable flicker, Harmonic Distortion, Transients, etc. for the Company's other Customers. The Customer should also consult Company's Power Quality Standards for Electric Service, the latest edition available on the Company web site at [www.entergy.com](http://www.entergy.com). The Customer should select the appropriate state, then "Your Business", and the Builder Standards.

#### Minimum Individual DER Flicker Emission Limits (IEEE Std 1547)

Epst	Eplt
0.35	0.25

95% probability value should not exceed the emission limit based on a one-week measurement period.

### 3.30 Frequency

When the operating frequency of the Customer's generating equipment deviates from the 60 Hz base, the Customer shall automatically disconnect the generating equipment from the distribution delivery system based upon the table below:

DER Response (shall TRIP) to Abnormal Frequencies:

Shall TRIP – Category I, II, and III				
Shall TRIP Function	Default Setting		Ranges of allowable Settings	
	Frequency (Hz)	Clearing Time (s)	Frequency (Hz)	Clearing Time (s)
OF2	62.0	0.16	61.8 – 66.0	0.16 - 1000
OF1	61.2	300.0	61.0 – 66.0	180.0 – 1000
UF1	58.5	300.0	50.0 – 59.0	180.0 – 1000
UF2	56.5	0.16	50.0 – 57.0	0.16 – 1000

Frequency ride-through requirements for abnormal operating performance shall be in accordance with the latest version of IEEE Std 1547.

### 3.31 Specifying Protective Equipment

The Company will have the right to specify certain protective devices, including relays and circuit breakers that the Customer must install. The Company will specify all relay settings on the intertie. Settings of interconnection protective devices on the Customer's system will be specified by the Customer, but will be checked, coordinated with, and reviewed by the Company before application and subsequent modification.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.32 Common Protection Requirements

Generating facilities operating in parallel with the Company's Distribution System shall be equipped with protective devices that will sense abnormal conditions on the Company's Distribution System and will cause the generating facility to automatically disconnect from the Company's Distribution System or will prevent the generating facility from being connected to the Company's Distribution System inappropriately. The Customer's equipment shall be capable of automatically disconnecting the generation upon detection of an islanding condition and upon detection of a Company Distribution System fault. These protective functions include:

- 1) Over- and under-voltage trip functions and over- and under-frequency trip functions;
- 2) A voltage and frequency sensing and time-delay function that will prevent the generator from energizing a de-energized Company Distribution System circuit and will prevent the generating facility from reconnecting with the Company's Distribution System unless the Company's Distribution System service voltage and frequency is within Company's "Power Quality Standards for Electrical Service" (DZ02-04).
- 3) A function to prevent the generating facility from contributing to the formation of an Unintended Island and cease to energize the Company's Distribution System within two seconds of the formation of an Unintended Island.
- 4) A loss of phase trip function.
- 5) Either a ground over-voltage or over-current trip relay scheme depending on the grounding system as specified by the Company.

The protection and control scheme shall be designed to ensure that the generator remains in operation when the frequency and voltage of the Company Distribution System are within the specified limits. Upon request from the Company, the Customer shall provide documentation detailing compliance with the specified operating ranges.

Unless otherwise directed by the applicable Retail Regulator, the generator will have, as a minimum, an automatic disconnect device(s) sized to meet all applicable local, state, and federal codes and operated by over and under voltage, and over- and under-frequency protection. For three-phase installations, the over- and under-voltage protection shall be included for each phase and the over- and under-frequency protection shall be required. All phases of the generator or inverter interface shall disconnect or cease export of power when directed by the protective devices. Voltage protection shall be wired according to the type of Distribution System ground. The Company will notify the Customer on the appropriate sensing arrangement based on the configuration of the Company Distribution System at the Point of Common Coupling.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### **3.33 Protection/Interface Requirements**

Protecting both the Customer's facilities and the Company's facilities is of great importance. Proper protective systems shall be established in the design phase and confirmed prior to start-up of the Customer's generator. **An interconnection between the Company and the Customer will not be allowed prior to the proper coordination of protective devices.** The Customer shall be responsible for providing to the Company the necessary documentation certifying that maintenance and testing have been satisfactorily performed.

### **3.34 Service Interruption Equipment**

Circuit breakers or other interrupting devices at the Point of Common Coupling must be capable of interrupting maximum available fault current. If facilities are larger than 1MVA and an inverter or similar system is used, consult the Company for additional requirements.

### **3.35 Fault Interrupting Device**

A fault-interrupting device must be installed at the point of intertie between the Company and the Customer. The device could be single-phase fuses with a group operated load break switch or a three-phase breaker. The choice will be the Company's and will be made on a case-by-case basis depending on location, available fault current, and size of the Customer's generator.

### **3.36 Susceptibility to Transmission Faults**

A Customer connected to the Company's Distribution System might be affected by faults occurring on the Company's transmission system. As necessary, a member of the Company's System Protection Department may review the proposed interconnection to make recommendations concerning the Customer's susceptibility to transmission faults.

### **3.37 Changes to Company Fault Interruption Equipment**

A generator source on the Distribution System will provide an additional source of fault current to the Company's distribution system. It is possible that the Customer's contribution will require the existing coordination of fault interrupting devices on the distribution feeder be changed. The Customer will be responsible for the cost of these changes to the Company's distribution system. It is also possible that the Customer's contribution will increase the available fault current on the Company's Distribution System beyond the interrupting capability of the existing devices on the Company's distribution system. The Customer may be required to limit their fault current. Should the Company also be required to make changes, the Customer shall pay the cost of the required changes. These issues will be examined on a case-by-case basis.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### 3.38 **Equipment to Block Energizing Dead Circuits**

**Under no condition will the Customer be permitted to energize a non-energized Company distribution circuit.** Equipment to effectively block the Customer from energizing a non-energized Company circuit shall be installed.

### 3.39 **Communication Criteria for Requiring Telemetry**

Communication protocols shall be in accordance with IEEE Std 1547 latest version with any interface made available at the Point of Common Coupling that meets the DER communication interface and cyber security requirements as specified within this document.

Telemetry requirements will be based on the cases described under **Interconnection "Case" Type based on the following capacity requirements:**

1. Cases 1 through 4, no telemetry will be required.
2. Cases 5 and 6 may or may not require telemetry depending on the output of the Customer's generating facility.

All generators connected in parallel to the Company's Distribution System will require real-time monitoring in which the Customer shall be responsible for complying with all telemetry requirements.

- A. For any Customer installation with capacity greater than 1 MVA, but less than 10 MVA:

The Customer shall furnish a telephone number that is manned during all hours of operation where the Company dispatcher can contact the Customer in the event of trouble on the distribution circuit serving the Customer. Cellular and other wireless communication systems shall be allowed in lieu of standard wired or fiber linked communications, since this telemetry/transfer trip feature supports a backup function.

The Company **may** require a dedicated telephone circuit at the site of the Customer's intertie to provide communication with the Company based on evaluation requirements.

- B. For any Customer installation with capacity 10 MVA or greater:

The Company and the Customer shall maintain operating communications at the Customer's expense with the Company's system dispatcher or the designated representative. The operating communications shall include, but not be limited to, system paralleling or separation, scheduled and unscheduled shutdowns, equipment clearances, and hourly and daily load schedules and reports.

An RTU (Remote Terminal Unit) shall be installed by the Customer to gather accumulated and instantaneous data to be telemetered

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

to a specified Company control center. The Company shall approve the RTU and its configuration. Instantaneous analog Watt flow and VAR flow information and breaker/switch status must be telemetered directly to the Company's Distribution Operations Center. These signals will display the current status of the generation facility. Additionally, these signals will be used as input to the Company's control center computer system. These inputs could assist the Company in making decisions on economic dispatch for optimum system operation. Additional programs within the control center computer system will use the input data to assist in numerous other areas of system operation, such as load forecasting, generation scheduling and maintenance, contingency analysis, and training.

Voice communication requires local Person of Contact for Customer's System.

Aggregate Generation Facility Size	Real Time Telemetry	Voice
1 MVA and above, but below 10 MVA	X*	X**
10 MVA to 20 MVA	X	X

\* Centralized RTU or equivalent successor with cellular or wireless communication system allowed.

\*\* Voice communication limited to remote designated Person of Contact for Customer System.

These interconnected facilities must comply with the Company's telemetry requirements in order to be properly integrated into the Company communication and control systems.

<b>TITLE: Distributed Energy Resource Standards for Interconnection</b>	<b>STANDARD NUMBER: DR07-01, Rev. 17</b>	<b>EFFECTIVE DATE: 12/15/2019</b>
---	--	-----------------------------------

Case 7 will always require the Customer to install telemetering as described in Section 3.39(2)(B) above regardless of the size of the generator.

### Telemetry Requirements Summary

Generator Size and Type	Data Acquisition Requirement						
less than 1 MVA	No remote telemetry is required						
1 MVA and above, but below 10 MVA	Wireless real-time telemetry for total generation. Note: Load data and hosting capacity limitations evaluation may recommend specific requirements. <table border="1" data-bbox="889 709 1409 823"> <tr> <td>Volts</td> <td>Amps</td> </tr> <tr> <td>Watts</td> <td>VARs</td> </tr> <tr> <td>Line Voltage</td> <td>GOB Status</td> </tr> </table>	Volts	Amps	Watts	VARs	Line Voltage	GOB Status
Volts	Amps						
Watts	VARs						
Line Voltage	GOB Status						
10 MVA to 20 MVA	Real-time (SCADA) telemetry for each individual generating unit 1 MVA and greater along with the following: <table border="1" data-bbox="883 982 1403 1213"> <tr> <td>Volts</td> <td>Amps</td> </tr> <tr> <td>Watts</td> <td>VARs</td> </tr> <tr> <td>Line Voltage</td> <td>Individual GOB Status along with any single isolation breaker, switch, reclosure, etc.</td> </tr> </table>	Volts	Amps	Watts	VARs	Line Voltage	Individual GOB Status along with any single isolation breaker, switch, reclosure, etc.
Volts	Amps						
Watts	VARs						
Line Voltage	Individual GOB Status along with any single isolation breaker, switch, reclosure, etc.						

### 3.40 Metering Requirements

A bidirectional meter shall be applied for an interconnection less than 300 KVA unless specified by a Company study.

The Company has the option to install additional metering at its cost to monitor any DER 300 KVA and above in which a separate company standard meter shall monitor any connected load supplied from the Company's Distribution System. The generator step-up transformer losses will be the Customer's responsibility; therefore, the metering shall be at the distribution voltage level.

TITLE: Distributed Energy Resource Standards for Interconnection	STANDARD NUMBER: DR07-01, Rev. 17	EFFECTIVE DATE: 12/15/2019
--	-----------------------------------	----------------------------

### 3.41 Design Requirements

Many design requirements that the Customer must satisfy are common to all generator types. The common requirements include the disconnect switch, industry certification standards, industry power quality standards, voltage response tables, etc.

#### 3.41.1 Distribution Circuit Models

The importance of the accuracy of the system model cannot be overemphasized; the more closely a system model represents an actual system, the more accurate the analysis. The system model should include both the distribution circuit configuration details and interconnected DER attributes.

#### 3.41.2 Summary of Protective Function Requirements

The size, type, and expected operation of the Customer's generator dictates many of the functional requirements. The functions summarized below list the minimum protection requirements:

- an over-voltage trip,
- an under-voltage trip,
- an over/under frequency trip,
- a loss of phase trip,
- an unintentional islanding trip,
- Either a ground over-voltage or over-current trip relay scheme depending on the grounding system as specified by the Company.
- Will be investigated based under minimum feeder load circumstances. This investigation may alter the requirements.
- For generating facilities under Case 3 that are operating under a testing protocol in which the exported power exceeds the minimum daytime loading or 50% loading of the connected distribution feeder circuit, a reverse power-sensing scheme is also required within the generator controls and/or external company owned device along with a direct transfer trip protection from the feeder breaker.

#### 3.41.3 Facilities with Parallel Generation Under 300 KVA

Connecting Small Electric Generators to the Company Distribution System under 300 KVA.

- Applications 15 KVA and under would receive direct approval based on the hosting capacity of the interconnected transformer.
- Applications greater than 15 KVA and under 300 KVA would receive a Feasibility Study to evaluate the impact based on the available hosting capacity from previous interconnections.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### **3.41.4 Facilities with Parallel Generation 300 KVA to 20 MVA**

Whenever possible, generators greater than 3 MVA should be constructed in blocks that support the use of generally available 2 or 3 MVA transformers while minimizing transformer energization inrush. Using such transformers would help mitigate total system outages during sectionalized outages taken to support maintenance. Although transformer standardization is recommended for all generators interconnected to the Company's Distribution System, this is a requirement for all Company-owned equipment (including equipment managed under partnership agreements) unless the System Impact Study or Facilities Study identifies otherwise.

#### **A. Facilities Rated 300 KVA to Below 10 MVA**

These facilities must include at a minimum a telemetry/transfer trip that will support a backup function for the latest version of IEEE 1547 automatic loss of grid/unintentional islanding detection features. Cellular and other wireless communication systems shall be allowed in lieu of standard wired or fiber linked communications, since this telemetry/transfer trip feature supports a backup function. Power quality monitoring shall be included with all interconnect applications via a Company-approved device or direct telemetry from the generator. A remotely-operated load break switch shall be required on all applications 1 MVA and above with inclusions of these remote isolation devices on systems below this capacity based on evaluation/study requirements.

#### **B. Facilities Rated 10 MVA and Above**

In addition to the above requirements, these facilities must include constant communication with the Distribution Operation Control Center and/or Distributed Energy Resource Management System (DERMS) along with any necessary Direct Transfer Trip (DTT) support requirements.


Also, to prevent protective feature isolations/trips of the Company's Distribution System upon transformer energizations, large generator (or DER) interconnections shall be sectionalized to limited initial transformer energization to a maximum of 10 MVA. Switchgear, manual gang switches, or a similar three-phase simultaneous switching device should be used to support these restricted transformer inrush limitations. This would also eliminate total system outages during sectionalized outages to support maintenance.

TITLE: Distributed Energy Resource Standards for Interconnection	STANDARD NUMBER: DR07-01, Rev. 17	EFFECTIVE DATE: 12/15/2019
--	-----------------------------------	----------------------------

### 3.42 Categories for Distribution-Level Interconnections

The following categories for distribution-level interconnections exist for generators that are allowed to electrically parallel with the electrical power system through a single point of interconnection. Typical installations:

#### Category 1: Parallel Generation Under 300 KVA

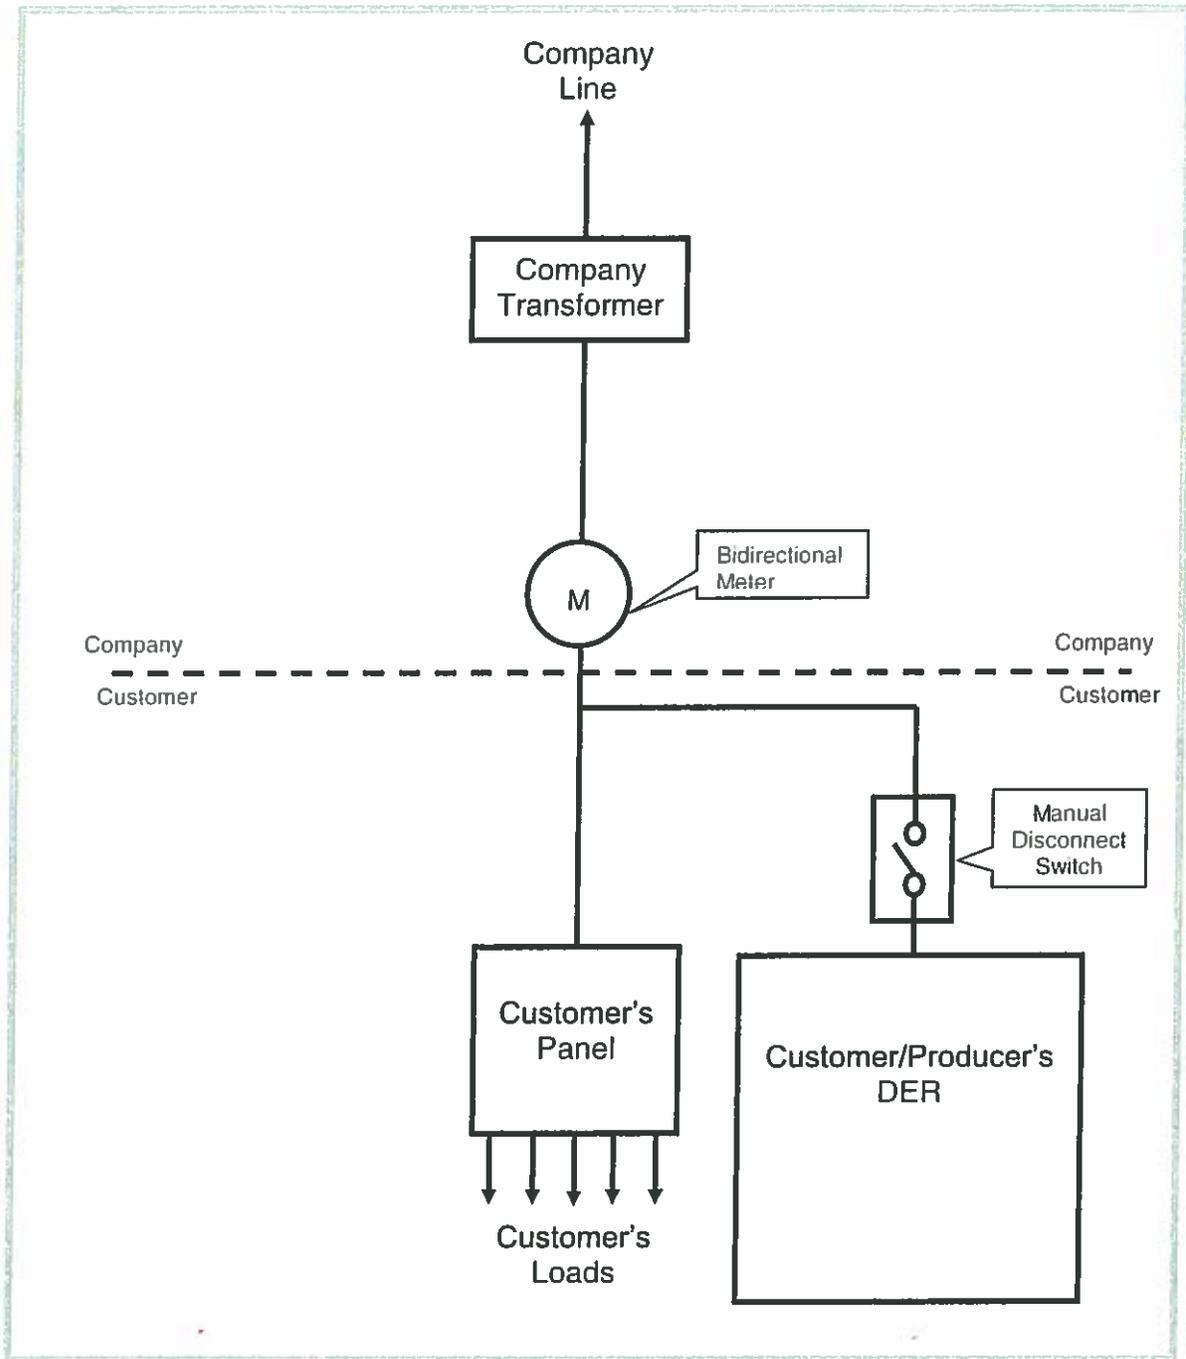


TITLE: Distributed Energy Resource  
Standards for Interconnection


STANDARD NUMBER:  
DR07-01, Rev. 17

EFFECTIVE DATE:  
12/15/2019


**Category 2: Interconnection using existing transformer with single generation sources.**

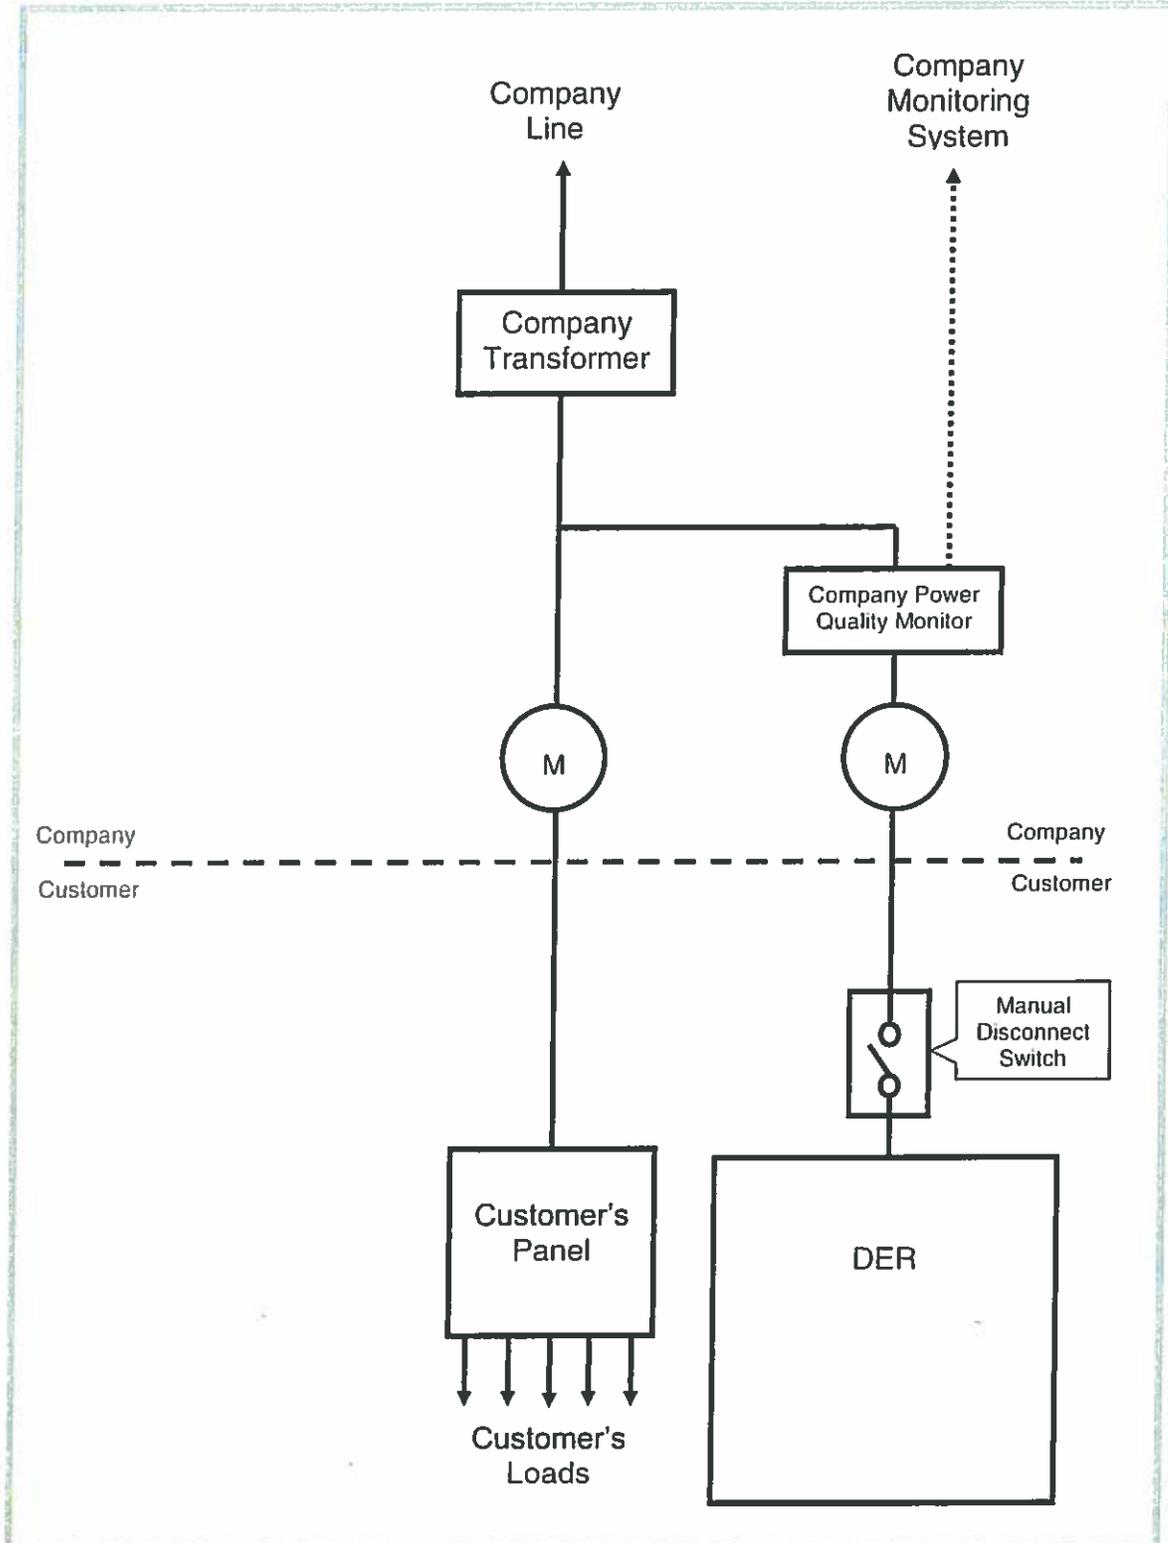


Category 3: Large commercial parallel generation with multiple generation sources.

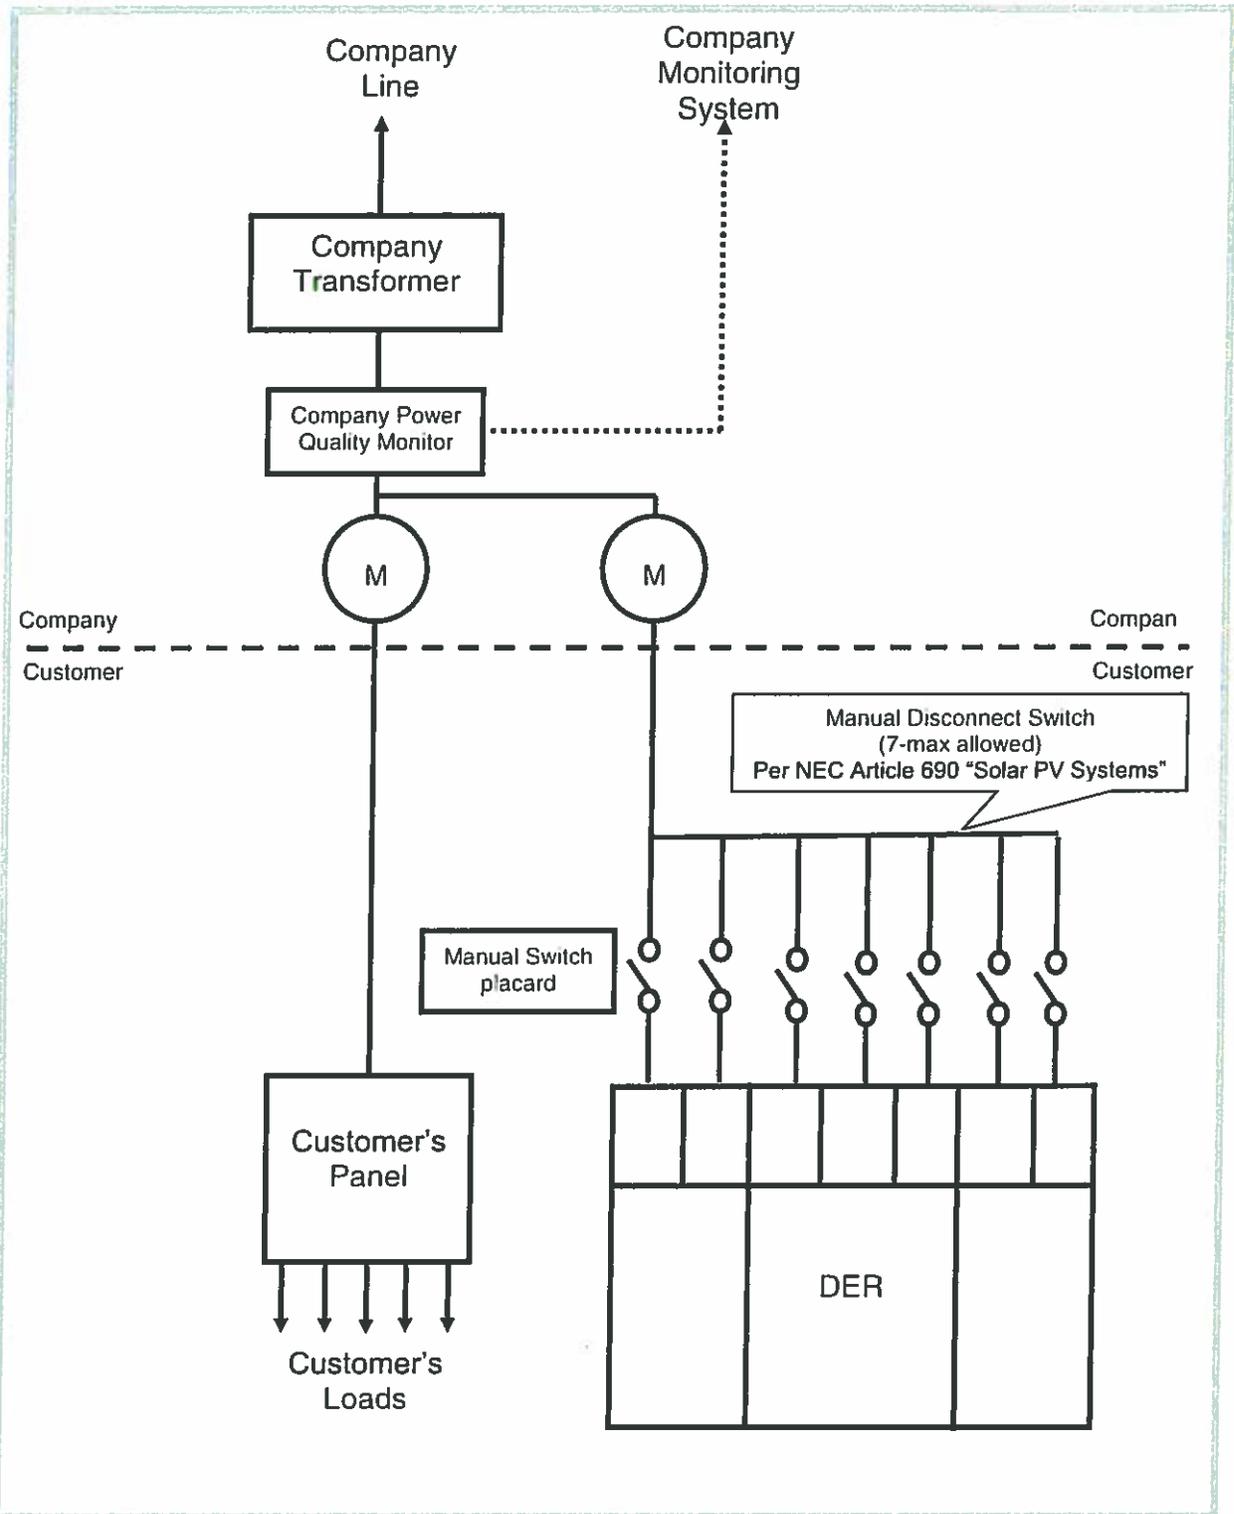

Category 4: Large commercial parallel generation with remote isolation device.

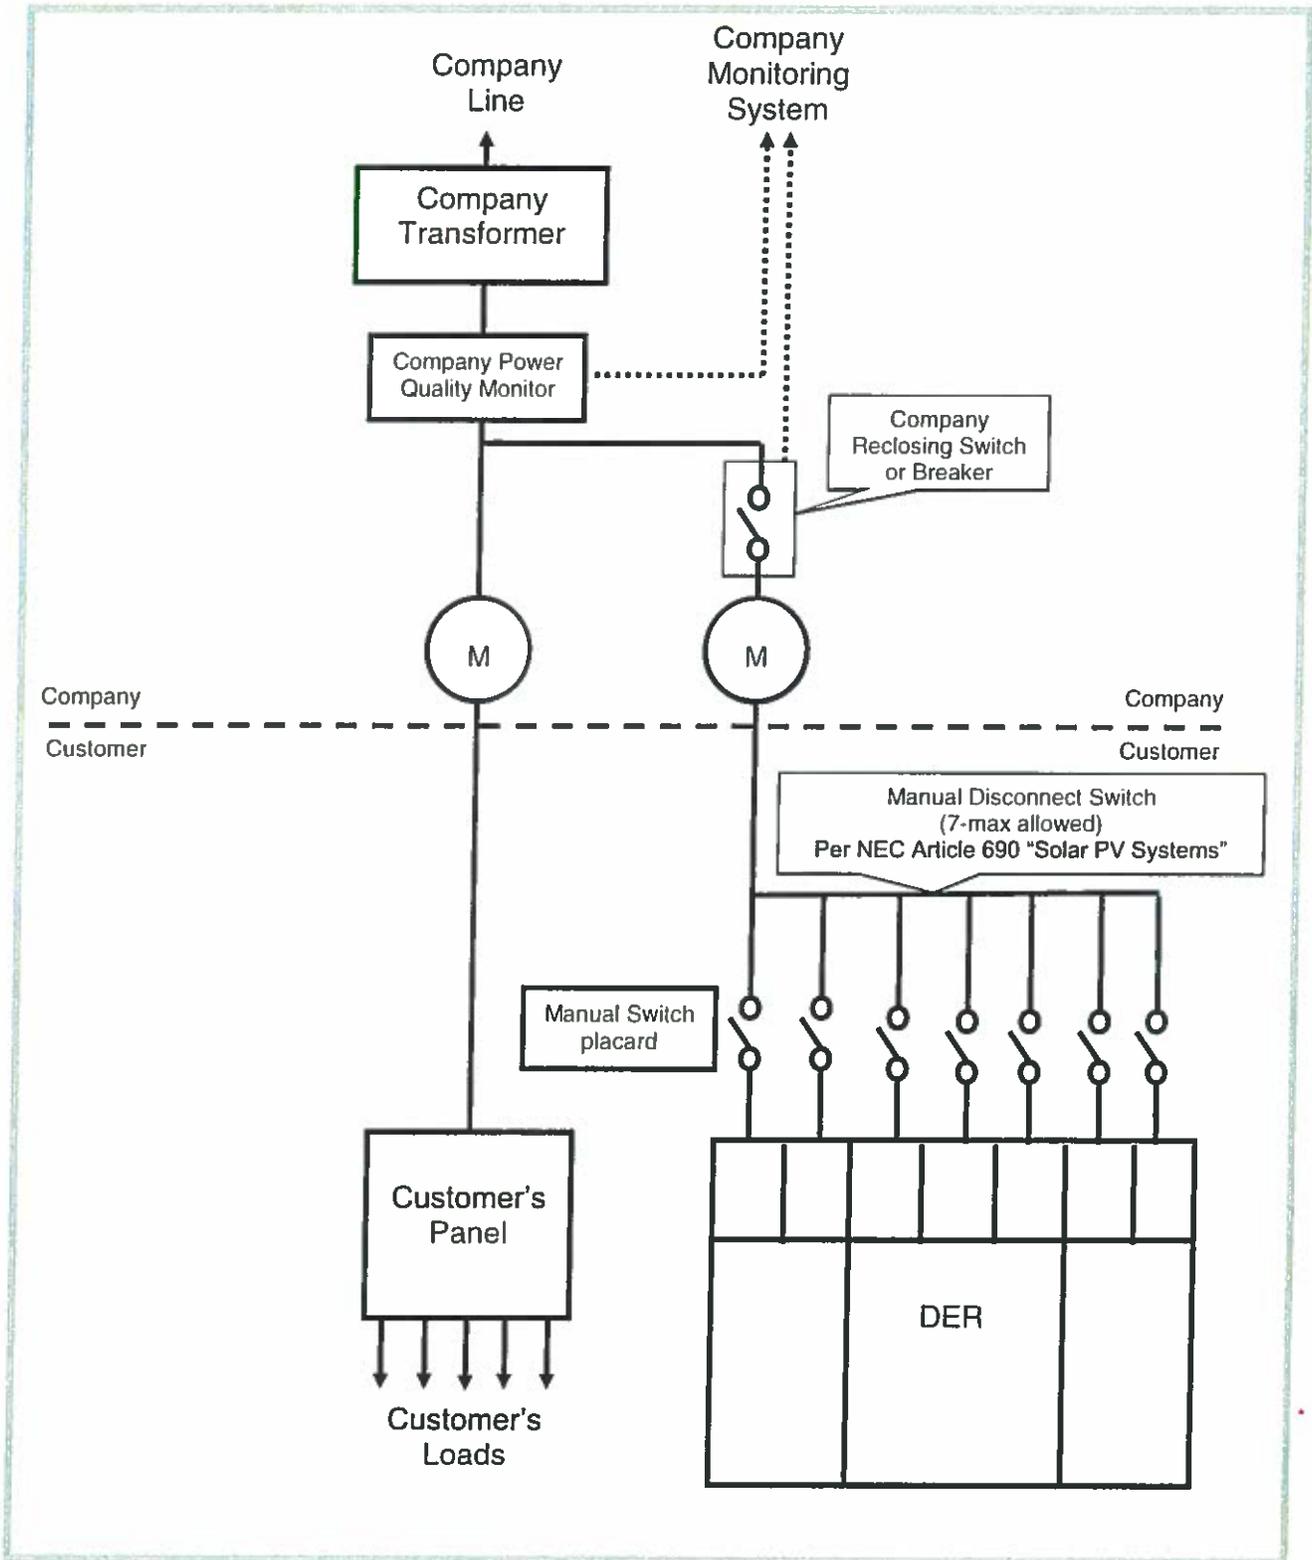


Category 5: Large commercial parallel generation with dedicated transformer

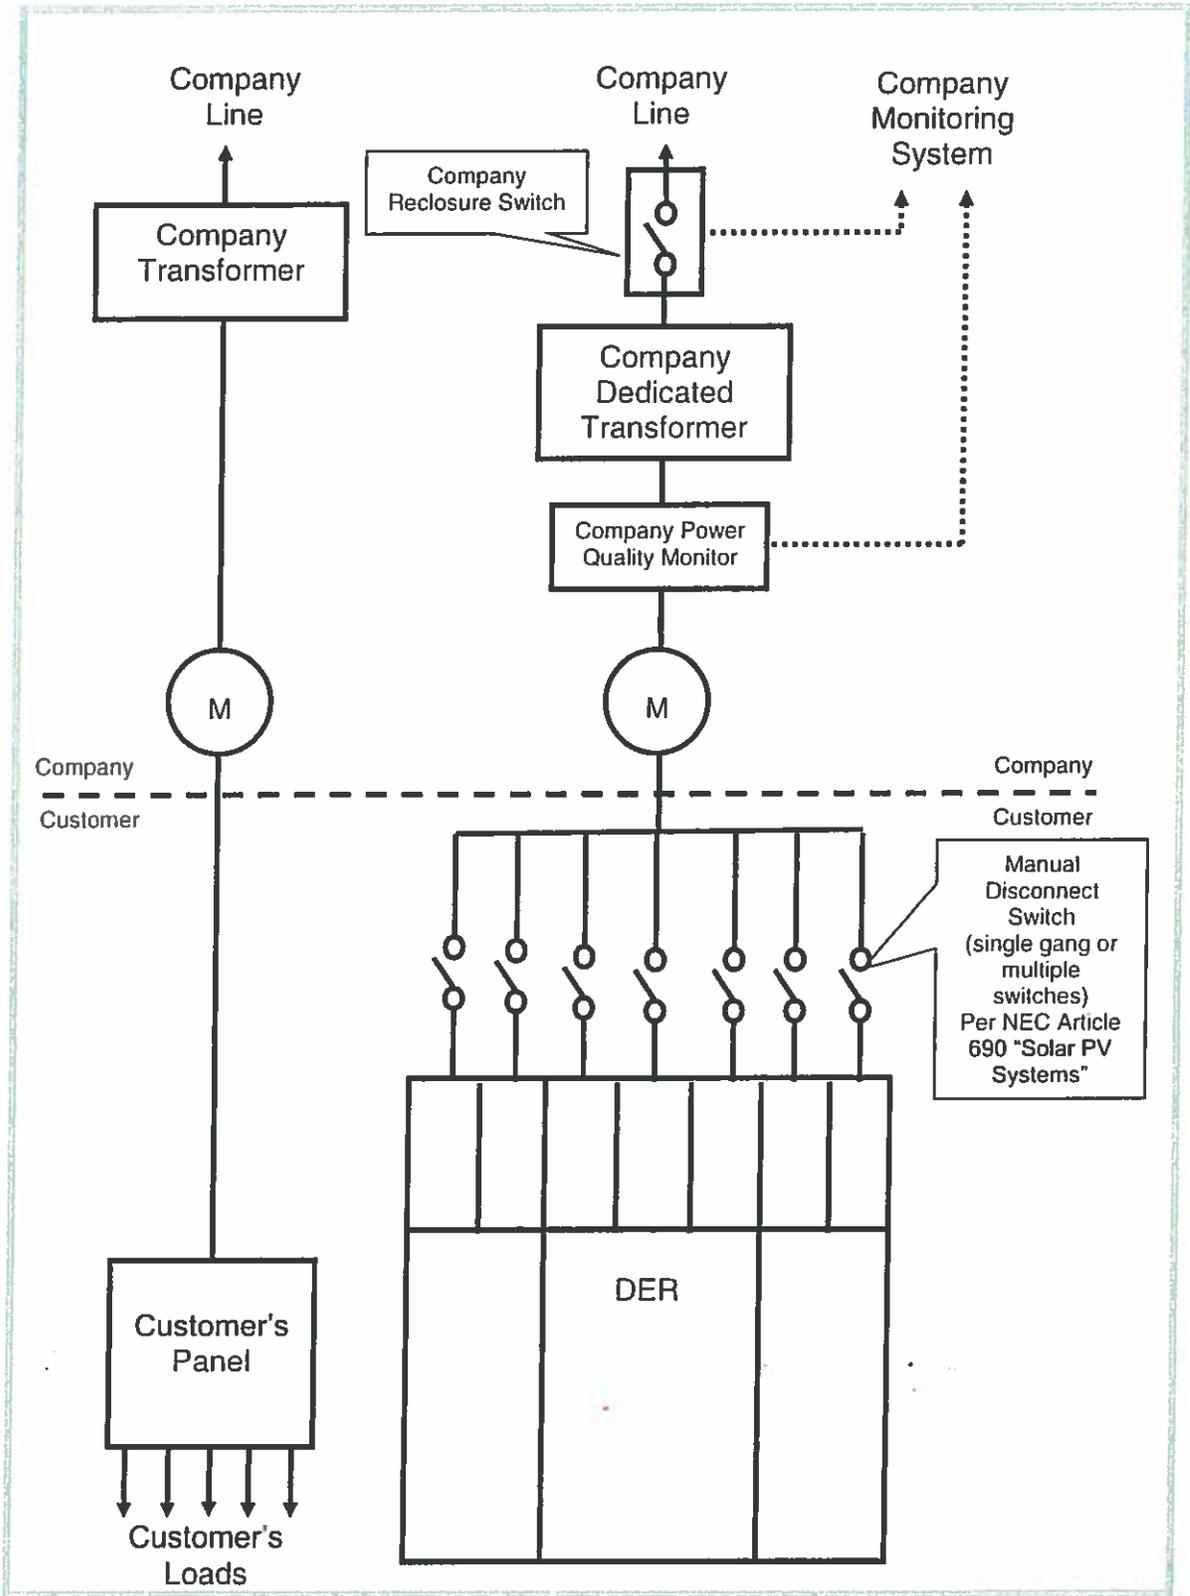

TITLE: Distributed Energy Resource Standards for Interconnection	STANDARD NUMBER: DR07-01, Rev. 17	EFFECTIVE DATE: 12/15/2019
--	-----------------------------------	----------------------------

**Category 6: Large commercial parallel generation greater than 10 MVA Up to 20 MVA with dedicated transformers**

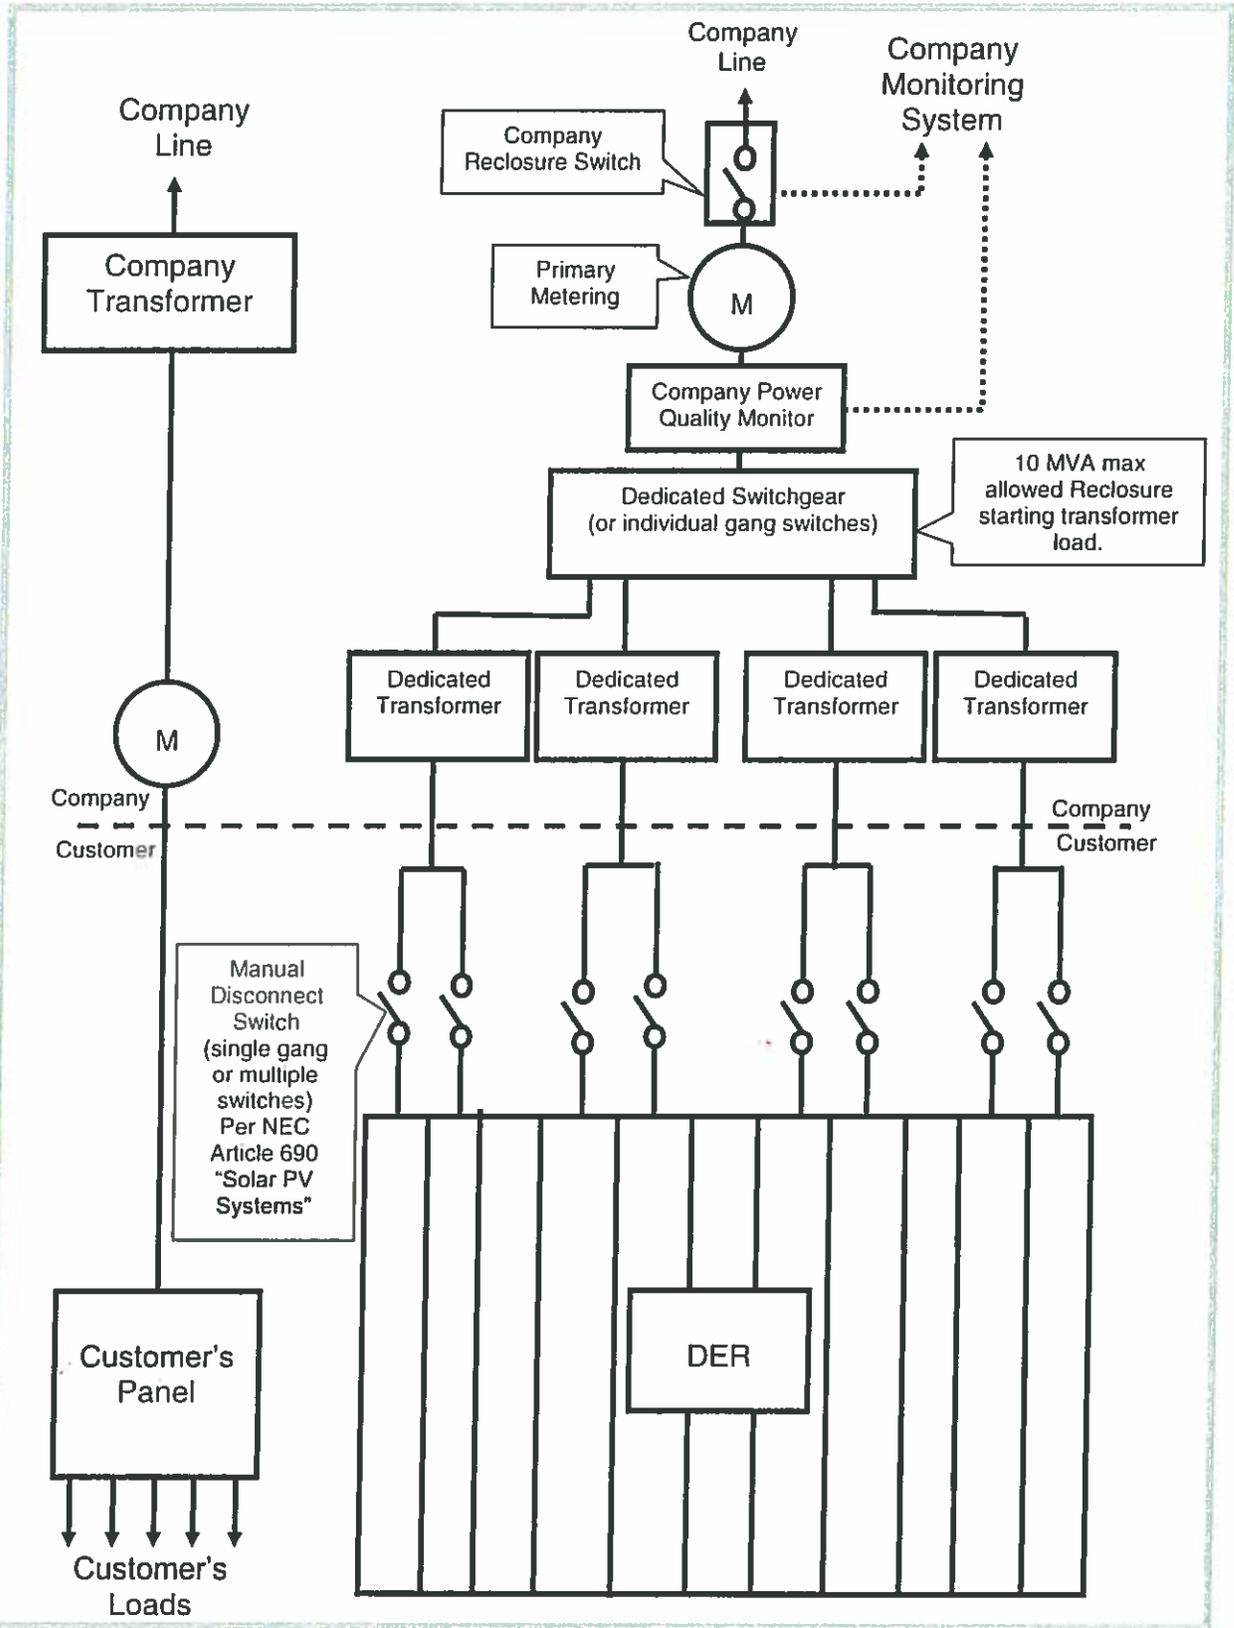

TITLE: Distributed Energy Resource Standards for Interconnection	STANDARD NUMBER: DR07-01, Rev. 17	EFFECTIVE DATE: 12/15/2019
--	-----------------------------------	----------------------------

### 3.43 Tests of the Customer's Equipment

The Company reserves the right, but has no responsibility either actual or implied, to observe the Customer's tests and/or inspection of any of the Customer's protective equipment that is essential to the interconnection, including relays, circuit breakers, protective devices, and related equipment. Inspection shall include simulated test tripping of the Customer's interconnection breakers by the protective relays to verify all protective set points and relay/breaker trip timing prior to connection to the Company's Distribution System.

Unless a different time is otherwise prescribed by a Retail Regulator, the Customer shall provide the Company with notice at least two weeks before the initial energizing and start-up testing of the Customer's generating equipment so that the Company may witness the testing of any equipment and protective systems associated with the interconnection.

### 3.44 Pre-parallel Testing

Commissioning testing, where required, will be performed on-site to verify protective settings and functionality. Upon initial Parallel Operation of a generator, or anytime interface hardware or software is changed that may affect the functions listed below, a commissioning test must be performed. Individual qualified in-testing protective equipment (professional engineer, factory-certified technician, or licensed electrician with experience in testing protective equipment) must perform commissioning testing in accordance with the manufacturer's recommended test procedure to verify the settings and requirements per this standard.

The Company may require that a written commissioning test procedure be submitted at least 10 working days prior to the performance of the commissioning test. The Company has the right, but not obligation, to witness any commissioning test. The Company may also require written certification by the installer describing which tests were performed and their results. Protective Functions to be tested during commissioning, particularly with respect to non-Certified Equipment, may consist of the following:

- Over and under voltage (IEEE Devices 27 and 47)
- Company Distribution System fault detection / Short Circuit Protection (Devices 51 or 67, 51-Neutral or 59-Ground)
- Over and under frequency (Device 81 Over and Under)
- Loss of Phase (Devices 27 or 47, 87)
- Anti-Islanding Function (Device 27/59, 81O, 81U)
- Non-Export Function (if applicable) (Device 46 and/or 67 or 32)
- Inability to energize dead line (Device 27)

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

- Time delay on restart after utility source is stable (Devices 2, 24, 27, 81, 87)
- Synchronizing controls (if applicable) (Devices 25 and 78)
- Breaker Closing/Reclosing Control (Devices 25, 47/79)
- Other Interconnection Protective Functions that may be required as part of the Interconnection Agreement

Commissioning testing shall include visual inspections of the interconnection equipment and protective settings to confirm compliance with the interconnection requirements. Other checks and tests that may need to be performed include:

- Verifying final Protective Function settings
- Trip test
- In-service test

### 3.44.1 Certified Equipment

A generator qualifying for interconnection must incorporate UL Certified Equipment that has, at a minimum, passed the commissioning tests described in this standard and are judged to have little or no potential impact on the Company's distribution system. For such generators, it is necessary to perform the following tests:

- 1) Protective Function settings that have been changed after commissioning testing will require field verification. Tests shall be performed using injected secondary frequencies, voltages and currents, applied waveforms, a test connection using a generator to simulate abnormal utility voltage or frequency, or varying the set points to show that the device trips at the measured (actual) utility voltage or frequency.
- 2) The non-exporting function shall be checked using secondary injection techniques. This function may also be tested by adjusting the generator output and local loads to verify that the applicable non-exporting criteria (i.e., reverse power or under power) are met.

The Feasibility Study and/or a System Impact Study may impose additional components or additional testing.

TITLE: Distributed Energy Resource Standards for Interconnection	STANDARD NUMBER: DR07-01, Rev. 17	EFFECTIVE DATE: 12/15/2019
--	-----------------------------------	----------------------------

### 3.44.2 Non-Certified Equipment

Non-Certified Equipment shall be subject to the appropriate tests and any additional requirements as well as those described above. With the Company's approval, these tests may be performed in the factory, in the field as part of commissioning, or a combination of both. The Company, at its discretion, may also approve a reduced set of tests for a particular generator or, for example, if it determines it has sufficient experience with the equipment.

### 3.44.3 Verification of Settings

At the completion of commissioning testing, the Customer shall confirm all devices are set to Company-approved settings. Verification shall be documented in the commissioning test documentation.

### 3.45 Requirements for Commercial (Parallel) Operation

A Customer's generator and Interconnection Facilities shall be reasonably accessible to Company personnel as necessary for Company to perform its duties and exercise its rights in accordance with the Interconnection Agreement between Company and Customer.

Customer shall operate and maintain its generator and Interconnection Facilities in accordance with electrical practices and shall maintain compliance with approved Interconnection Agreement.

The Company may limit the operation, disconnect, or require the disconnection of a Customer's generator from the Company's Distribution System at any time, with or without notice, in the event of an emergency, or to correct unsafe operating conditions. In accordance with the Interconnection Agreement, the Company may also limit the operation, disconnect, or require the disconnection of Customer's generator from the Company's Distribution System upon the provision of reasonable written notice:

- 1) To allow for routine maintenance, repairs or modifications to the Company's distribution system;
- 2) Upon the Company's determination that a Customer's generator is not in compliance with this Standard and any applicable tariffs or rules that apply to the interconnection; or
- 3) Upon termination of the Interconnection Agreement.

Upon the Customer's written request, the Company shall provide a written explanation of the reason for such curtailment or disconnection.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

### **3.46 Responsibility for Customer's Operations**

The Company is not responsible for proper operations of the Customer's generation facilities connected to the Company's Distribution System.

### **3.47 Load Shed Responsibilities**

If the Customer's generator drops off line in which an automatic load shed scheme is required, the Customer at this point shall shed the agreed upon load within 10 cycles of the generator dropping off line to prevent this additional load exceeding the available capacity of or causes excessive voltage sag on the distribution circuit. Such requirements shall be noted in the Interconnection Agreement and communicated to the appropriate Company's planning engineering organization.

For a Customer whose generator operations are described by Case 2, Case 3, or Case 4, and who also has a contract with the Company for stand-by or maintenance power, arrangements should be made in the design of the Customer's system to allow for load shed under emergency conditions on the Distribution System.

### **3.48 Reconnection to Distribution Delivery System**

The Company may require the Customer to wait up to five minutes to reconnect after the Company's Distribution System voltage and frequency return to normal range and the system is stabilized. Consult the Company for details. (IEEE 1547 latest version)

### **3.49 Disconnecting Service to a Customer Facility**

The Interconnection Agreement, tariffs, and applicable policies and procedures, including those of the Company's Retail Regulator, may state criteria for disconnection of Customer facilities which are interconnected to the Company's Distribution System. In general, Customer facilities may be curtailed or disconnected in emergency situations and/or if the Company determines that their continued operation creates a threat to personnel or the Distribution System.

### **3.50 Responsibility for Customer Maintenance**

The Customer bears the sole responsibility for maintaining its electrical equipment. The Customer will maintain records of such maintenance activities, which the Company may review at reasonable times upon request. For any generator greater than 300 KVA, a log of generator operations shall be kept by the Customer. At a minimum, the log shall include the date, generator time on, and generator time off, and megawatt and megaVAR output. Maintenance records should be made available for the Company's inspection upon request. The Company reserves the right to inspect the records but has no responsibilities for maintenance either actual or implied.

TITLE: Distributed Energy Resource Standards for Interconnection	STANDARD NUMBER: DR07-01, Rev. 17	EFFECTIVE DATE: 12/15/2019
--	-----------------------------------	----------------------------

### 3.51 Alterations to Existing Service

The Company's facilities, including meters, transformers, and other equipment, are sized and installed to satisfy the Customer's requirements at the time service is initiated and are based on information supplied by the Customer. Consulting with the Company regarding any change in the Customer's requirements is required. It is essential that the Customer give adequate prior notice to the Company of any substantial additional load or capacity (e.g., a large motor or generator) that is to be connected to the Company's Distribution System. The Customer should not proceed to make these additions until after the Company has notified the Customer that it can either supply the increased load or the conditions under which the increased load or capacity can be accommodated. The Company is not liable for any damages incurred by the Customer connecting additional equipment without notice to the Company.

### 3.52 SYSTEM CHANGES

#### 3.52.1 Company Changes to Distribution System

The Company's Distribution System is a dynamic and changing system. If the Company changes the distribution voltage that serves the Customer's location, the Customer will be responsible for paying for all modifications of its equipment that may be required for reconnecting to the Company's reconfigured Distribution System.

#### 3.52.2 Customer Changes to Interconnection

The Customer shall notify the Company to obtain prior approval for any proposed modifications to the interconnecting scheme. This includes equipment and software/firmware updates.

### 3.53 PENALTY FOR INTERCONNECTING WITHOUT COMPANY AUTHORIZATION

A Customer who interconnects a generator without the Company's prior written authorization will be: (1) liable and responsible for all damages (including any and all third-party damages) and expenses (including all legal fees) that result; (2) responsible for all of the Company's incurred expenses to ensure the safety and reliability of the Company's Distribution System caused by the unauthorized interconnection of the Customer's generator; and (3) subject to surcharges or other penalties as permitted by the Company's Retail Regulator.

TITLE: **Distributed Energy Resource  
Standards for Interconnection**

STANDARD NUMBER:  
**DR07-01, Rev. 17**

EFFECTIVE DATE:  
**12/15/2019**

### **3.54 Periodic Testing**

Per the latest version of IEEE-1547, periodic tests shall be performed according to a scheduled time period or other criteria to confirm the performance of any interconnected device or combination of devices forming a system. Unless otherwise specified, periodic testing for generators exporting 300 KVA or greater shall be required with a maximum interval between tests of 5 years. A log of the testing results shall be kept. All test results shall be submitted and added to the log within 30 days following the performance test. The log shall be made available to the Company upon request.

Periodic test requirements and intervals for all interconnection-related Protective Functions and any associated batteries shall be provided by equipment manufacturers or Company personnel.

Reverification of conformance with the interconnection and interoperability requirements of this Standard may be required when any of the following events occur:

- Functional software or firmware changes have been made.
- Any hardware component of the generator has been modified in the field or has been replaced or repaired with parts that are not substitutive components compliant with this Standard.
- Protection settings have been changed after factory testing.
- Protective Functions have been adjusted after the initial commissioning test process.

TITLE: <b>Distributed Energy Resource Standards for Interconnection</b>	STANDARD NUMBER: <b>DR07-01, Rev. 17</b>	EFFECTIVE DATE: <b>12/15/2019</b>
---	--	-----------------------------------

## 4.0 References

- IEEE 1547-2018 Standard for Interconnecting and Interoperability of Distributed Energy Resources with Associated Electric Power Systems Interfaces
- UL 1741-SA
- California Rule 21
- Connecting Small Electric Generators to the Entergy Distribution System (less than 300kVA) (Latest Edition), Entergy Standard Number DR0702 (superseded by this Revision 17 of DR07-01)
- Connecting Large Electric Generators to the Entergy Distribution System (300kVA to 20MVA) (Latest Edition), Entergy Standard Number DR0701 (superseded by this Revision 17 of DR07-01)
- Entergy Customer Installation Standards for Electric Service (Latest edition)
- Entergy Power Quality Standards for Electric Service, latest edition
- Midcontinent Independent System Operator, Inc. Open Access Transmission Tariff (OATT), latest version
- Operating Company Interconnection Agreements
- Applicable Retail Regulator rules, policies, and procedures

## 5.0 Responsibilities

### 5.1 Interpretation

Interpretation of this document is the responsibility of the Manager of Standards & Engineering Services or the Manager's designee with concurrence of the Asset Planning Department, the Distribution Business Department, and other Company personnel.

### 5.2 Deviation

The Manager of Standards & Engineering Services is responsible for ensuring that this document is written in accordance with federal, state, and national code requirements as well as consideration of applicable Retail Regulator rules, policies, and procedures. Any requested deviations must be reported to the Manager of Standards & Engineering Services to be considered for inclusion in this document.

In the event requirements for a specific design, configuration, or type of equipment are not set forth in this document, the Customer may interconnect using mutually-agreed upon technical standards, as authorized by the Manager of Standards & Engineering Services and Company personnel. Deviation from this document may be made only with the consent of the Manager of Standards & Engineering Services or the Manager's designee in consultation with Company personnel. No other employee is granted independent authority to grant deviations.